


**FIRE SUPPRESSION SYSTEM**

Overall R1D2 local fire System 2W

Fire alarm and electrical to be completed by others

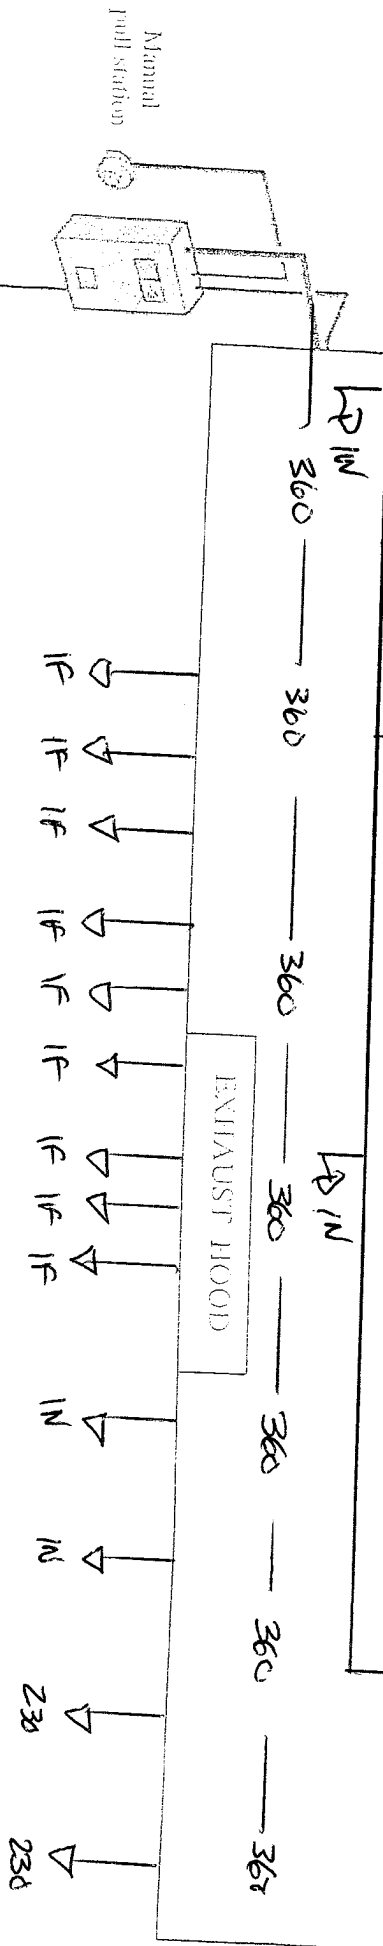

The detectors trigger the releasing mechanism which actuates the system... pressurizing the agent storage tank.

Liquid suppressant flows through the distribution piping to discharge

Chemical is applied directly on the fire in specific spray patterns... suppressing the fire in seconds.

38" OVEN	X	X	X	X	X	X			
36" Range	X	X	X	X	X	X			
36" Range	X	X	X	X	X	X			
36" Range	X	X	X	X	X	X			
48" CHAIR									
16" Fry									
16" Fry									

Job Name: T1QA  
Address: 327 COMMERCIAL STREET  
PORTLAND MAINE

Date: 16/3/14  
Submitted To: E/D