


brawings 254 Commercial St.

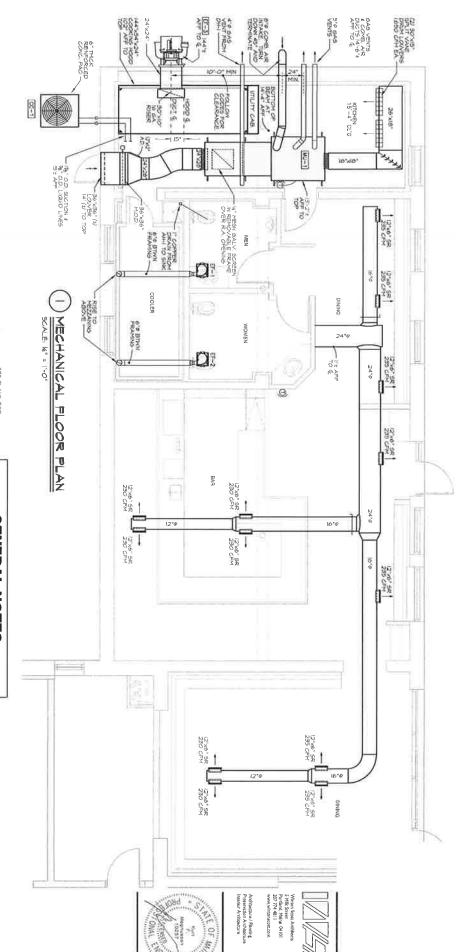



FASTENER!



## GENERAL NOTES

- Mechanical Contractor shall coordinate work with at other trades.

  All ciping and ductwork shall be run concealed and on the warm side.
- All piping and ductwork shall be run concealed and on the warm side of building insulation unless afrown otherwise.
- Pliping and ductwork is shown diagramatically. Exact locations to be adjusted as required to conform to field conditions.

  All duct sizes indicated are nutside (sheet metal) dimensions.
- All duct sizes indicated are outside (sheet metal) dimensions.
- All cutting and patching by the General Contractor.

  All square duct albows over 12 inches in width to have turning vanes.
- All motorized dampers and duct smoke detectors shall have duct access doors as large as possible up to  $12^{\circ}\times12^{\circ}$ .
- All dimensions associated with existing conditions are approximate and are to be field verified.

King's Head Pub

Merrill's Wharf Portland, Malne July 01, 2013

Mechanical Floor Plans

Scale: 1/4" = 1'-0"

MECHANICAL SYSTEMS ENGINEERS

ROYAL RIVER CENTER, UNIT #10

10 FOREST FALLS DRIVE

FACEBOOK: MECHANICAL SYSTEMS ENGINEERS

207-845-1441

© COPMENT 2013

© COPMENT 2013

<u>Z</u>