
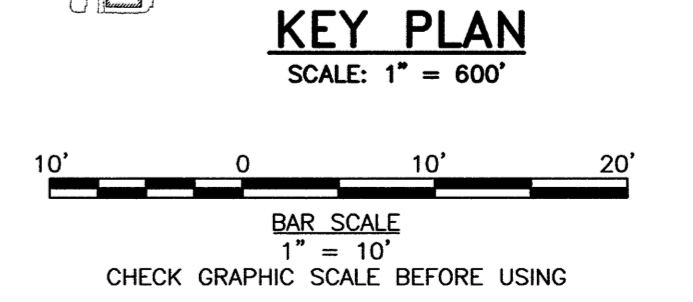
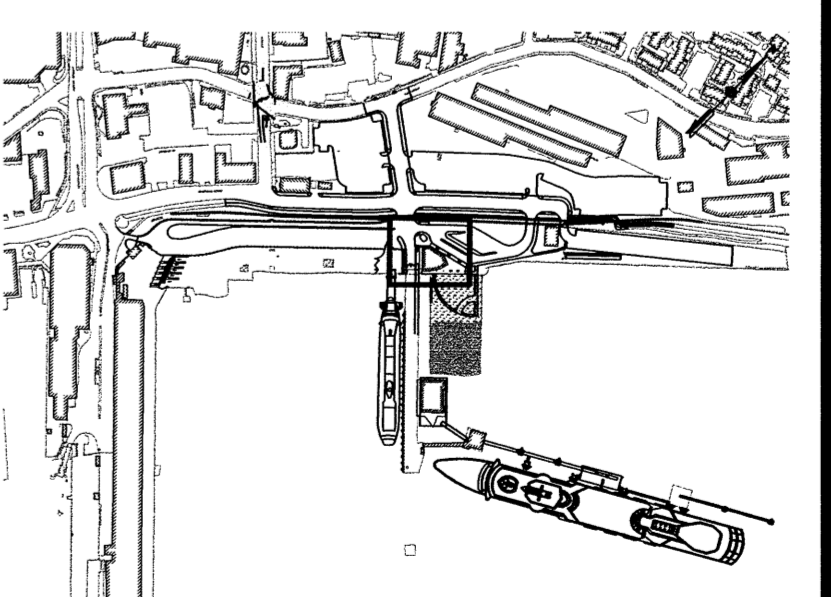
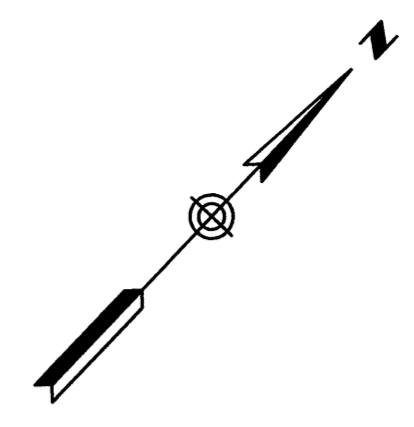


Filename: \\Portland\Projects\203438 Ocean Gateway - Phase 1 Engineering\Project Deliverables\VAAP Drawings\2005-12-23, VAAP 20.1\Civil\20343802-C219.dwg, Dec 23, 2005 - 2:18pm

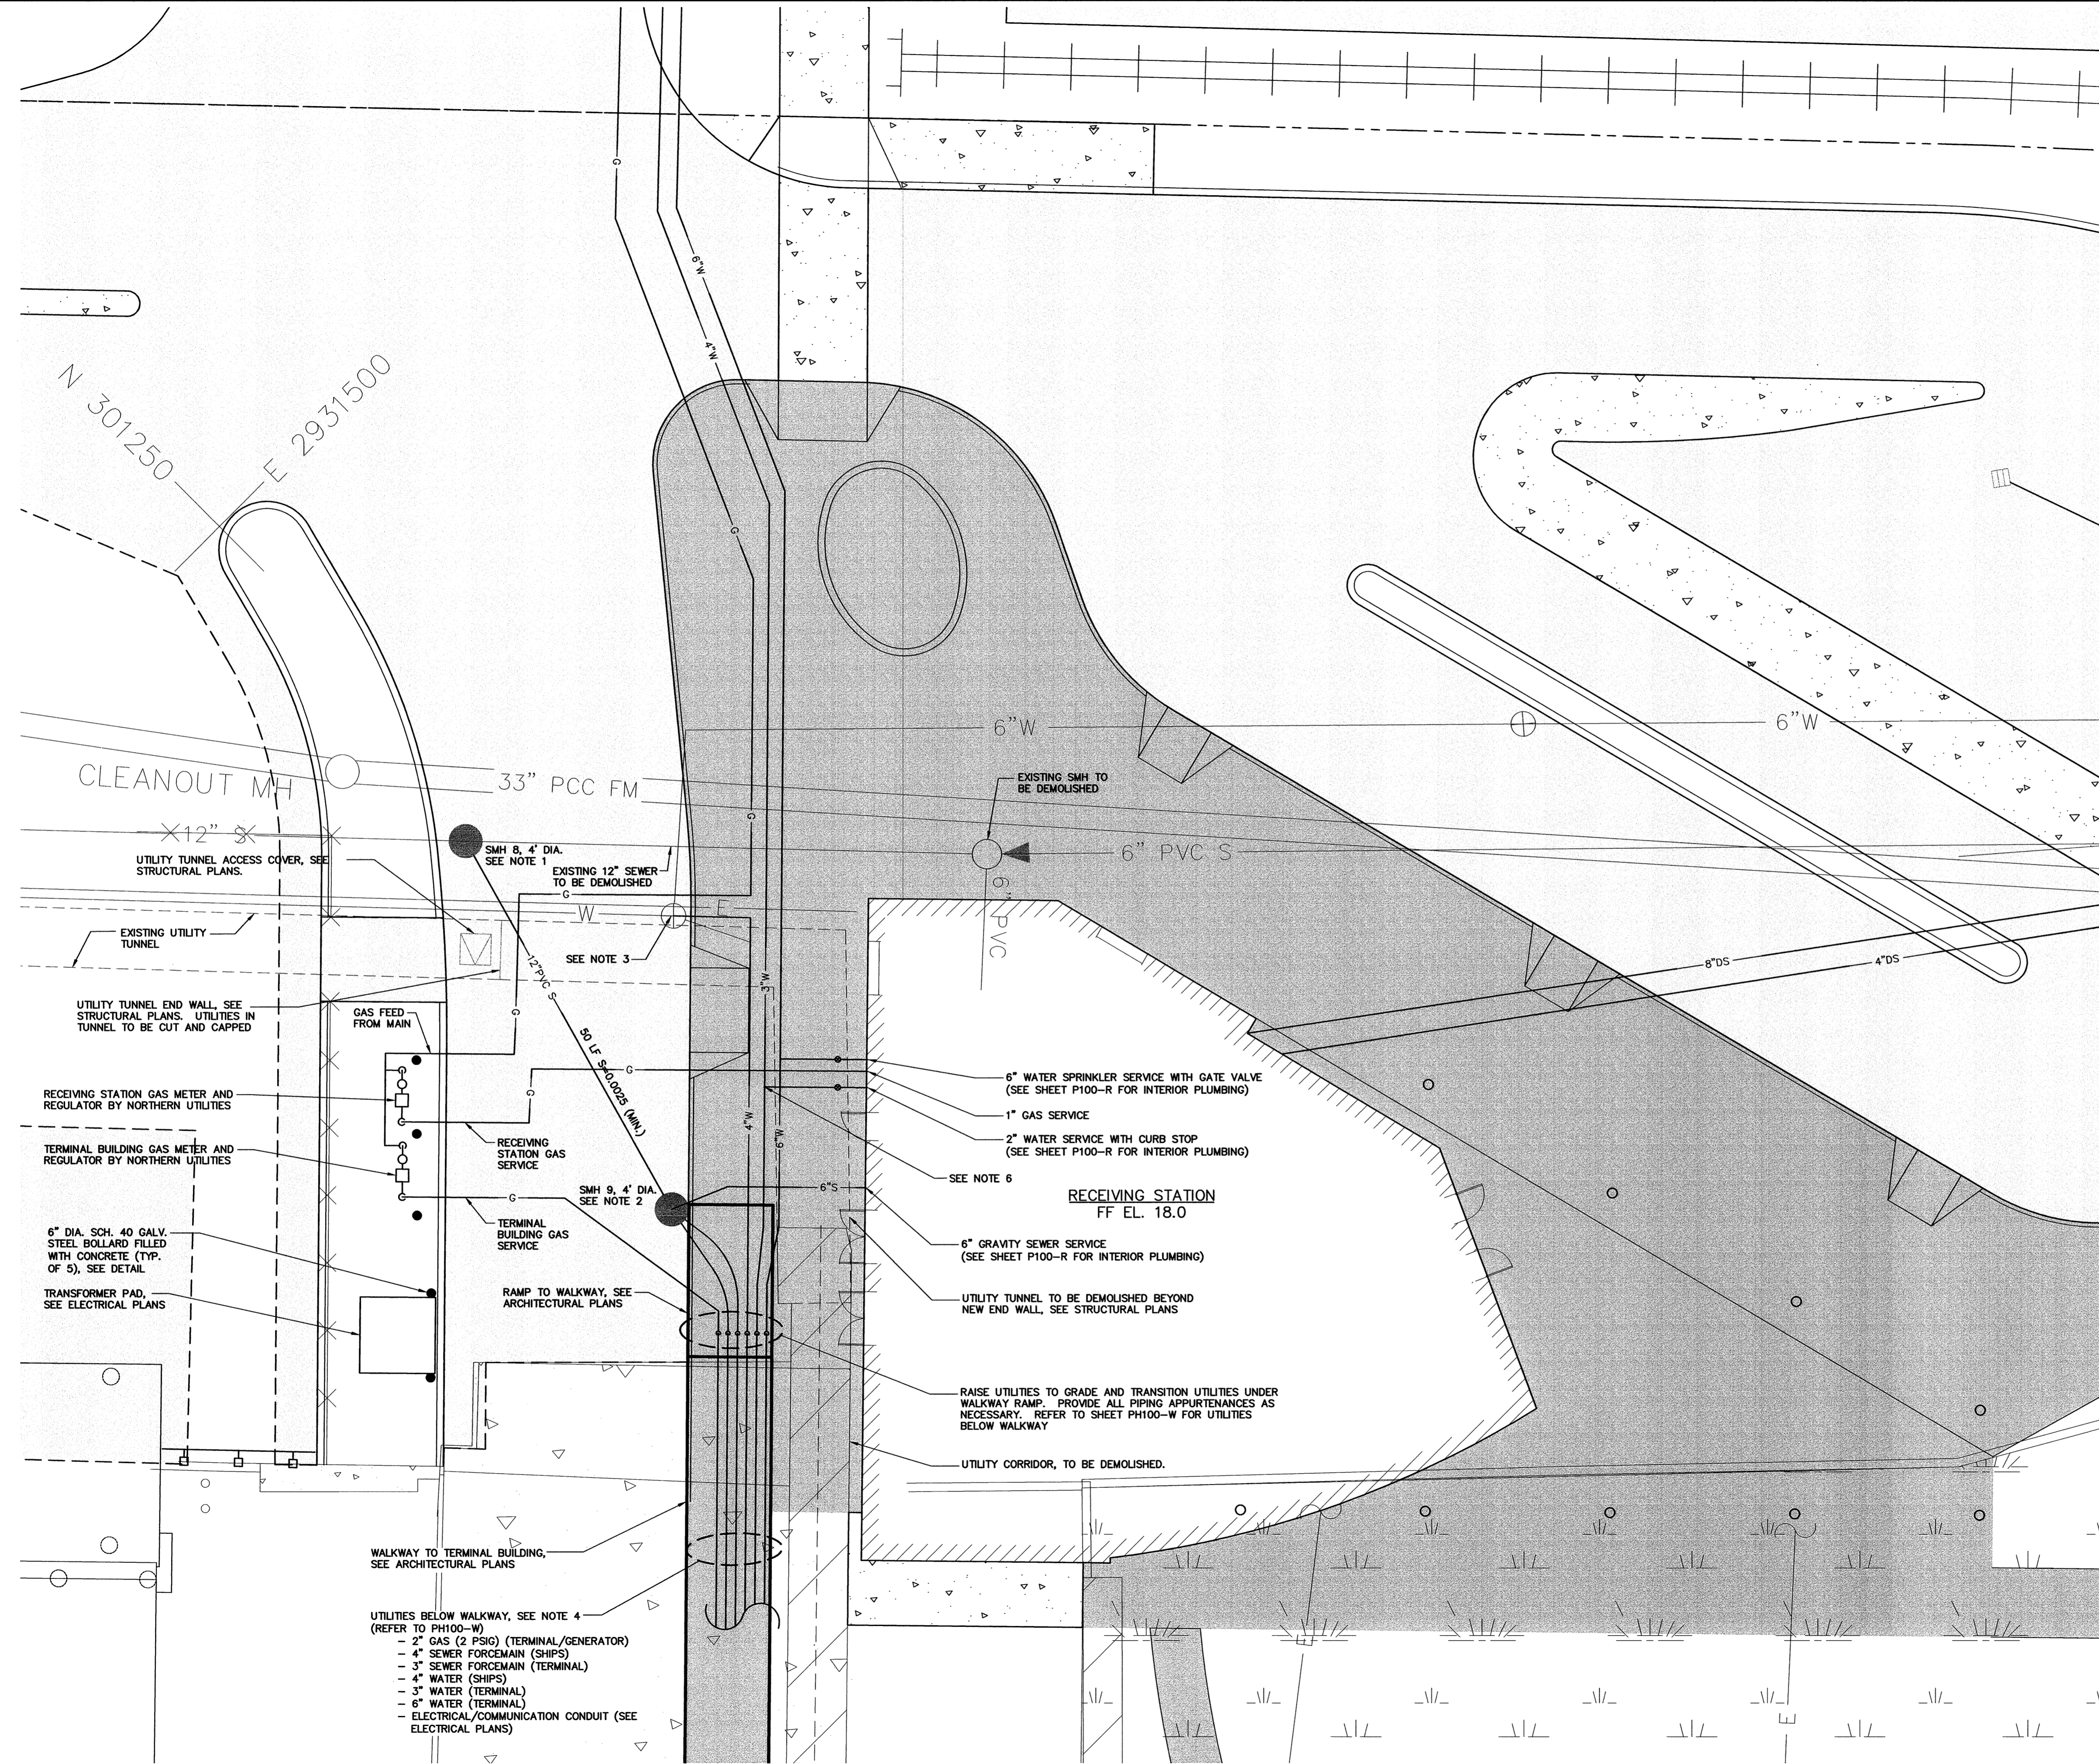


MLLW = 0.00 FT = -4.57 FT NGVD 1929

- NOTES:**
1. TEST PIT REQUIRED TO DETERMINE INVERT OF EXISTING 12" SEWER. MANHOLE DEPTH AND INVERTS AS DETERMINED BY TEST PIT RESULTS.
 2. SEWER MANHOLE DEPTH AS DETERMINED BY TEST PIT RESULTS AND SLOPE OF 12" PVC SEWER BETWEEN SMH 8 AND SMH 9.
 3. REDUCE EXISTING 10" W TO 4" D.J. WATER BEYOND GATE VALVE FOR VESSEL SERVICE. EXISTING 6" SERVICE TO PAINT STORAGE BUILDING TO BE DEMOLISHED.
 4. UTILITIES BENEATH WALKWAY LISTED LEFT TO RIGHT IN PLAN VIEW FOR CLARITY PURPOSES.
 5. REMOVE AND DISPOSE EXISTING UTILITY SERVICES TO PAINT STORAGE BUILDING BELOW RECEIVING STATION. EVACUATE AND PROVIDE MECHANICAL JOINT CAPS AND RETAINER GLANDS ON ABANDONED WATER AND SEWER SERVICES EAST OF RECEIVING STATION. RECORD LOCATION OF ALL ABANDONED PIPE.
 6. REDUCE 4" W TO 3" WATER BEYOND RECEIVING STATION SERVICE.

WOODARD & CURRAN
Engineering • Science • Operations
41 Hutchins Drive - Portland, Maine 04102

STATE OF MAINE
DEPARTMENT OF TRANSPORTATION
PROJECT NUMBER 009215.00
PIN
009215.00

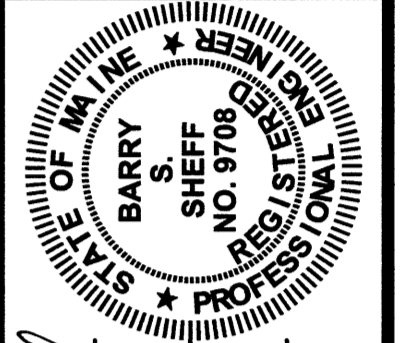

Barry S. Sheff
SIGNATURE
9708
P.E. NUMBER
12/23/05
DATE

PROJ. MANAGER	PAUL POTTE	DATE	BY
DESIGN-DETAILED	DAS	01/14/05	JBC
CHECKED-REVIEWED	DAS	01/14/05	BSS
DESIGN-DETAILED			
DESIGN-DETAILED			
REVISIONS 1	MODIFIED PER VAAP201	10/17/05	
REVISIONS 2	MODIFIED PER VAAP201	12/23/05	
REVISIONS 3			
REVISIONS 4			
FIELD CHANGES			

CITY OF PORTLAND
OCEAN GATEWAY PHASE 1
RECEIVING STATION UTILITY PLAN

C219