


Note
 The heating hot water and chilled water systems shall be filled with a 40% propylene glycol (Dowfrost) and water solution. The propylene glycol shall contain long-life corrosion inhibitors.

TERMINAL BUILDING UPPER LEVEL PLAN
 SCALE 1/8" = 1'-0"



7 Pleasant Street
 Portland, Maine 04102
 Tel: (207) 865-9475
 office@bennettageng.com

STATE OF MAINE
 DEPARTMENT OF TRANSPORTATION
 PROJECT NUMBER 009215.00
 PIN
 009215.00

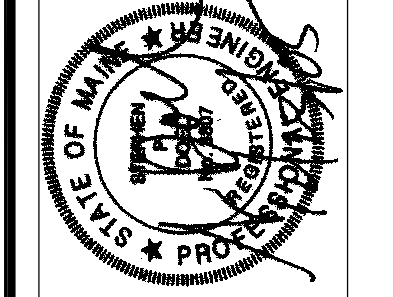

PROJ. MANAGER	DATE	BY	DATE
PAUL POTTLE	10/05/04	SP DOEL	10/05/04
DESIGN-DETAILED		SMR	
CHECKED-REVIEWED		SP DOEL	10/05/04
DESIGN2-DETAILED2			
DESIGN3-DETAILED3		VAAP	12/23/05
REVISIONS 1			
REVISIONS 2			
REVISIONS 3			
REVISIONS 4			
FIELD CHANGES			

CITY OF PORTLAND
 OCEAN GATEWAY PHASE 1
 TERMINAL BUILDING
 UPPER LEVEL HVAC PLAN

H101-T
 255 OF 288