

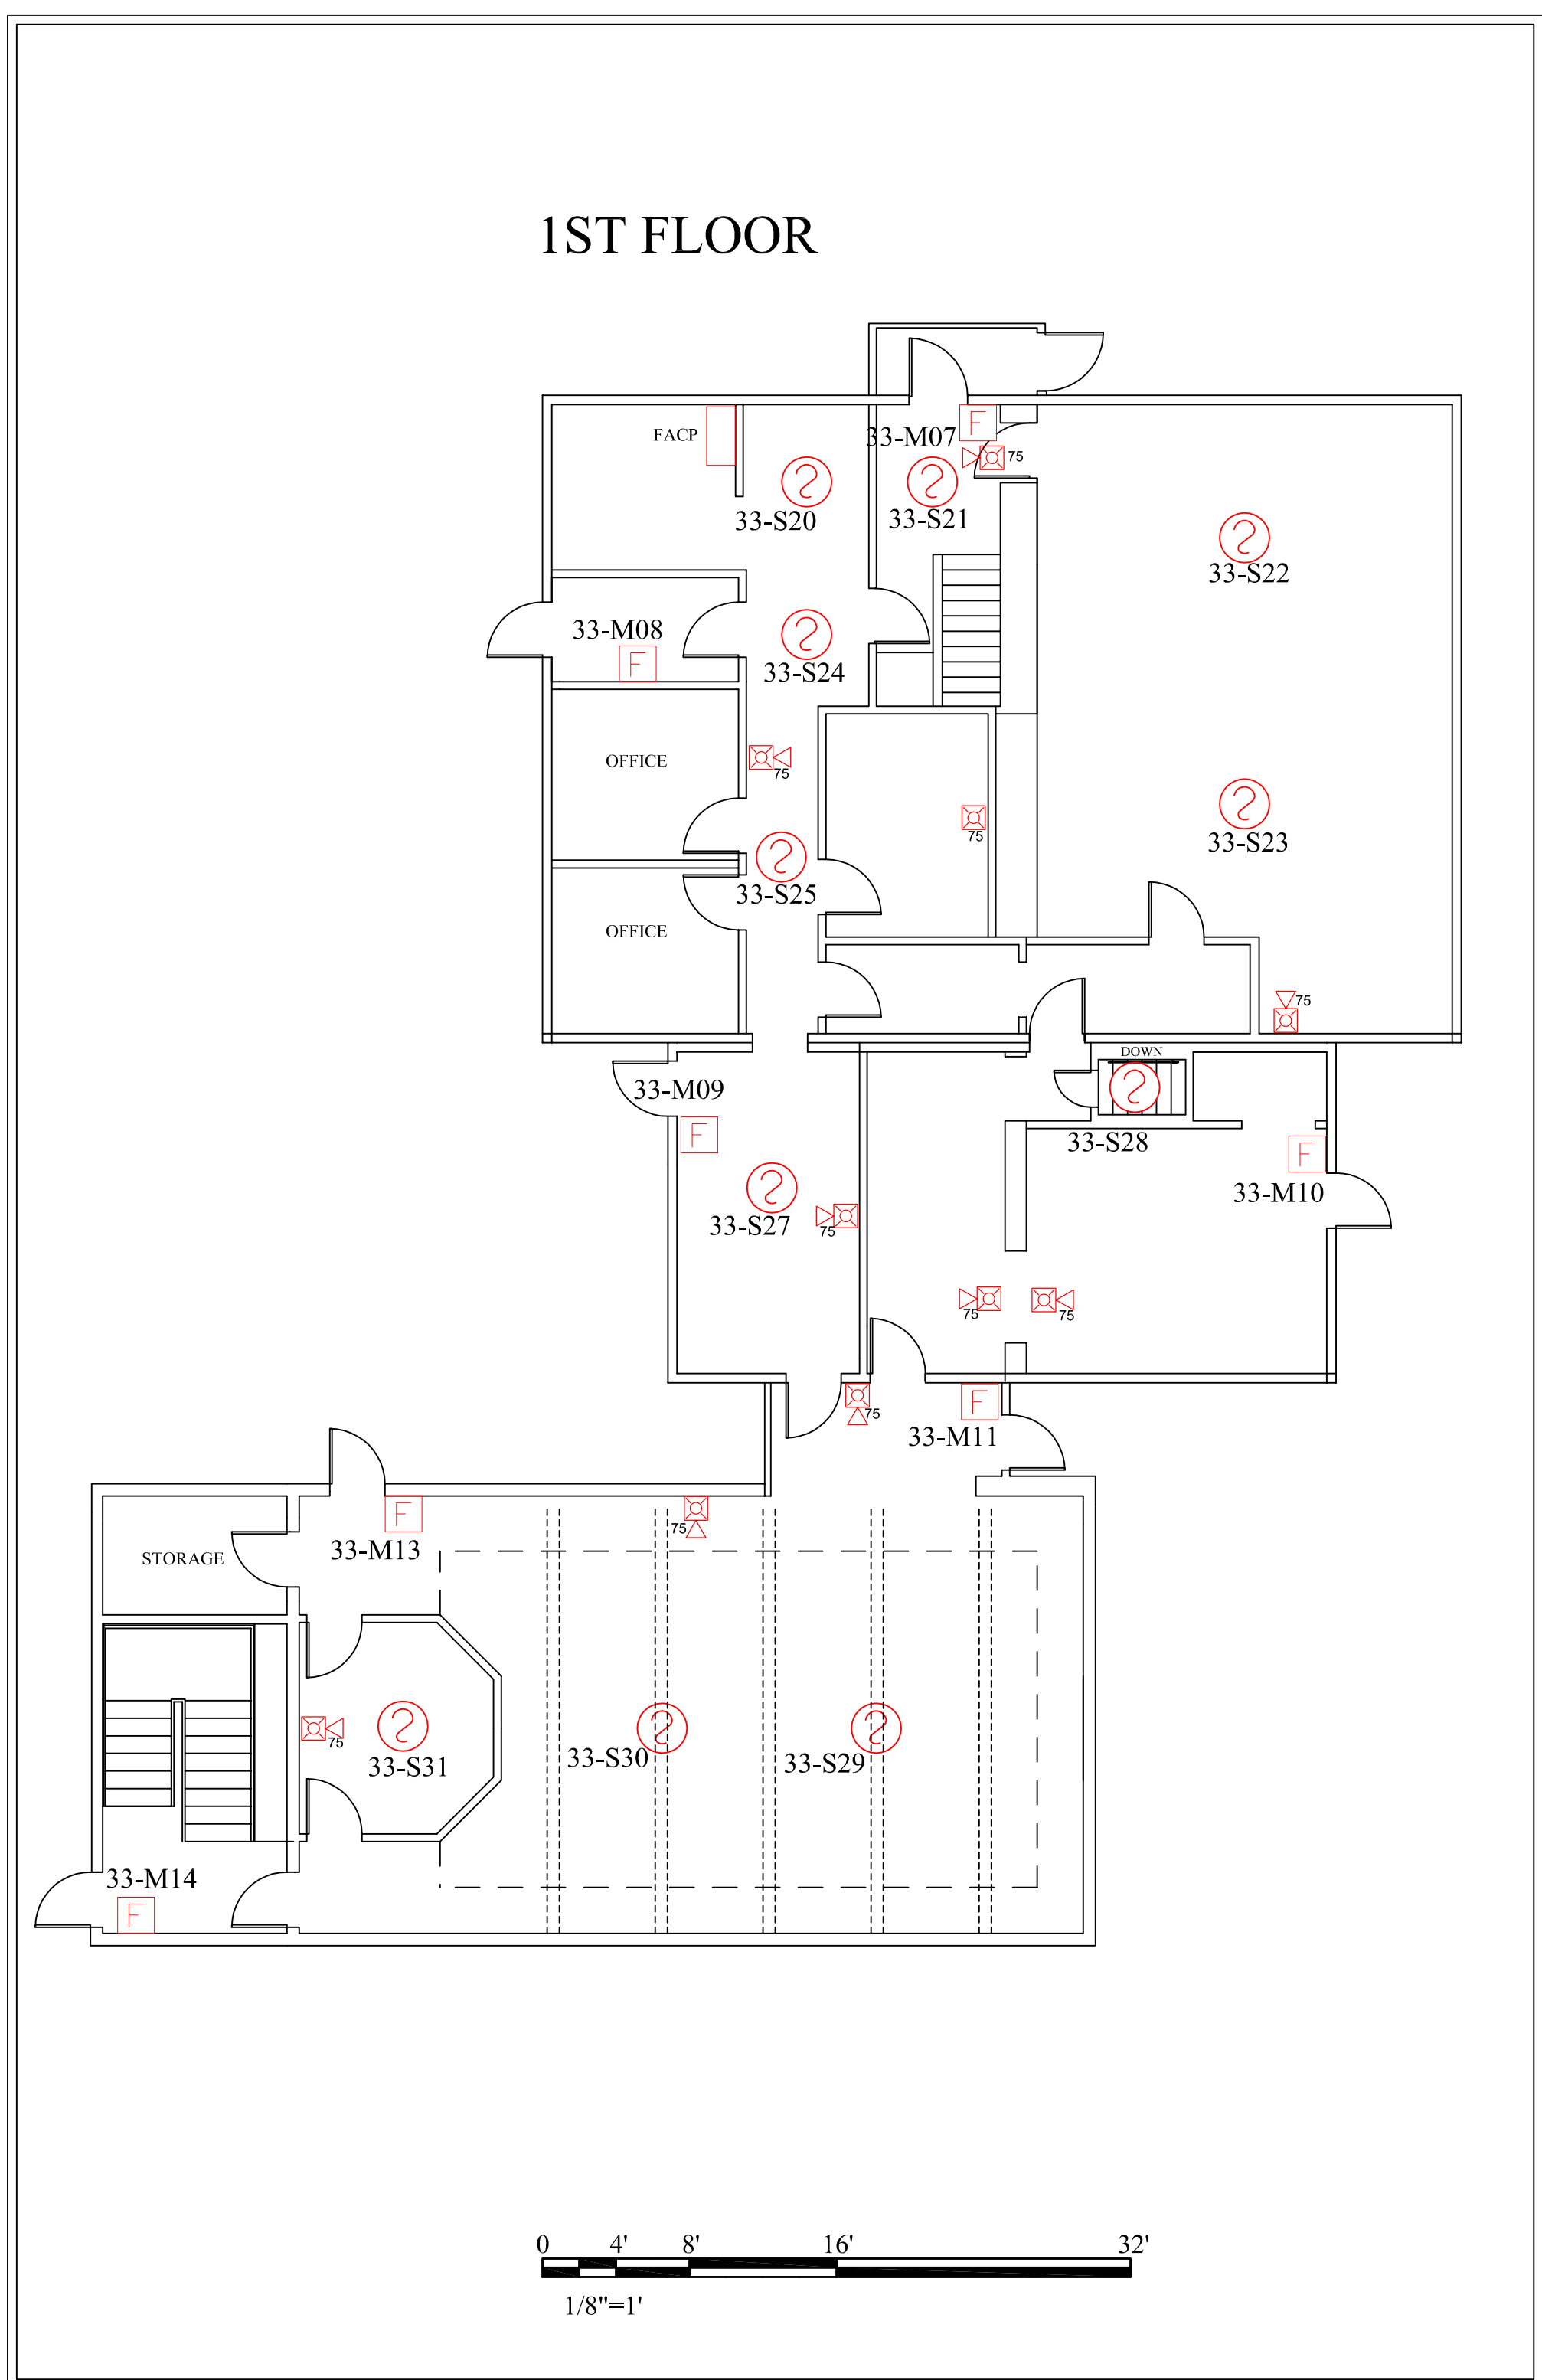
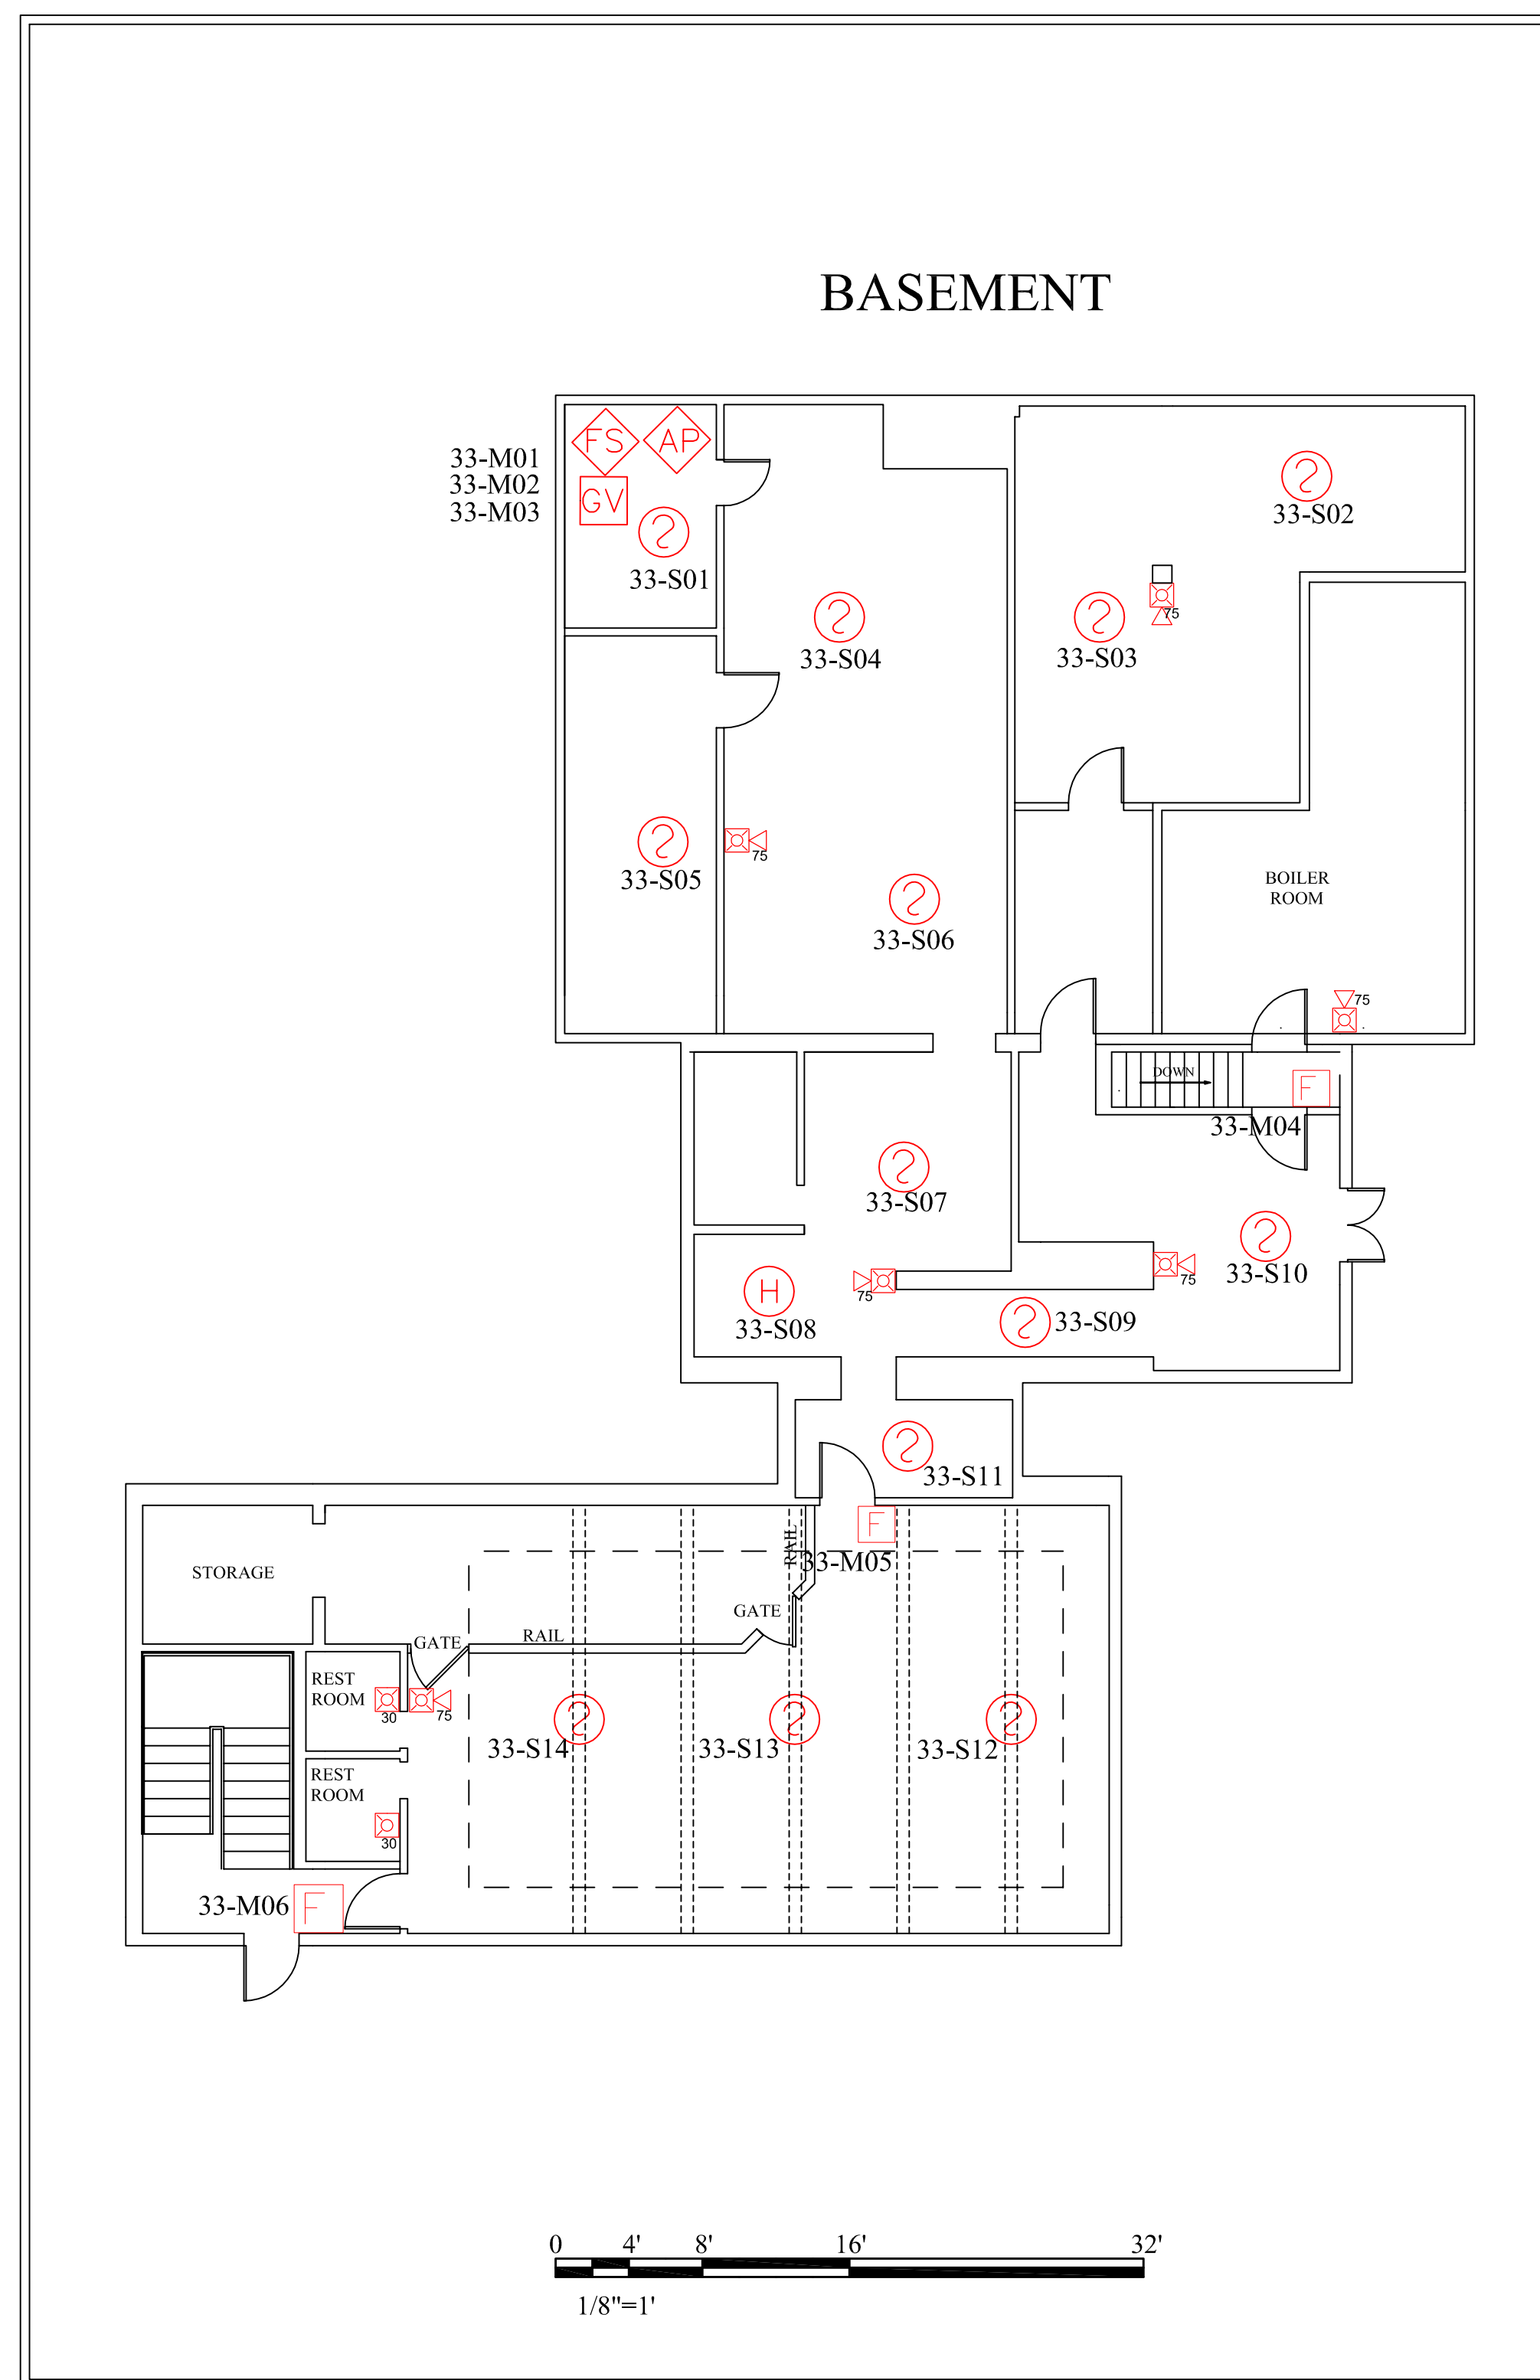


- LEGEND**
- SK-MONITOR MODULE (POINT NUMBER)
 - SK-PHOTO-T SMOKE DETECTOR (POINT NUMBER)
 - SK-PULL (POINT NUMBER)
 - SK-HEAT (POINT NUMBER)
 - GATE VALVE TAMPER (POINT NUMBER)
 - WATER FLOW (POINT NUMBER)
 - AIR PRESSURE (POINT NUMBER)
 - HORN/STROBE (CANDLE RATING)
 - STROBE (CANDLE RATING)

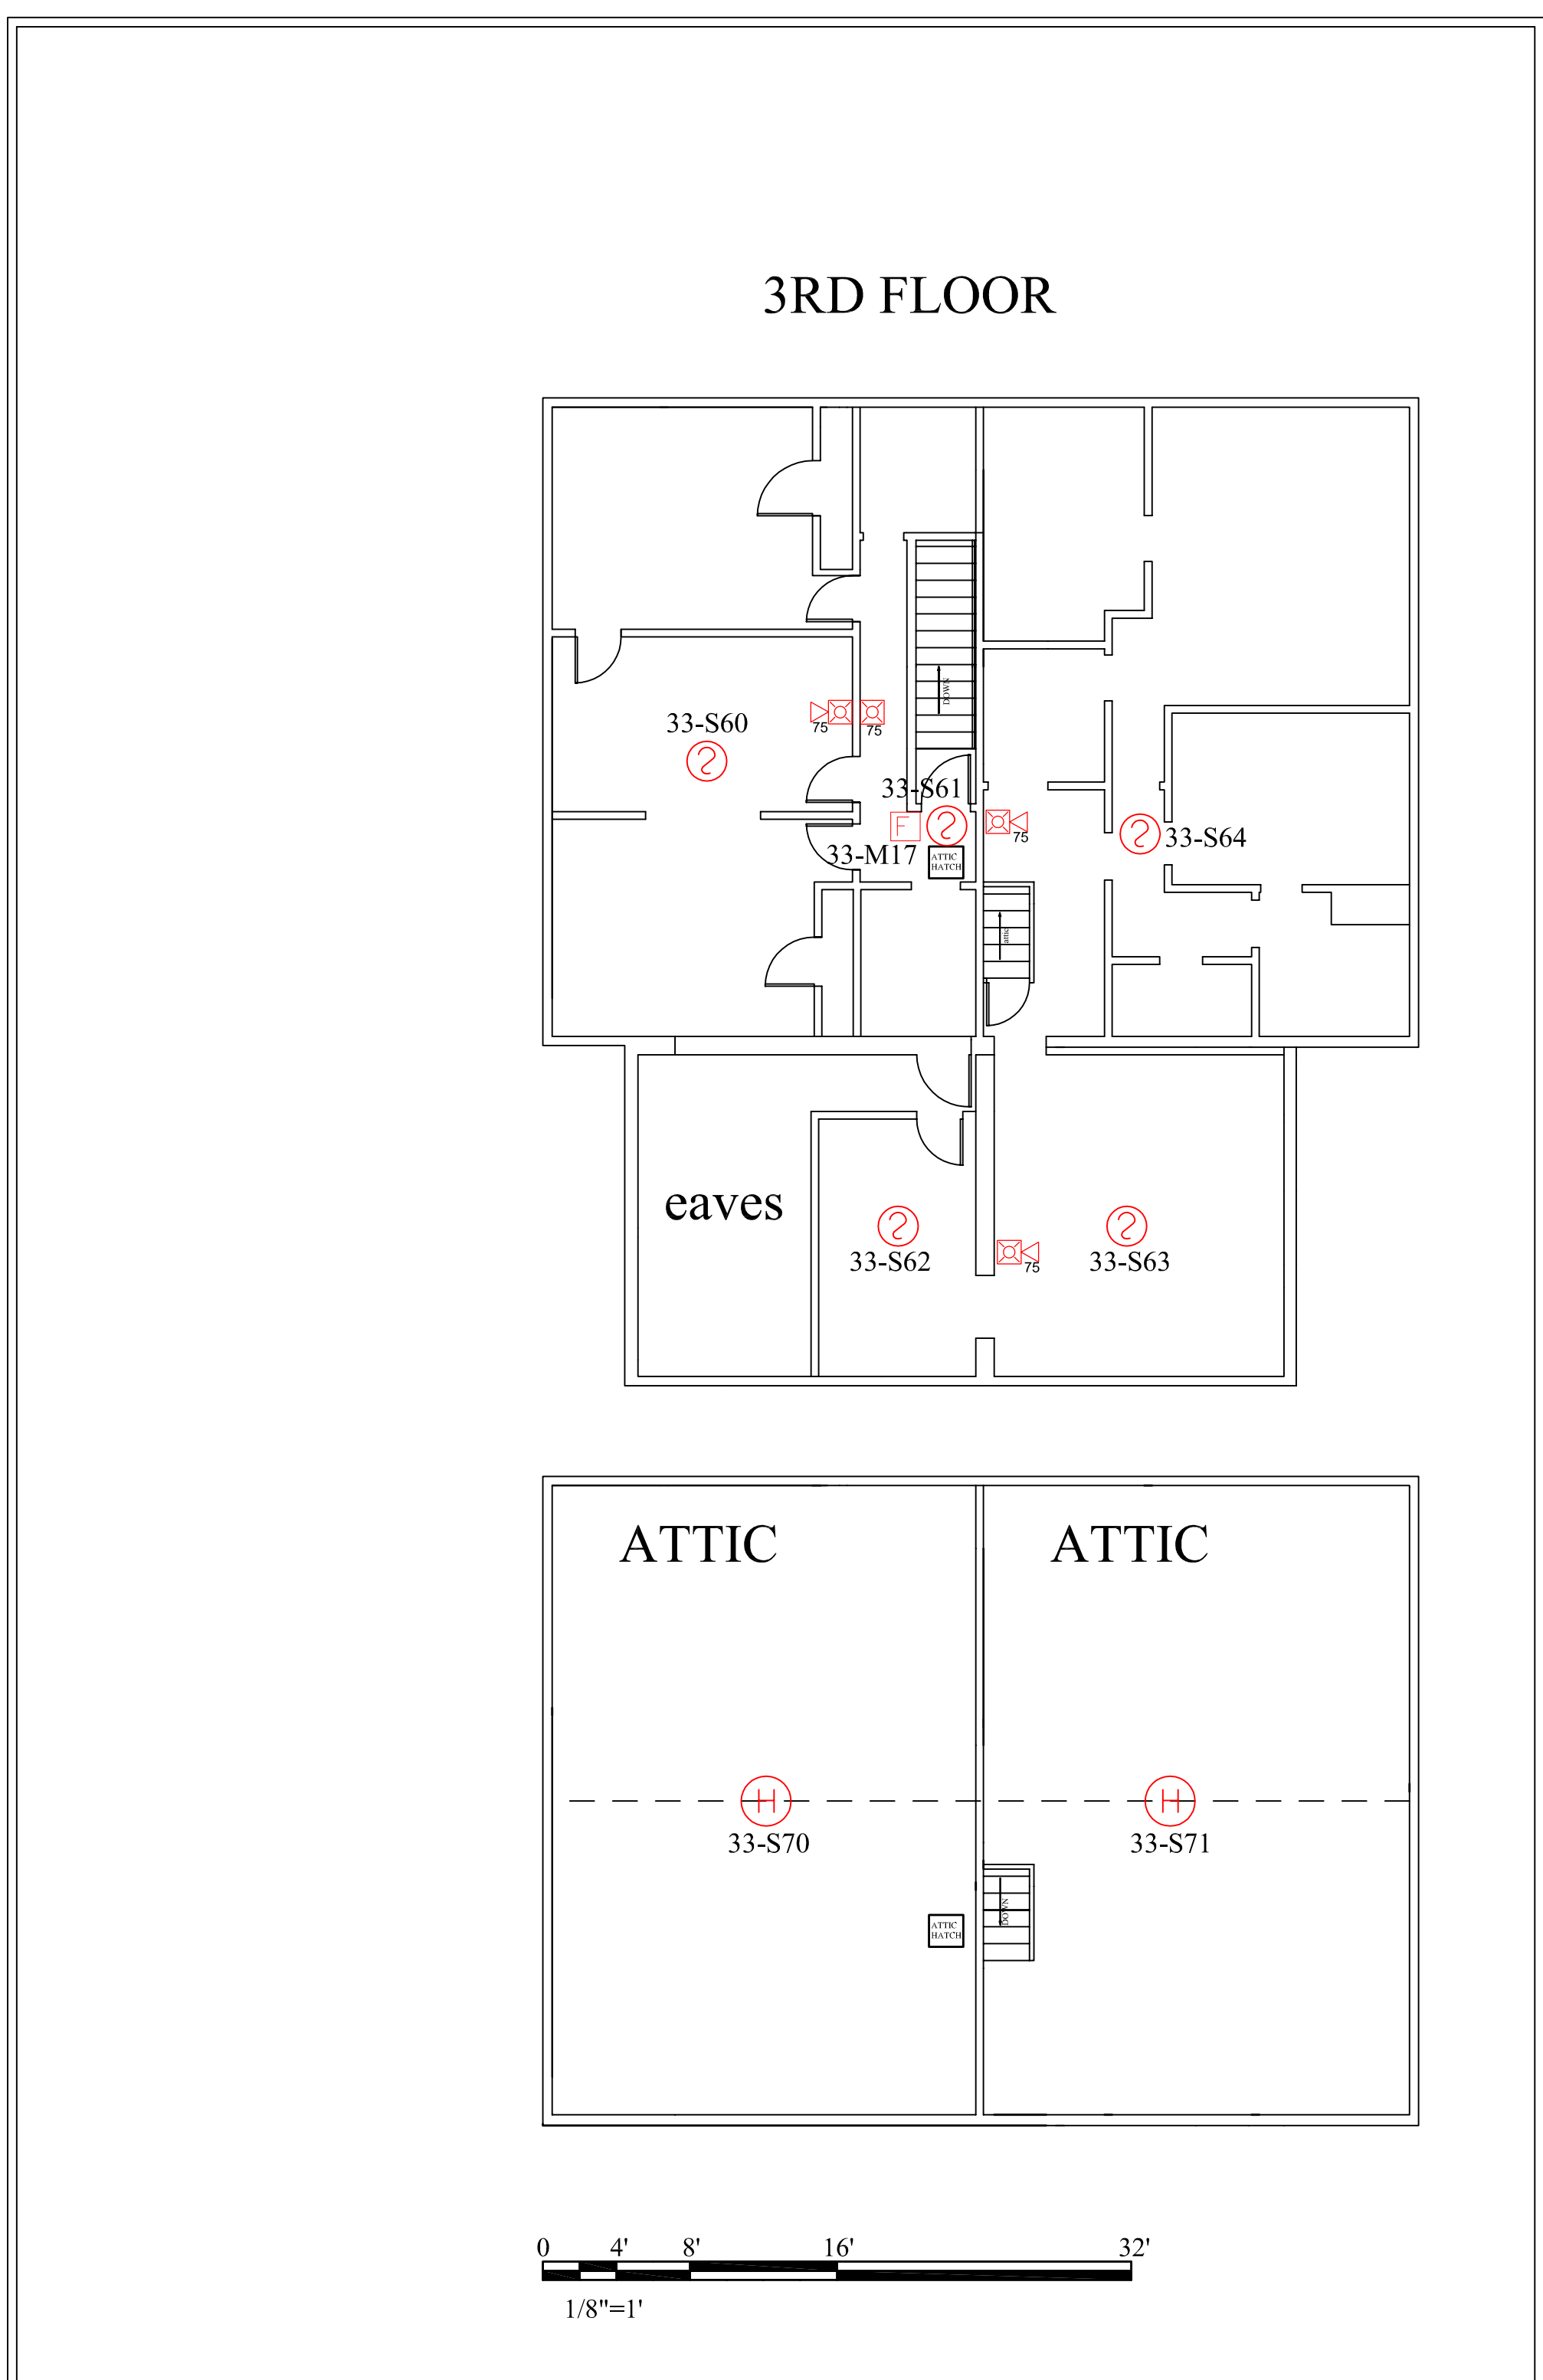

Note: All Alarm Initiating Devices to Sound All Notification Appliances and Activate City Box

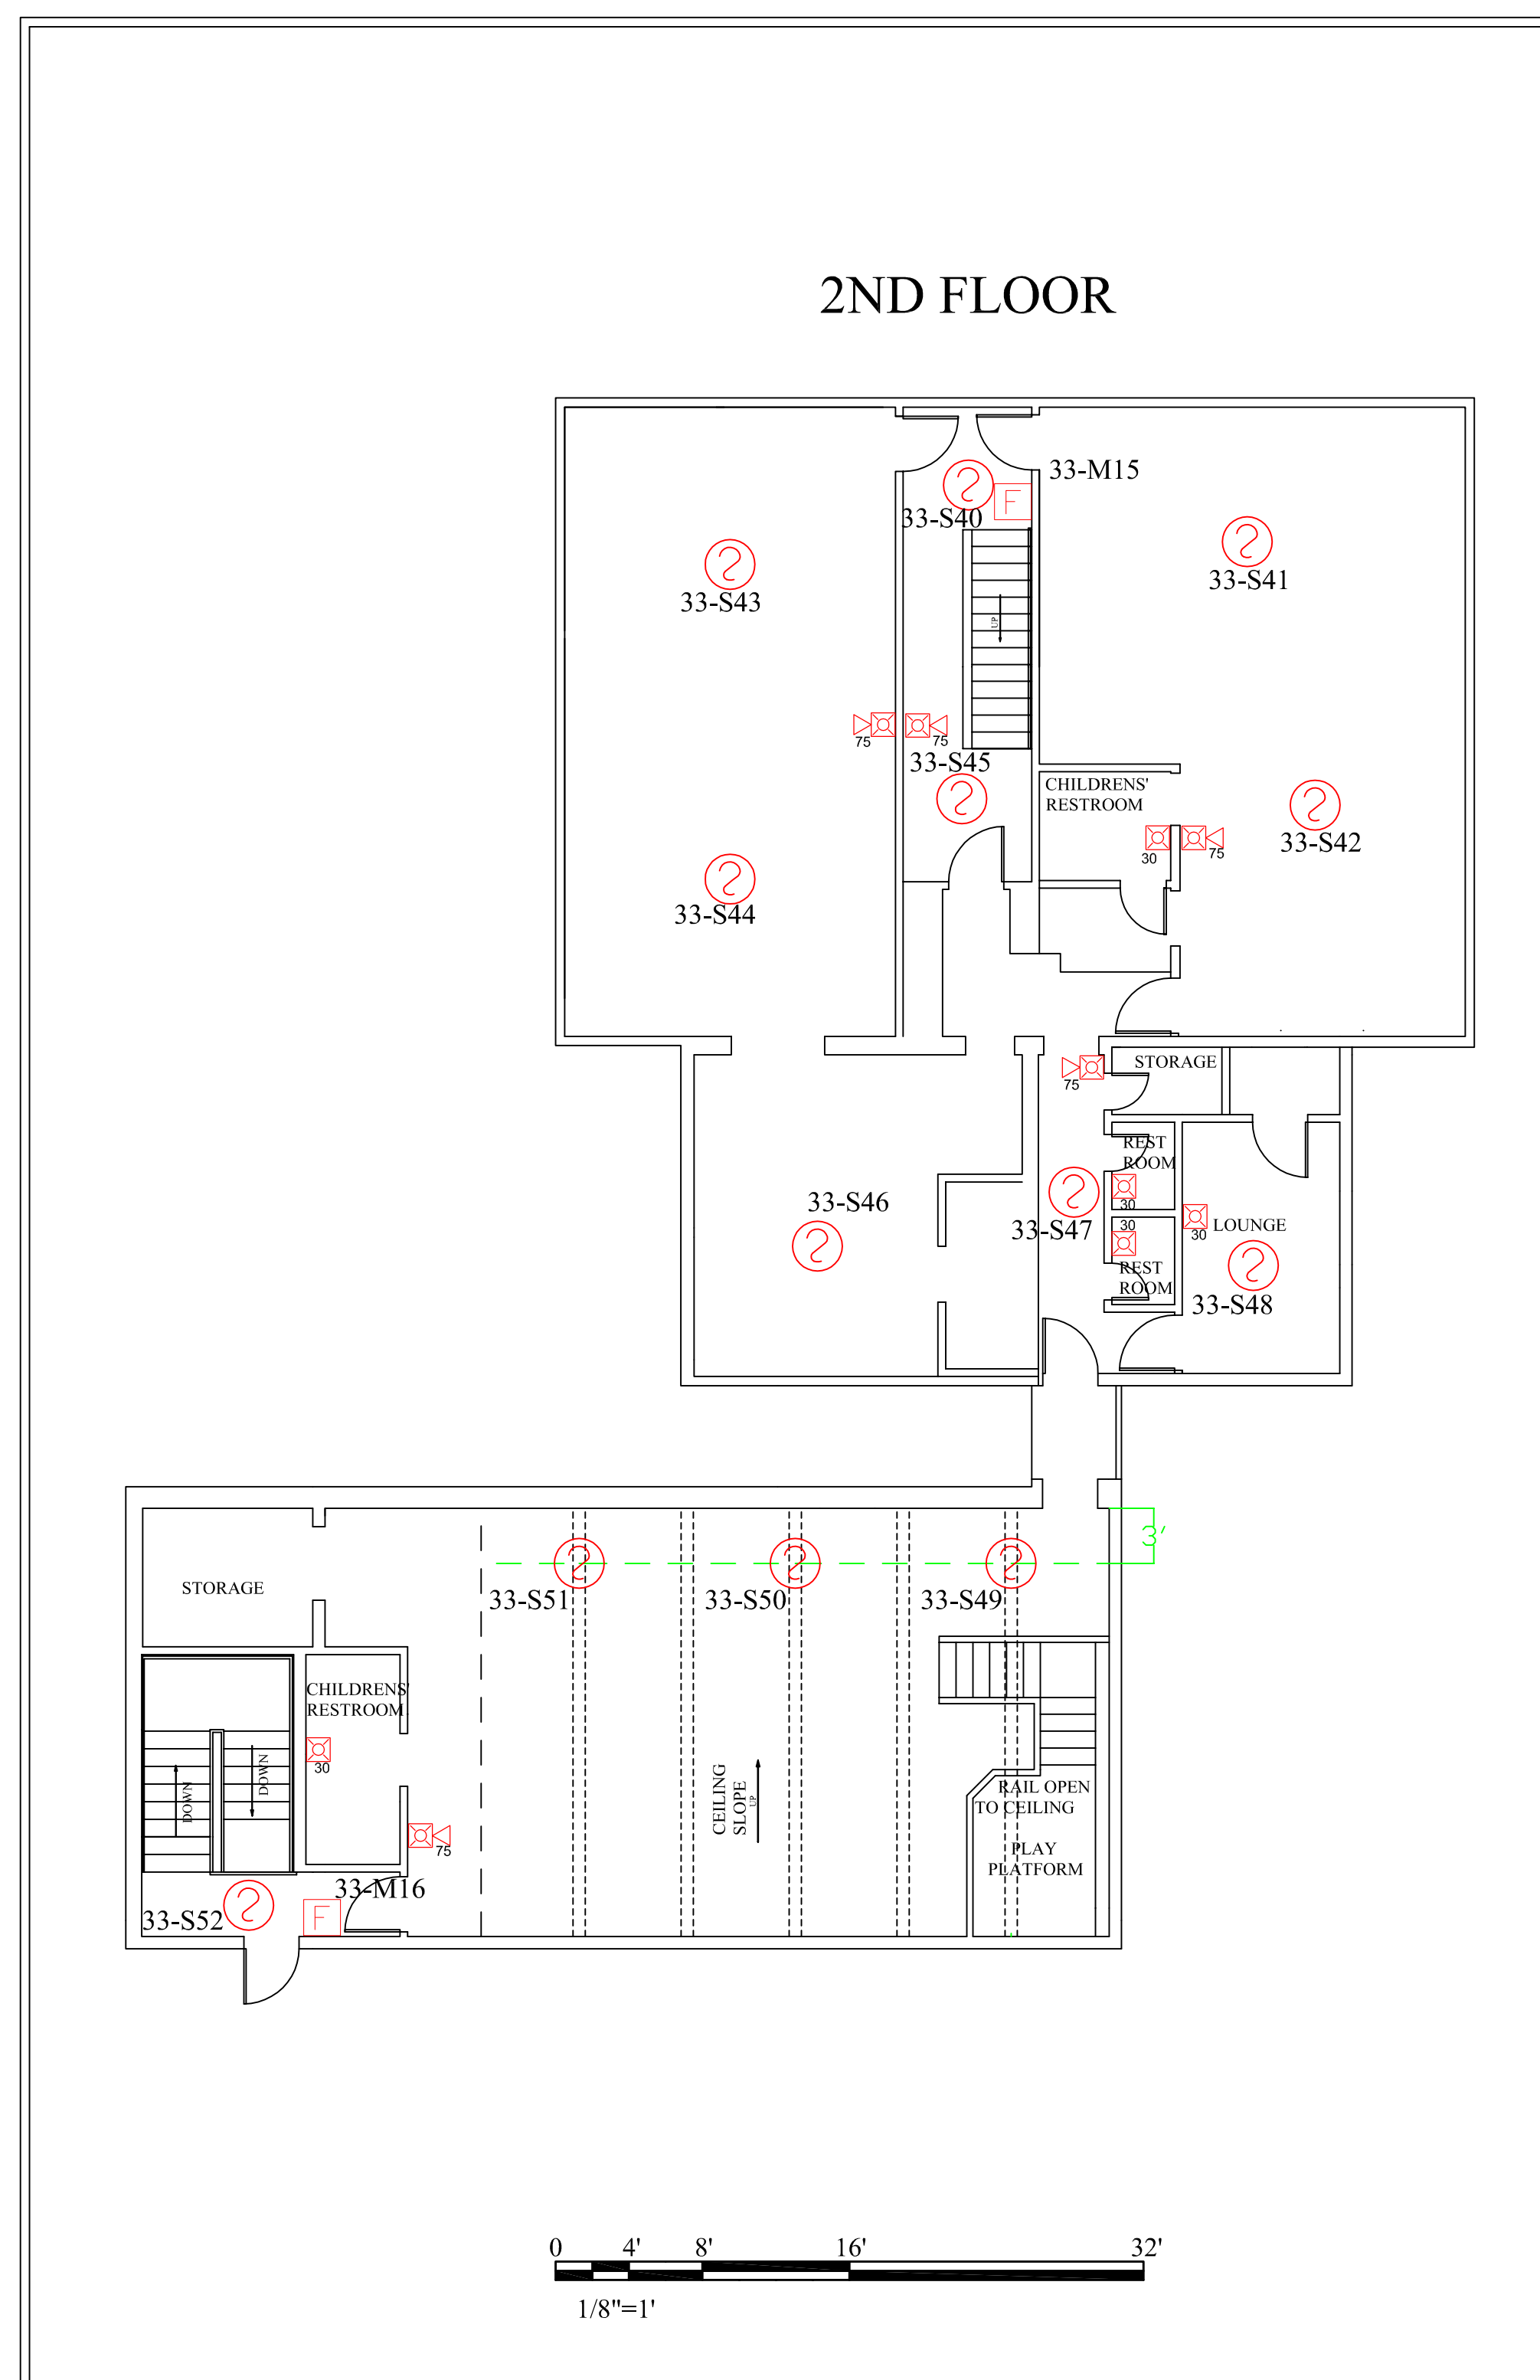

Note: No prints were available, drawing based on measurements taken on site and are reasonably close +/- Approx. 4 inches in floor spaces.

FA-1

PROJECT TITLE
CATHERINE MORRILL DAYCARE
DANFORTH ST
PORTLAND MAINE

NO	REVISIONS	DATE	BY
0	ISSUED FOR REVIEW	06-21-16	SECURADYNE

securadyn systems

600 Research Drive
Portland, ME 04107
Tel: 855-888-3444
Fax: 207-828-0022

John Kimball, NICET Certified Senior Engineering Technician
Certification # 107989