




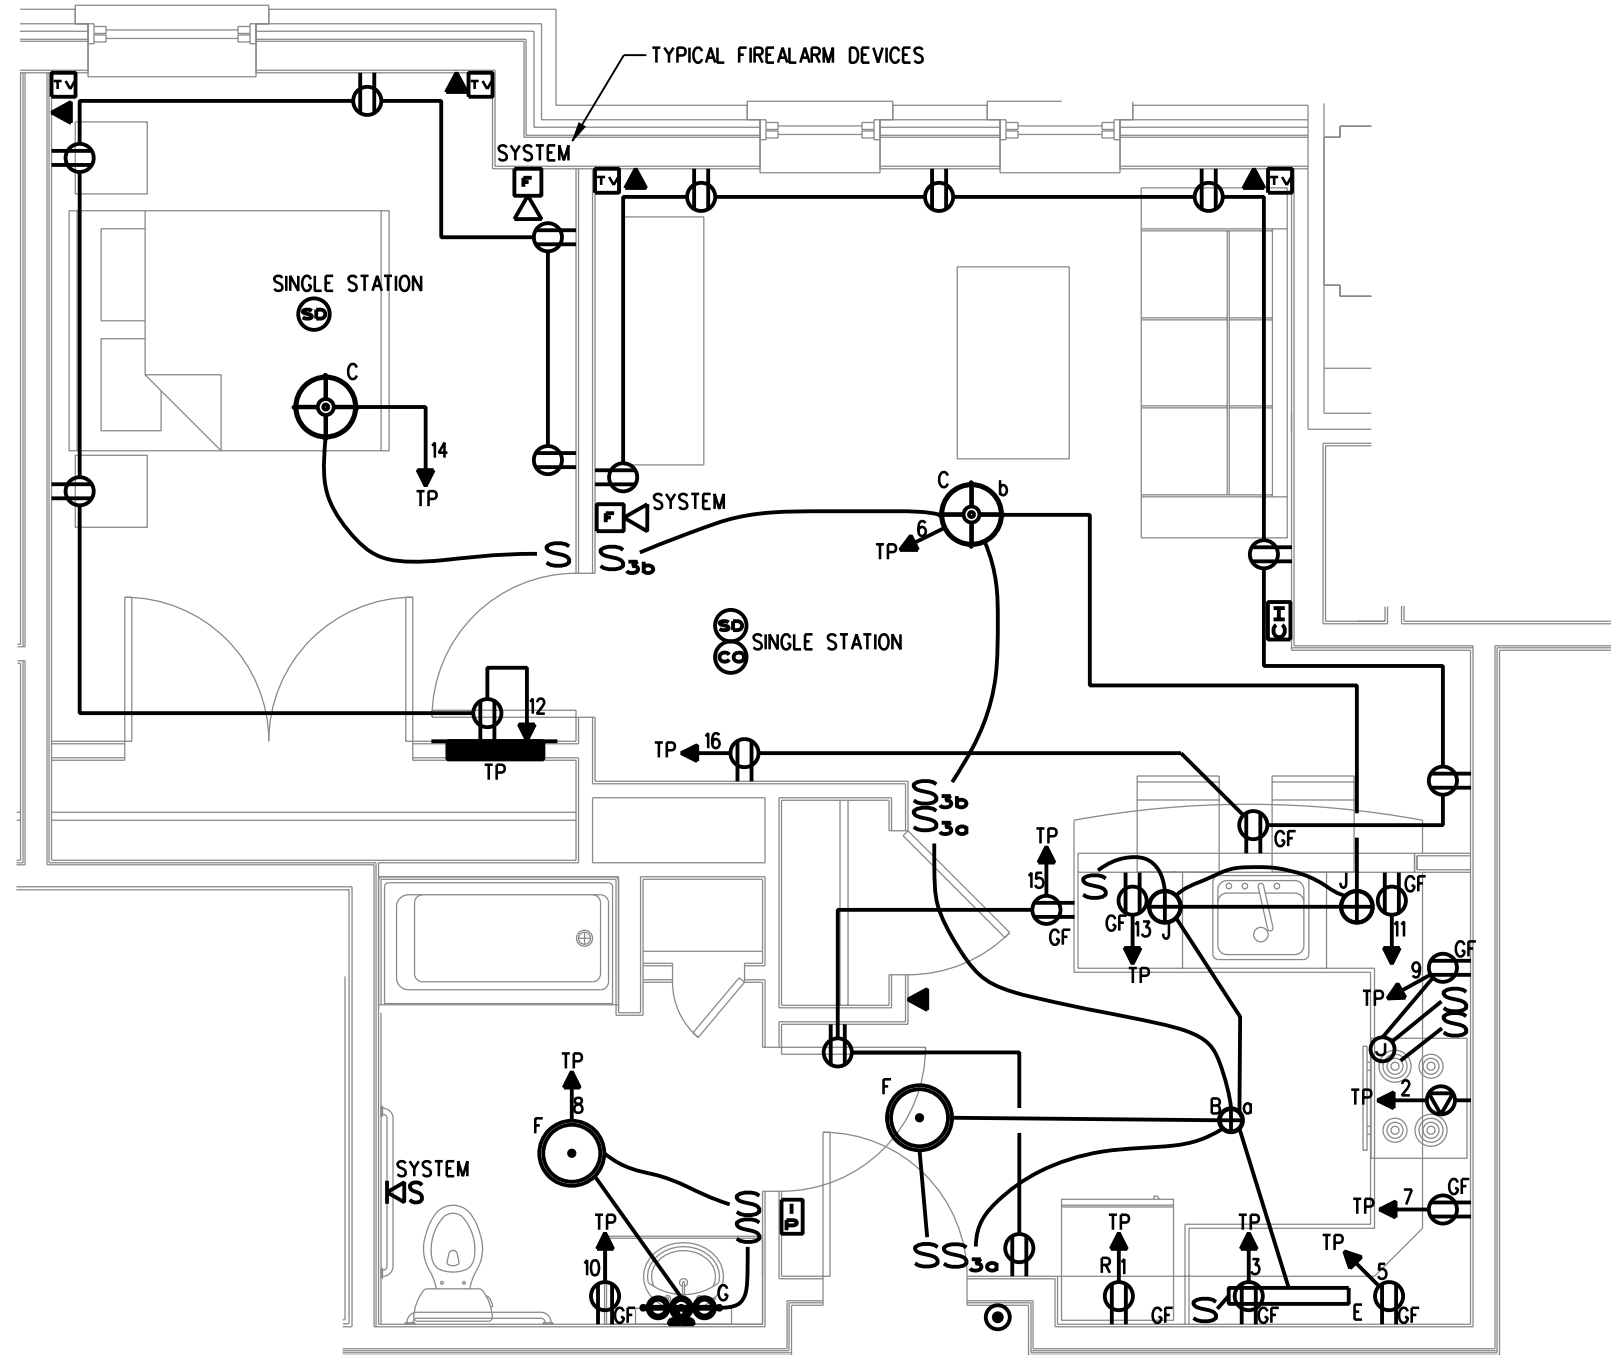

UNIT 104 1A-HC-1
SCALE: 1/4"=1'-0"
UNITS 204 AND 304 SIMILAR

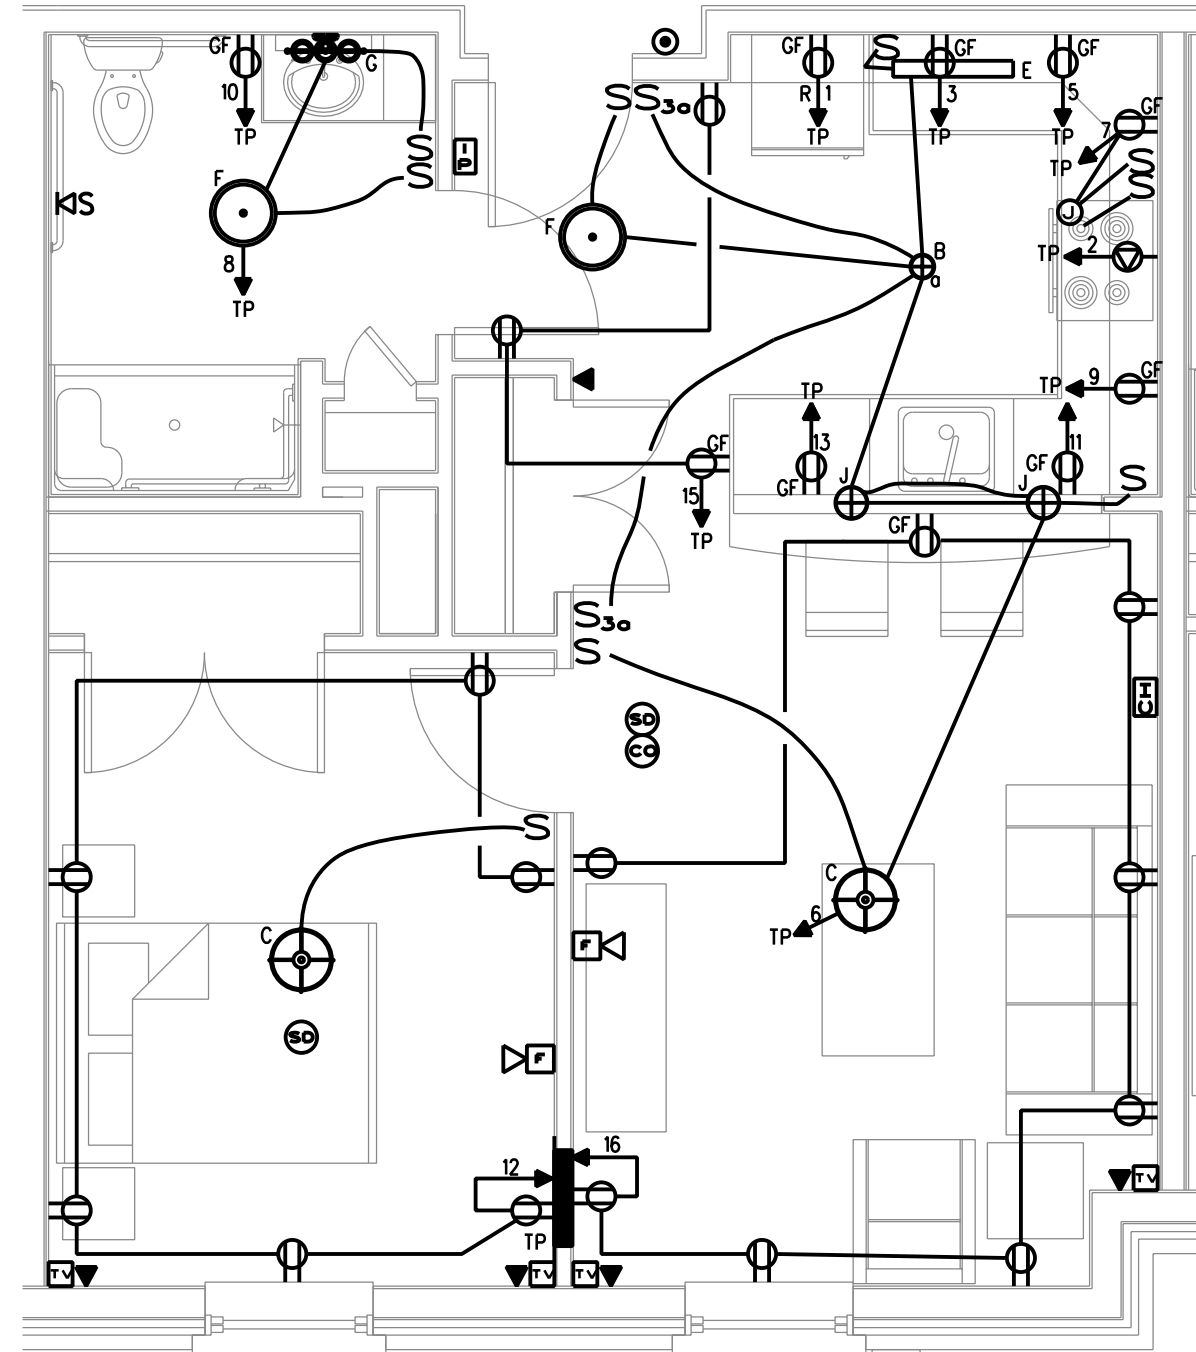


UNIT 103 1A-1
SCALE: 1/4"=1'-0"
UNITS 203 AND 303 SIMILAR

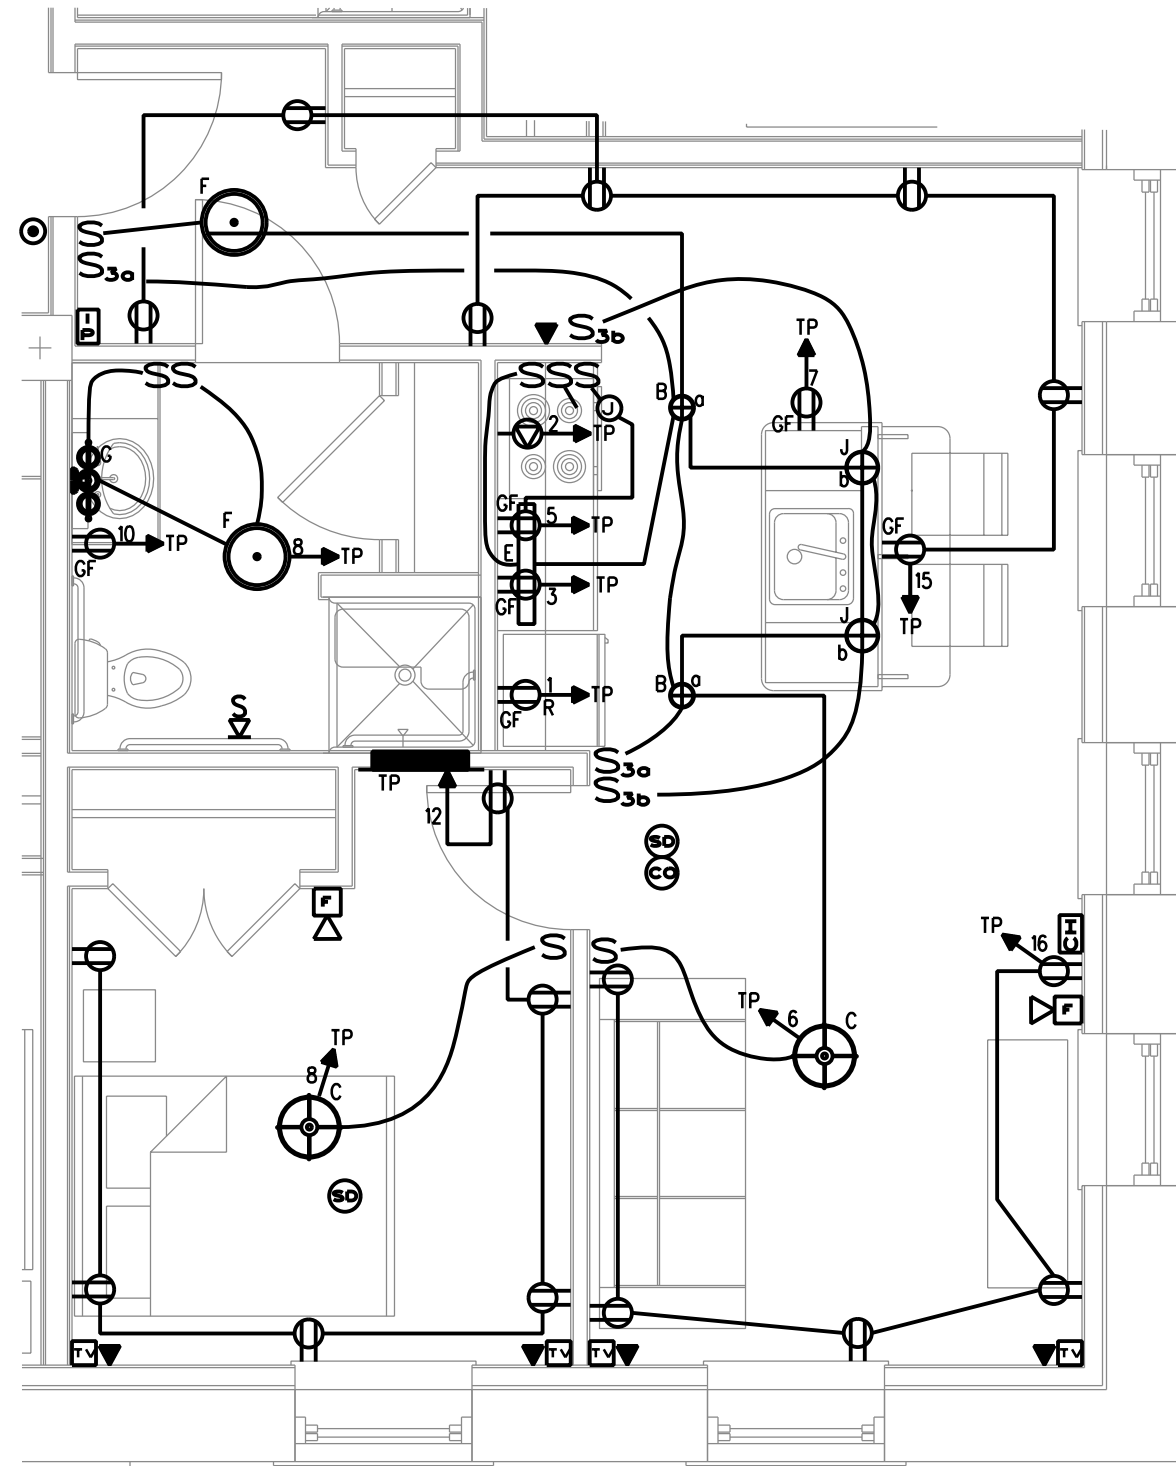


UNIT 211 1A-2
SCALE: 1/4"=1'-0"

ELECTRICAL DEMOLITION NOTES:


UNLESS NOTED OTHERWISE ON THE ELECTRICAL DRAWINGS, ALL ELECTRICAL SYSTEMS (INTERIOR AND EXTERIOR), INCLUDING BUT NOT LIMITED TO PANELS, DEVICES, CONDUIT, WIRING, FIRE ALARM CABLE, SECURITY CABLE, TELEPHONE CABLE, CATV CABLE, DATA CABLE, AND LIGHTING SHALL BE REMOVED IN THEIR ENTIRETY. EXCEPTIONS - EXISTING 480V, 3PH SERVICE, METERING EQUIPMENT, MAIN SERVICE PANEL IN BASEMENT ELECTRICAL ROOM SHALL REMAIN. EXISTING NOTIFIER AFP-200 ADDRESSABLE FIRE ALARM PANEL SHALL BE RELOCATED AND SALVAGED. EXISTING ELEVATOR MOTOR FEEDER SHALL BE RETAINED.

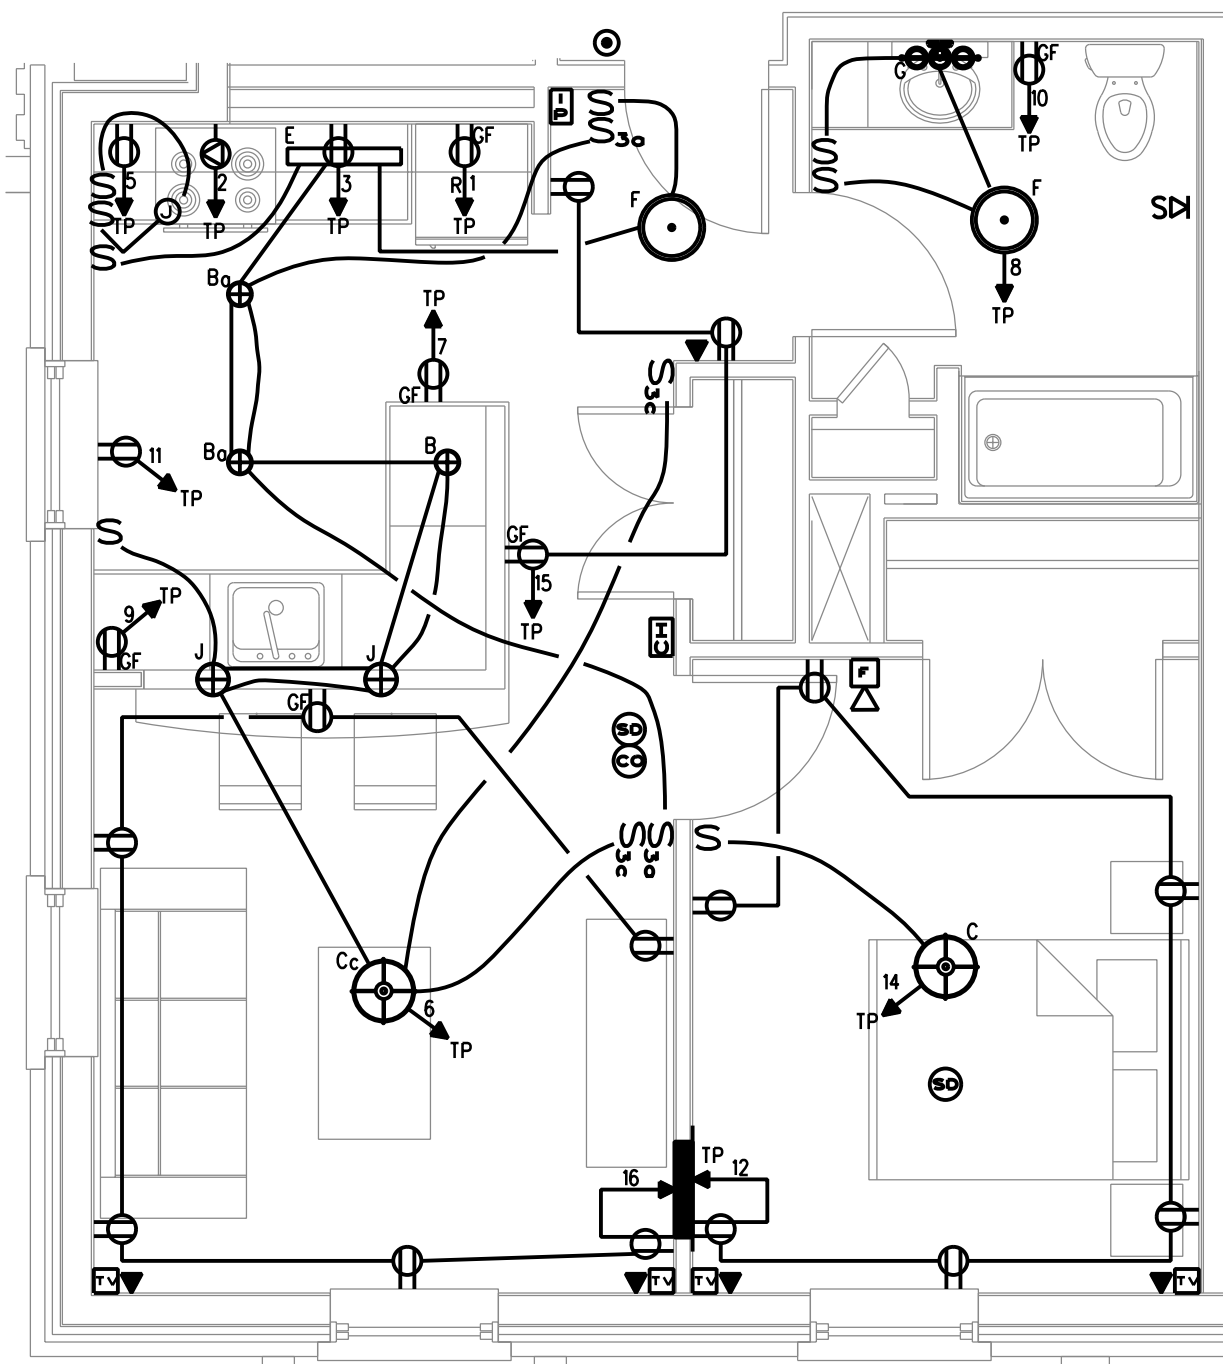

UNIT 101 1B-1
SCALE: 1/4"=1'-0"

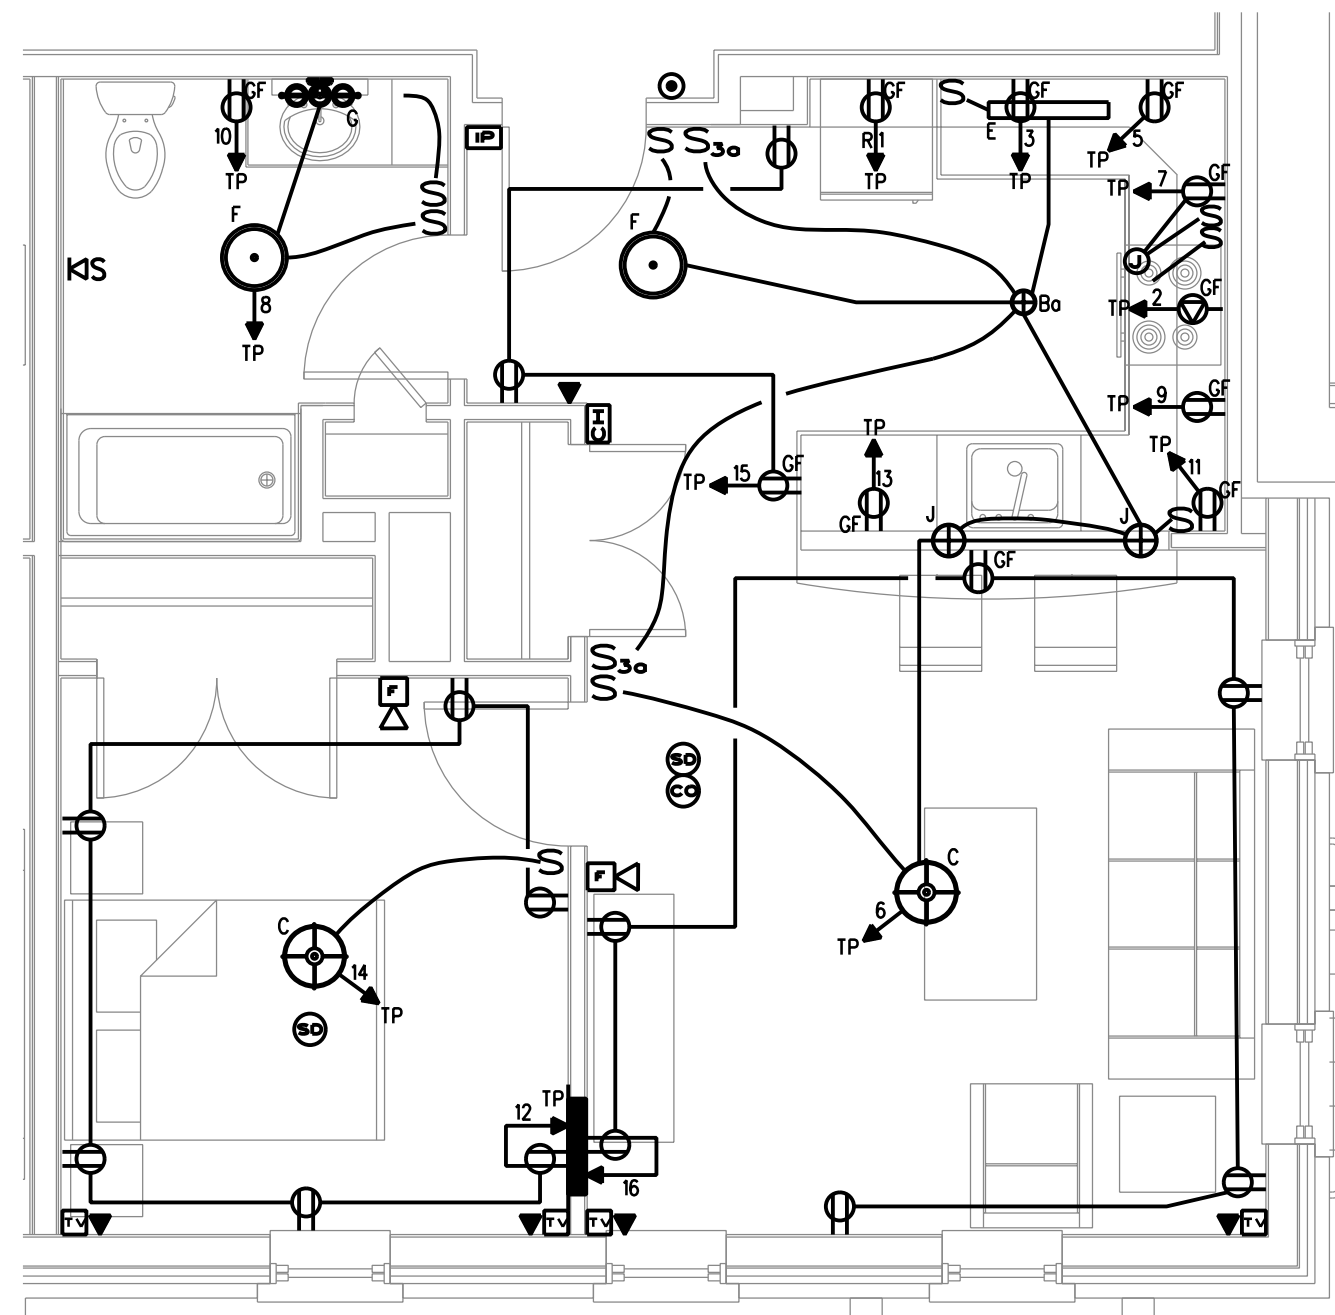

UNIT 105 1B-2
SCALE: 1/4"=1'-0"
UNITS 205 AND 305 SIMILAR

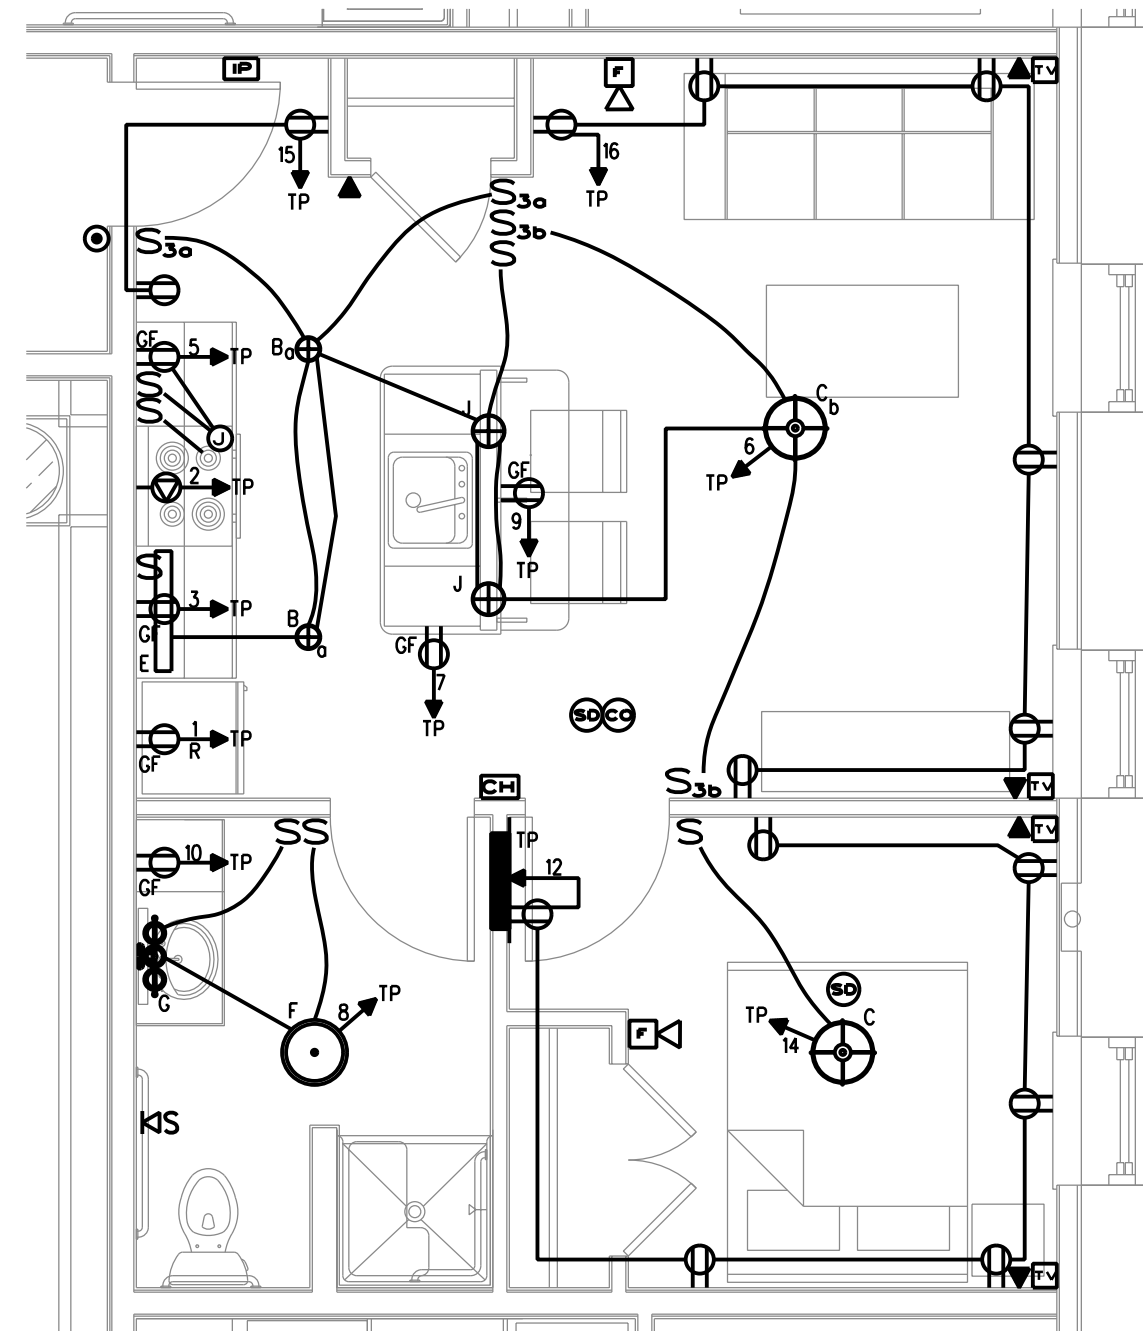

UNIT 110 1B-3
SCALE: 1/4"=1'-0"

NOTE:

REFER TO DRAWING E4.1 FOR UNIT NOTES