




NOTE - DETAIL APPLIES TO ERV HEATING COILS.

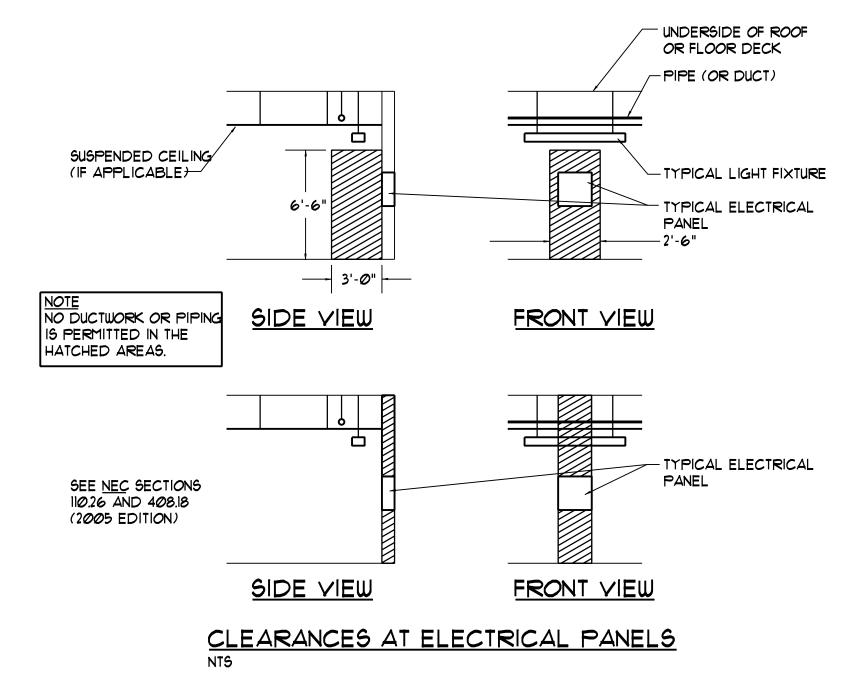

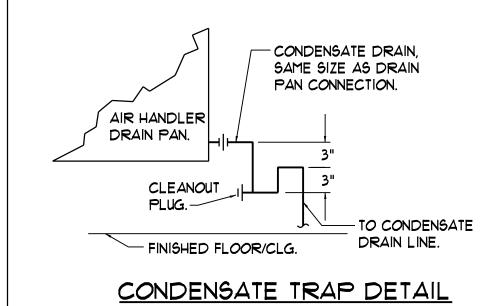

NOTE - CAP UNUSED DRAIN PAN CONNECTIONS.



|CWS Architects|

│ □ Architecture

Space Planning

🔲 434 Cumberland Avenue

Value Design

Portland, ME 0410

Fax: (207)774-4016

www.CWSarch.com

Phone: (207)774-444



BENNETT **ENGINEERING** MECHANICAL • ELECTRICAL (207) 865-9475

□ □wner:

Children's Hospital Housing Partners, LP 309 Cumberland Ave Suite 200

☐ CONSTRUCTION MANAGER:

WRIGHT-RYAN CONSTRUCTION

10 DANFORTH STREET PORTLAND, ME 04101 TEL: (207) 773-3625

Portland, Maine 04101

TERRACE

68 HIGH STREET PORTLAND, MAINE


Project No:


Drawing Title: MECHANICAL **DETAILS**

AS NOTE Scale: September 8, 201

Date: Revisions:

Drawing Number:

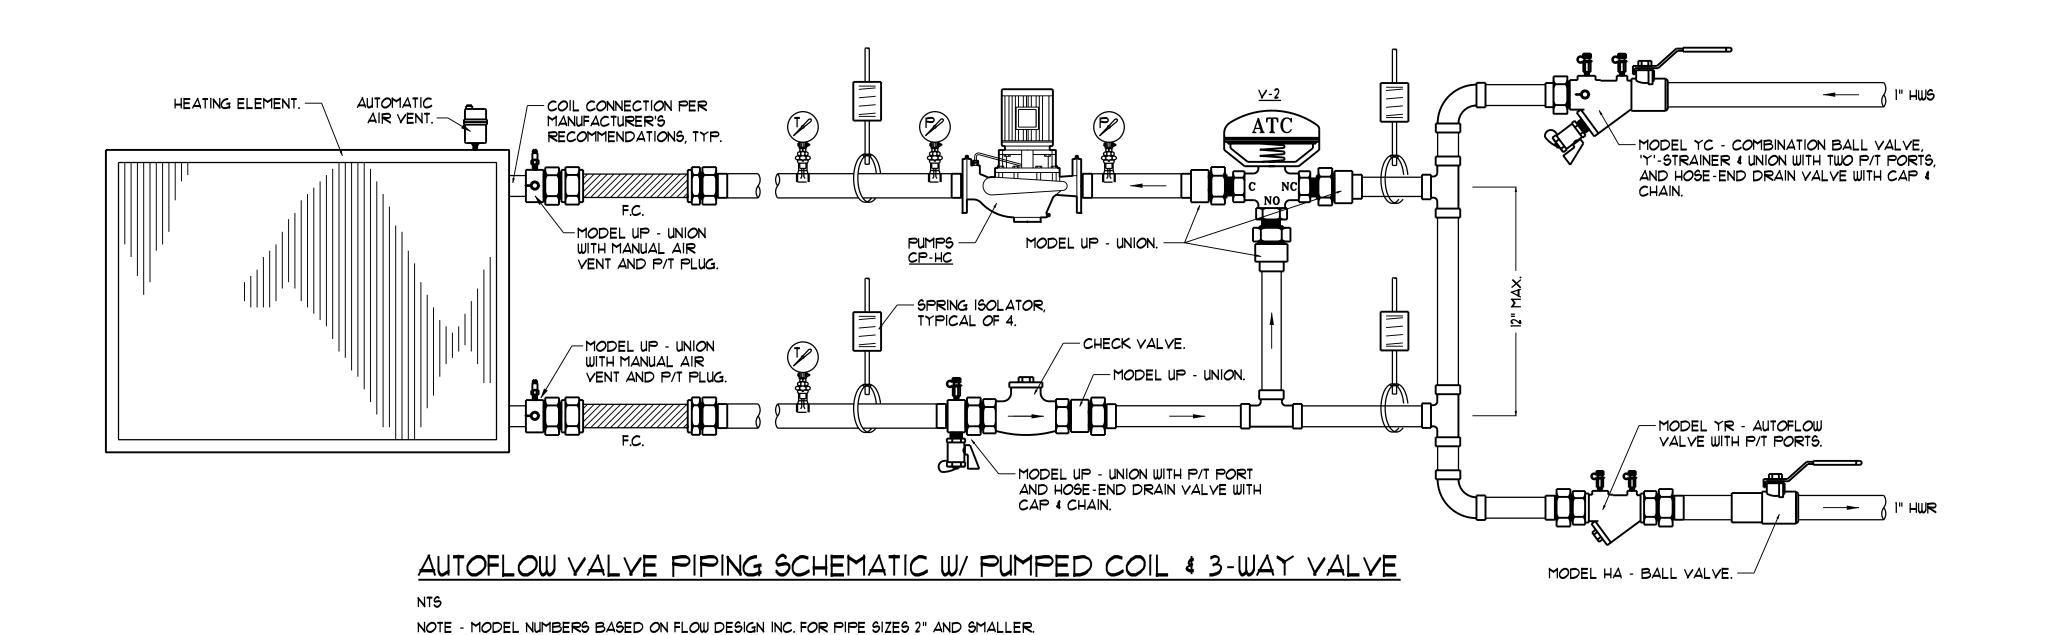

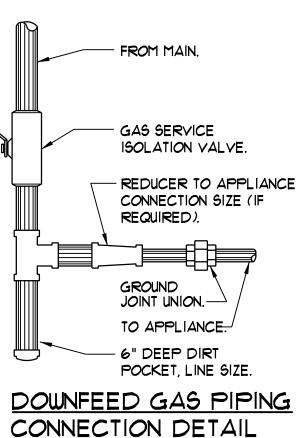

CONNECTION DETAIL

NOTE APPLIANCES WITH REGULATORS LOCATE PIPING SHOWN HEREIN UPSTREAM OF THE APPLIANCE REGULATOR. PROVIDE A TEST PLUG DOWNSTREAM OF THE APPLIANCE REGULATOR.

- TO APPLIANCE GAS TRAIN. - GROUND JOINT UNION. - REDUCER TO APPLIANCE CONNECTION SIZE (IF REQUIRED). -GAS SERVICE ISOLATION VALVE. FROM MAIN. --6" DEEP DIRT POCKET, LINE SIZE.

UPFEED GAS PIPING CONNECTION DETAIL

NTS

NOTE APPLIANCES WITH REGULATORS LOCATE PIPING SHOWN HEREIN UPSTREAM OF THE APPLIANCE REGULATOR. PROVIDE A TEST PLUG DOWNSTREAM OF THE APPLIANCE REGULATOR.