


SYMBOL LEGEND

- ⊗ EXIT LIGHT FIXTURE-UNSWITCHED
- ⊞ EMERGENCY BATTERY UNIT - WITH TWO HEADS
MOUNT AT 6'-8" AFF
- 15 ⊞ FIRE ALARM AUDIO/VISUAL, MOUNT 6'-8" AFF
NUMERALS DENOTE CANDELA RATING
- 15 SD ⊞ FIRE ALARM VISUAL STROBE ONLY
NUMERALS DENOTE CANDELA RATING
MOUNT 6'-8" AFF
- 15 SD ⊞ FIRE ALARM VISUAL STROBE ONLY
NON-SYSTEM CONNECTED
CONNECTED TO SINGLE STATION SMOKE DETECTORS
MOUNT 6'-8" AFF
- 120V ⊞ FIRE ALARM PULL STATION - MOUNT AT 48" AFF
- 135° 200° ⊞ SYSTEM CONNECTED FIXED TEMPERATURE HEAT DETECTOR
- ⊞ ⊞ SYSTEM CONNECTED SMOKE DETECTOR, PHOTOELECTRIC TYPE
- SS ⊞ SINGLE STATION SMOKE DETECTOR, PHOTOELECTRIC TYPE
W/ STROBE LIGHT & BATTERY BACKUP - NON-SYSTEM CONNECTED
SMOKE DETECTORS TO BE INTERCONNECTED WITHIN EACH APARTMENT
- ER ⊞ SMOKE DETECTOR, PHOTOELECTRIC TYPE- SYSTEM CONNECTED.
"ER" = ELEV. RECALL
- MH ⊞ SYSTEM CONNECTED MINIHORN

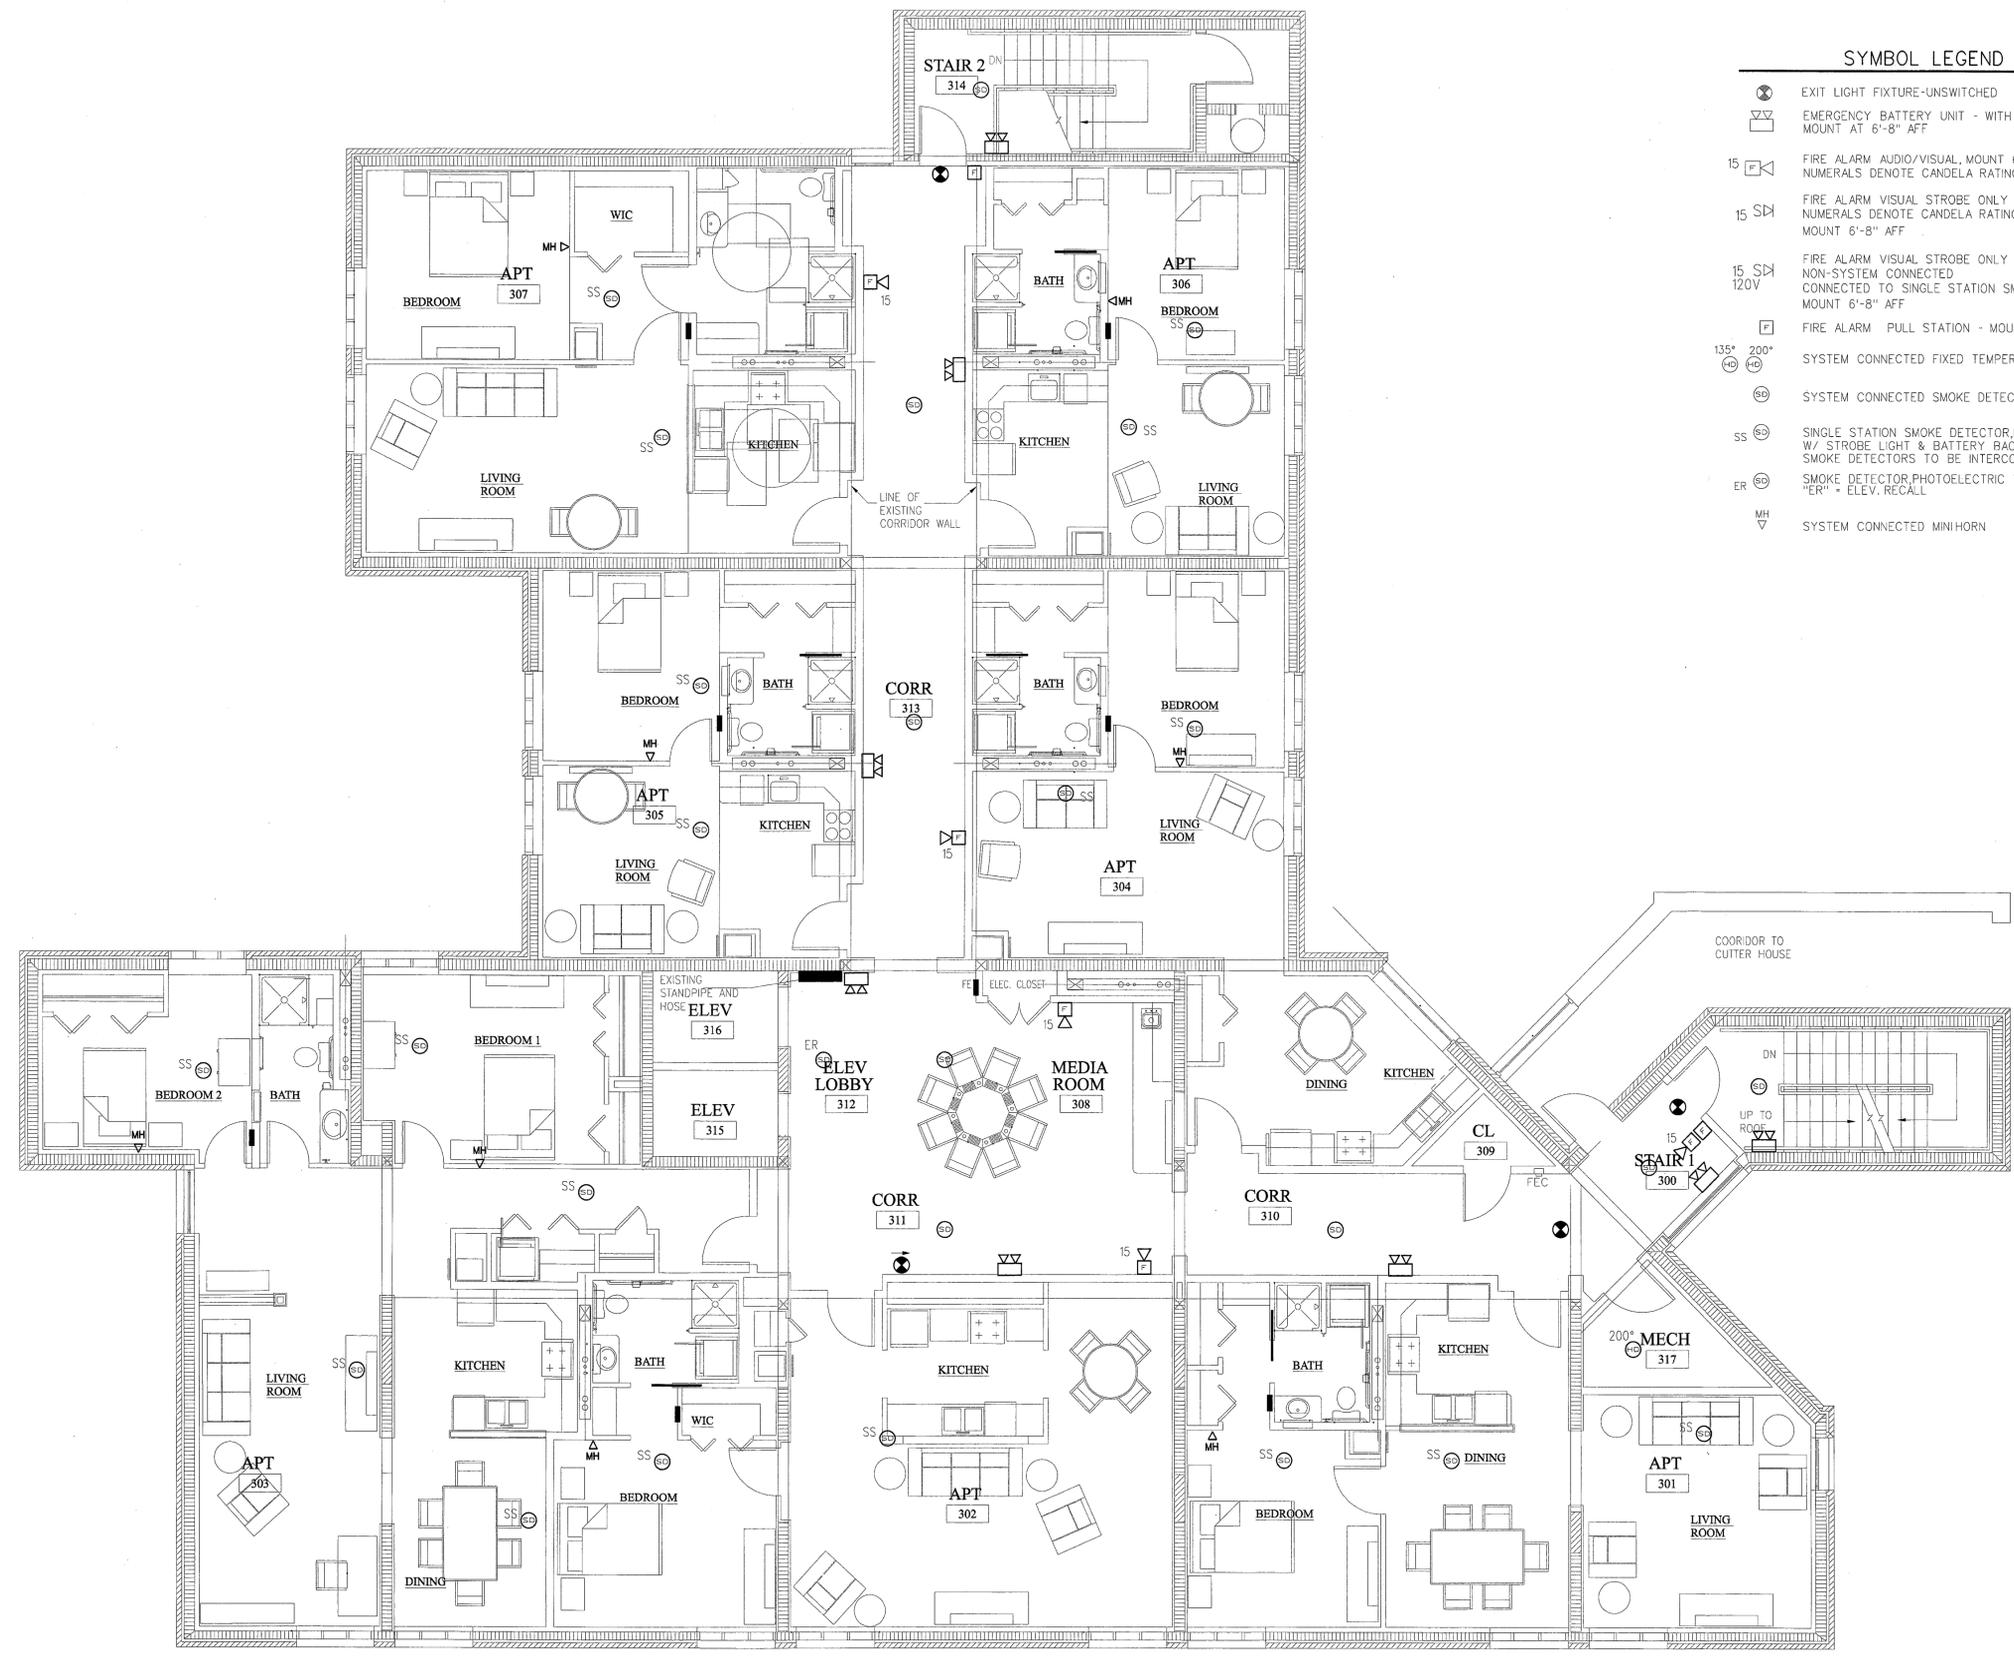

REVISIONS

#	DATE	DESCRIPTION

DATE:	07.09.08
PROJECT #	020108
DRAWN BY:	SFD
CHECKED BY:	WSBJR
DRAWING SCALE	3/8"=1'-0"

SHEET TITLE

THIRD FLOOR
LIFE SAFETY PLAN

LS101