


- WALL TYPE NOTES**
- REFER TO STRUCTURAL DRAWINGS FOR STUD SIZE AND SPACING
 - INSTALL WATER RESISTANT GYPSUM WALLBOARD IN ALL RESTROOMS AND TOILET ROOM WALLS AND CEILINGS, AND AT ANY WALL WITH PLUMBING FIXTURES
 - PROVIDE 1" GWB BEHIND ALL TUBS AND SHOWERS AT EXTERIOR WALLS AND FIRE RATED ASSEMBLIES. PROVIDE ADDITIONAL LAYER OF GWB TO COVER TUB AND SHOWER FLANGE. EXTEND ADDED LAYER ALONG ADJACENT WALLS AND ADJUST DOOR JAMB WIDTHS AS REQUIRED.
 - WHEN TWO ADJACENT WALL TYPES HAVE DIFFERING NUMBERS OF LAYERS OF GWB, THE FINISHED FACE OF GWB MUST FORM ONE CONTINUOUS PLANE, ADJUST STUD PLANE LOCATION AS REQUIRED TO ACHIEVE THE CONTINUOUS PLANE
 - HOLD BOTTOM OF GWB UP 1/2" FROM CONCRETE, PROVIDE SEALANT AT JOINT.
 - ALL WALL TYPES WITH AN INSULATION COMPONENT TO BE ACOUSTICALLY SEALED

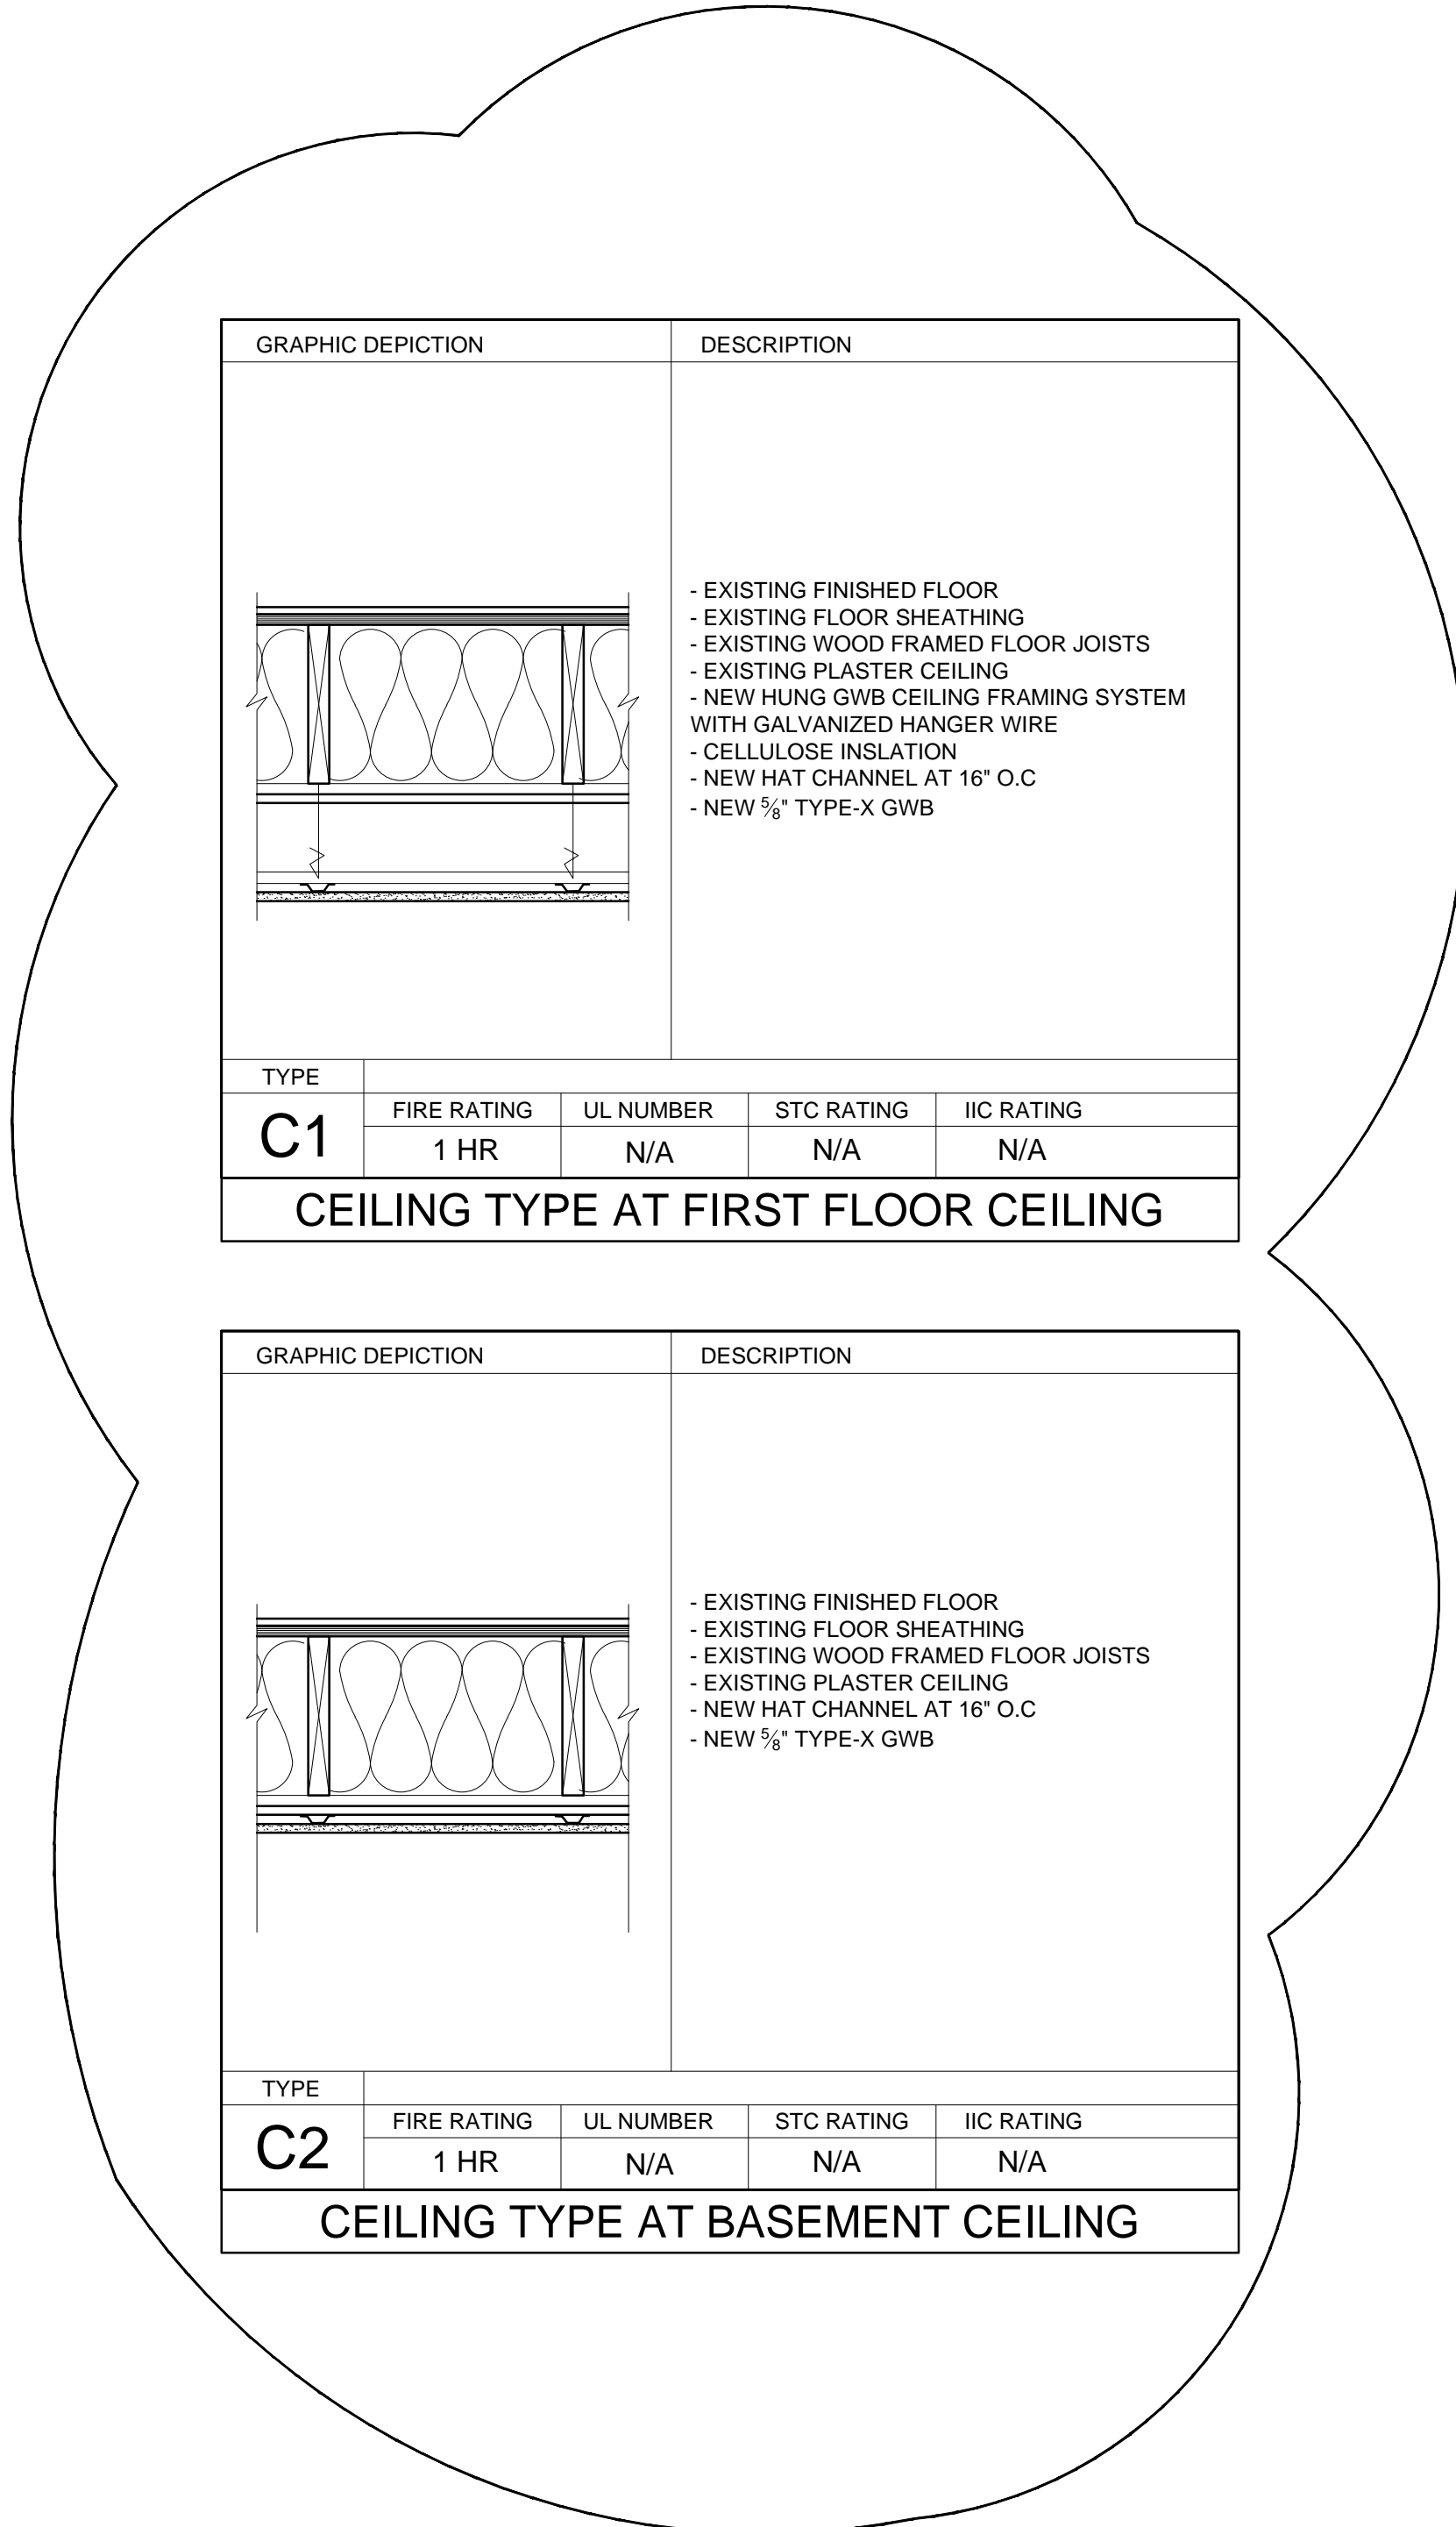

GRAPHIC DEPICTION		DESCRIPTION		
		<ul style="list-style-type: none"> EXISTING FINISHED FLOOR EXISTING FLOOR SHEATHING EXISTING WOOD FRAMED FLOOR JOISTS EXISTING PLASTER CEILING NEW HUNG GWB CEILING FRAMING SYSTEM WITH GALVANIZED HANGER WIRE CELLULOSE INSULATION NEW HAT CHANNEL AT 16" O.C NEW 5/8" TYPE-X GWB 		
C1	1 HR	N/A	N/A	N/A
CEILING TYPE AT FIRST FLOOR CEILING				

GRAPHIC DEPICTION		DESCRIPTION		
		<ul style="list-style-type: none"> EXISTING FINISHED FLOOR EXISTING FLOOR SHEATHING EXISTING WOOD FRAMED FLOOR JOISTS EXISTING PLASTER CEILING NEW HAT CHANNEL AT 16" O.C NEW 5/8" TYPE-X GWB 		
C2	1 HR	N/A	N/A	N/A
CEILING TYPE AT BASEMENT CEILING				

GRAPHIC DEPICTION		DESCRIPTION		
		<ul style="list-style-type: none"> LAYER OF 5/8" TYPE-X GWB 1/2" RESILIENT CHANNEL AT 24" O.C. 2X4 WOOD STUDS AT 16" O.C. 3-1/2" ACOUSTICAL FIRE BATT INSULATION LAYER OF 5/8" TYPE-X GWB 		
1A	1 HR	U311	35-39	N/A

GRAPHIC DEPICTION		DESCRIPTION		
		<ul style="list-style-type: none"> LAYER OF 5/8" TYPE-X GWB 1/2" RESILIENT CHANNEL AT 24" O.C. 2X6 WOOD STUDS AT 16" O.C. 5-1/2" ACOUSTICAL FIRE BATT INSULATION LAYER OF 5/8" TYPE-X GWB 		
1B	1 HR	U311	50-54	N/A

GRAPHIC DEPICTION		DESCRIPTION		
		<ul style="list-style-type: none"> LAYER OF 5/8" GWB 2X4 WOOD STUDS AT 16" O.C. 3-1/2" ACOUSTICAL SOUND BATT INSULATION LAYER OF 5/8" GWB (USE MOISTURE RESISTANT GWB AT ALL BATHROOM LOCATIONS)		
NA	N/A	N/A	N/A	N/A

GRAPHIC DEPICTION		DESCRIPTION		
		<ul style="list-style-type: none"> LAYER OF 5/8" GWB 2X6 WOOD STUDS AT 16" O.C. 5-1/2" ACOUSTICAL SOUND BATT INSULATION LAYER OF 5/8" GWB (USE MOISTURE RESISTANT GWB AT ALL BATHROOM LOCATIONS)		
NB	N/A	N/A	N/A	N/A

GRAPHIC DEPICTION		DESCRIPTION		
		<ul style="list-style-type: none"> 2X6 WOOD STUDS AT 16" O.C. LAYER OF 5/8" MOISTURE RESISTANT GWB 		
NC	N/A	N/A	N/A	N/A



© 2016 RYAN SENATORE ARCHITECTURE

LAYFAYETTE BUILDING RENOVATION
 PARK STREET
 PORTLAND, MAINE



RYAN SENATORE ARCHITECTURE
 565 CONGRESS STREET
 PORTLAND, MAINE 04101
 207-747-5159
 senatorearchitecture.com

CONSULTANTS:

REVISIONS:
 ▲ REVISION #1 - 8/2/17

DATE: SEPTEMBER 29, 2016

PROJECT No. 1621

DRAWN BY: RJS, RRT

CHECKED BY: RJS

SCALE: AS NOTED

SHEET TITLE:
 WALL, FLOOR AND CEILING TYPES

A0-1