

NOTE:




- 1. SEE SHEET E-001 FOR LEGEND AND ABBREVIATIONS.

KEYED NOTES:

- ① CONNECT NEW CONDENSING UNIT CU-1 TO EXISTING ELECTRICAL CIRCUIT.
- ② PROVIDE 3#14'S IN 3/4"C FROM CU-2A TO FCU-2A IN EQUIPMENT ROOM 01. CONNECT AS REQUIRED BY MITSUBISHI.
- ③ PROVIDE 3#14'S IN 3/4"C FROM CU-2B TO FCU-2B IN EQUIPMENT ROOM 01. CONNECT AS REQUIRED BY MITSUBISHI.
- ④ PROVIDE 3#10'S AND #10 GND IN 3/4"C.
- ⑤ MOVE CIRCUIT #1 (SIEMENS PANEL) TO CIRCUIT #2—SHARED WITH RECEPTACLE. REMOVE BREAKERS FROM POLES #1, #7, #9 AND #11. PROVIDE 2 30AMP 2-POLE BREAKERS AND ARRANGE EXISTING BREAKERS TO ACCOMMODATE.
- ⑥ CONNECT NEW CONDENSING UNIT 2A TO PANEL P2 (30A 2-POLE).
- ⑦ CONNECT NEW CONDENSING UNIT 2B TO PANEL P2 (30A 2-POLE).

144 Fore Street/P.O. Box 618
 Portland, Maine 04104
 tel. (207) 772-3846
 fax. (207) 772-1070
 www.ssmfinc.com

ARCHITECTURE
 ENGINEERING
 PLANNING
 INTERIOR DESIGN
 COMMISSIONING

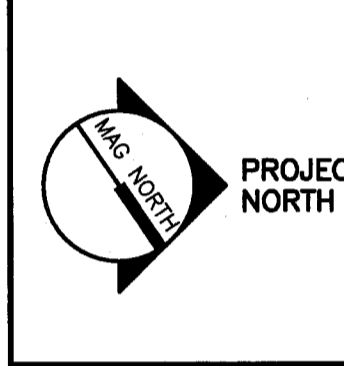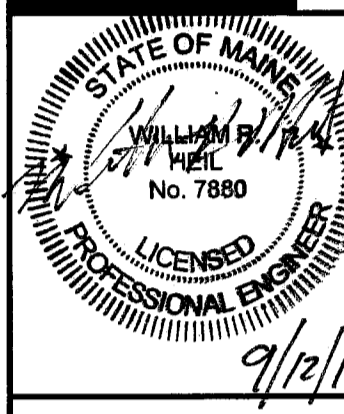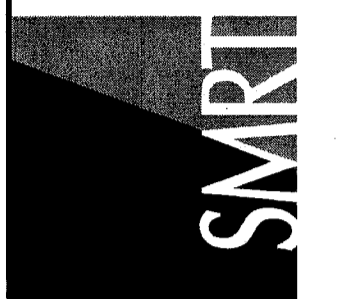

MERCY HOSPITAL
 EQUIPMENT REPLACEMENT
 PORTLAND, ME

ISSUED FOR CONSTRUCTION
 9-12-12

CURRENT ISSUE STATUS:

REV	DESCRIPTION	DATE
0	ISSUED FOR CONSTRUCTION	9-12-12

GRAPHIC SCALE:
 0" 1"

SCALE: AS NOTED
 PROJECT MANAGER: KD
 JC/DRAWN BY: RBB
 A/E OF RECORD: WRB
 CAD FILE: E-101-12076.DWG
 PROJECT NO: 12076
 DATE: 9-12-12

SHEET TITLE:
 ELECTRICAL
 ROOF PLANS

SHEET No.
E-101
 © copyright 2009 SSMF INC.

E ELECTRICAL ROOF PLAN
 1/4"=1'-0"