


Important! Wiring connections must have correct polarity.



5th
FLOOR

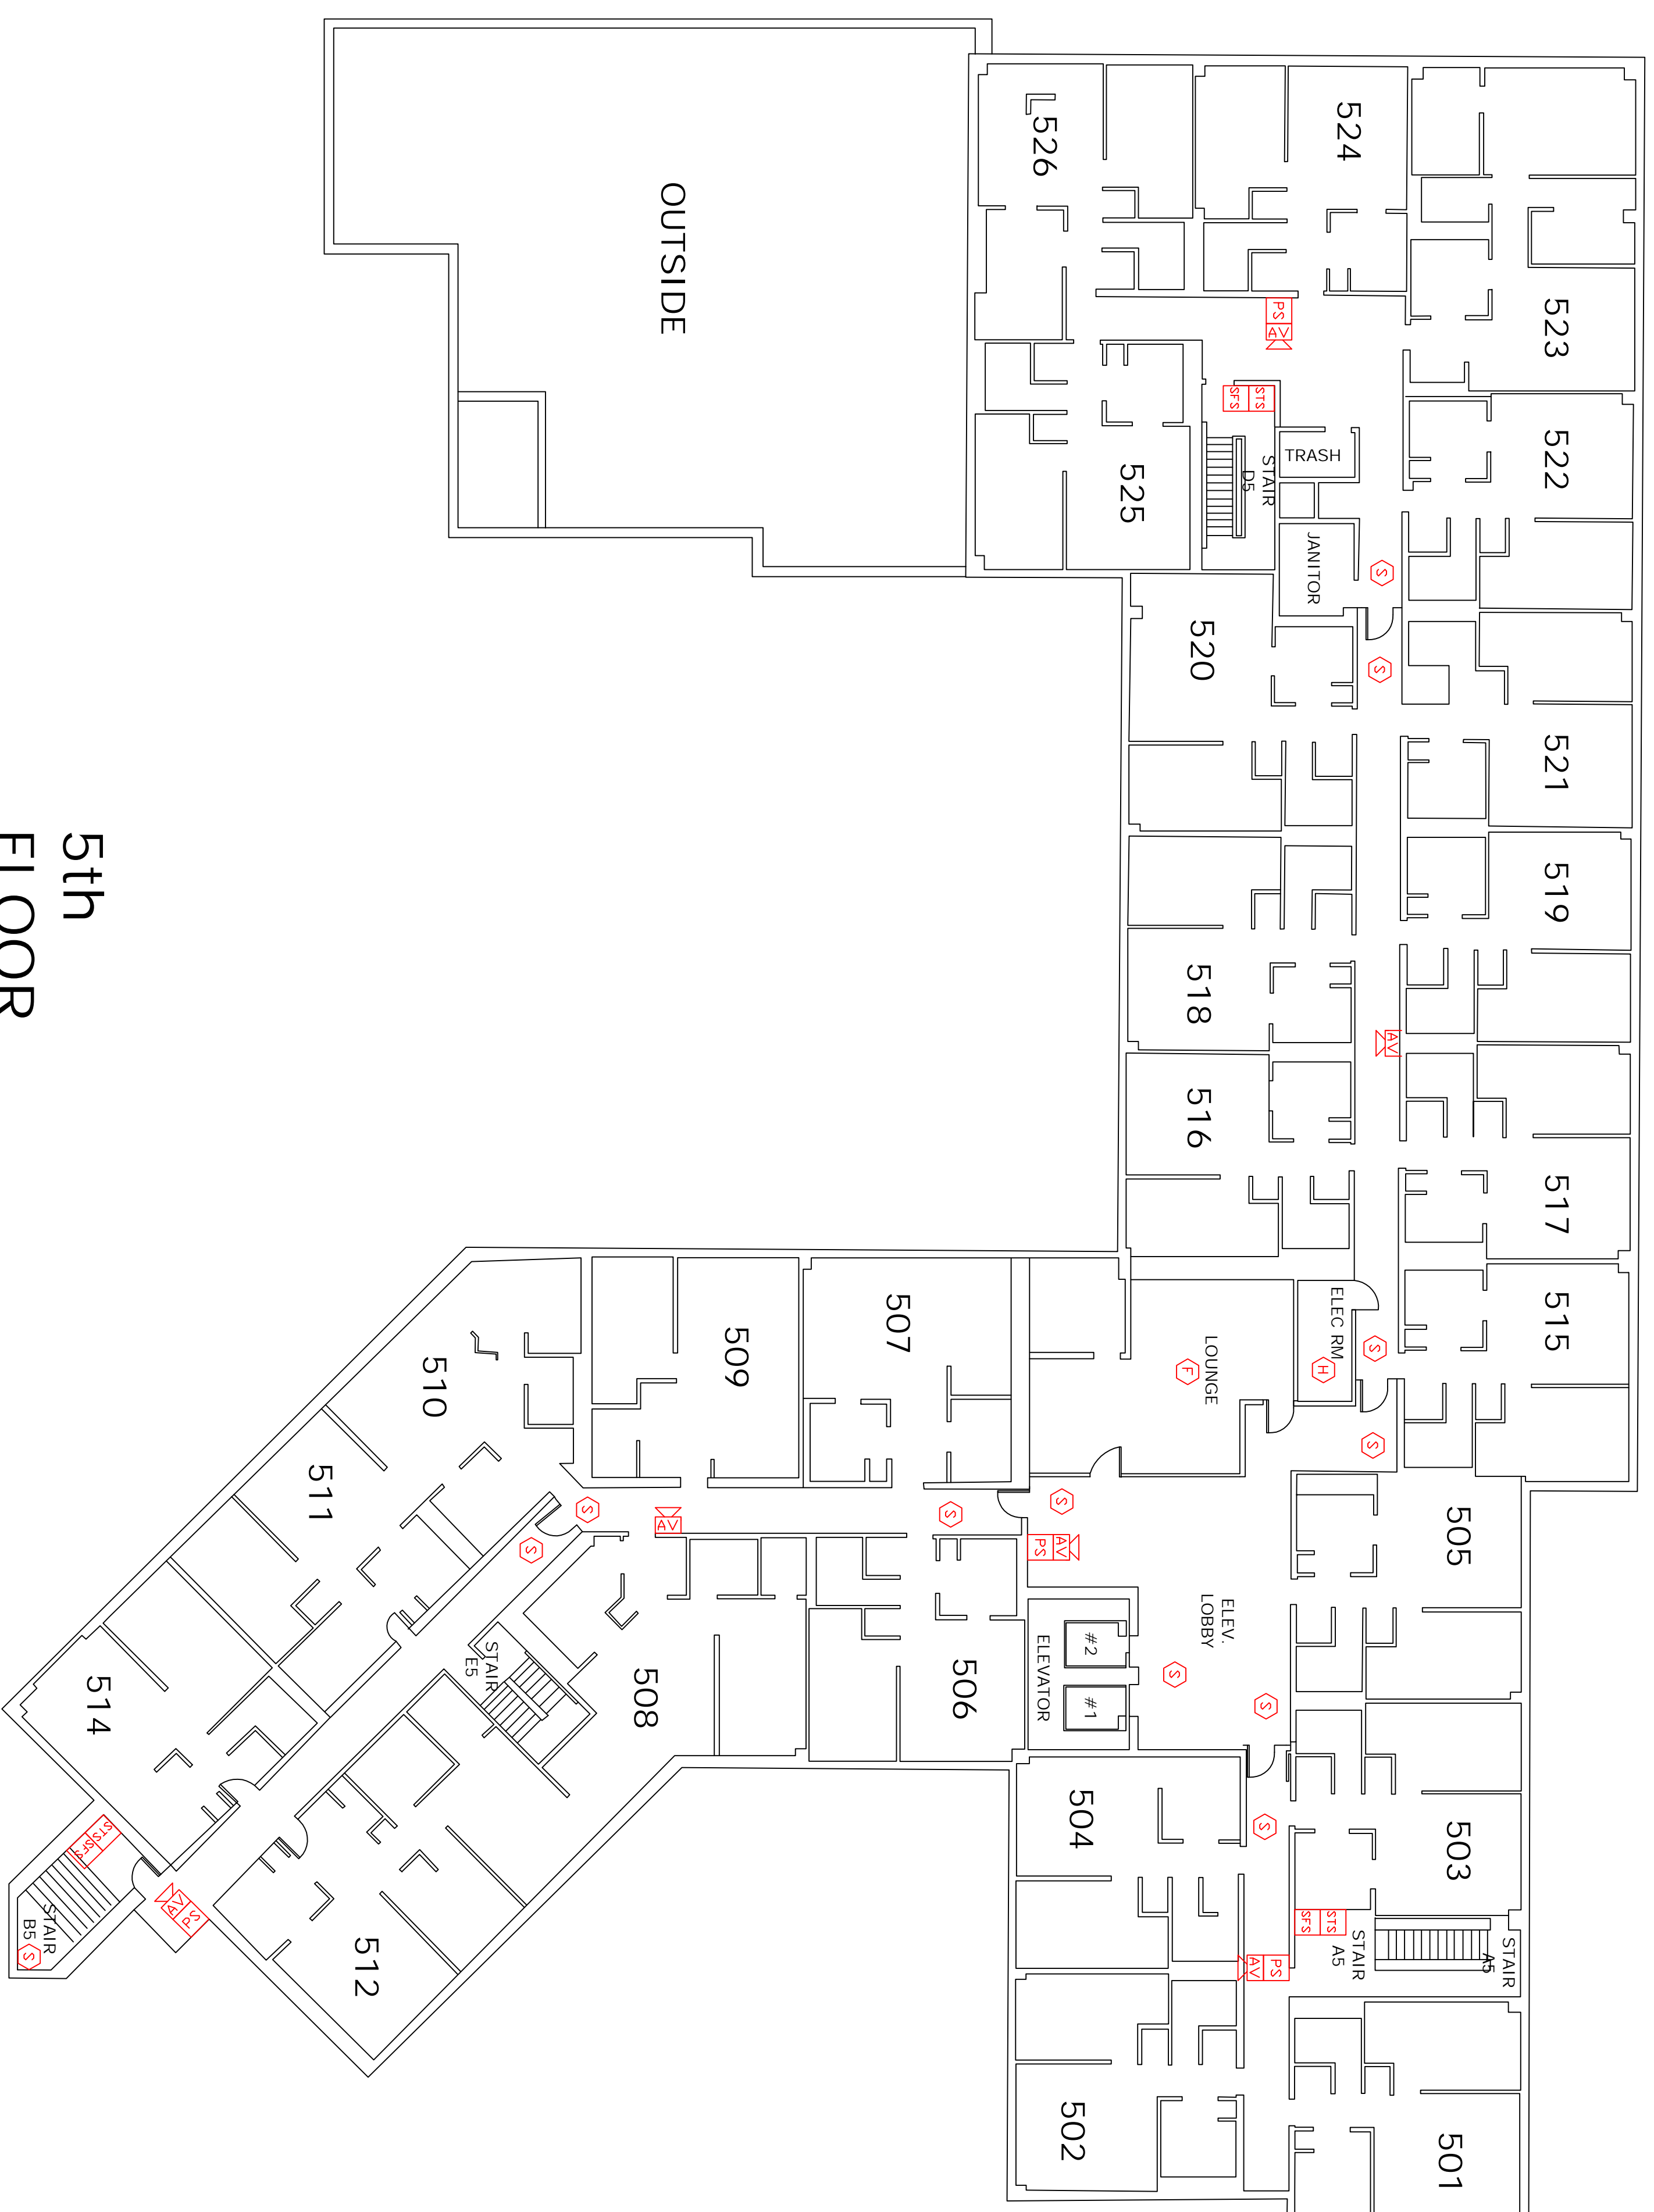

LEGEND

- PS PULL STATION
- S SMOKE DETECTOR
- H HEAT DETECTOR
- H FIXED TEMP
- RT REMOTE TEST/INDICATOR
- DS DUCT SMOKE DETECTOR W/ FSP-851R HEAD
- VD VISUAL ONLY
- AV AUDIO / VISUAL
- DSM DUAL SYNC MODULE
- ISD ISOLATION MODULE
- FMM MONITOR MODULE
- FRM RELAY MODULE
- STS SPRINKLER TAMPER
- SFS SPRINKLER FLOW

This drawing is an accurate layout from provided floor plans and information available at time of design. Circuiting has been designed for maximum use of resources available with supplied equipment. Deviations from this design must be noted and approved prior to final acceptance. Note: Signal Circuit 1 has a 2.5 amp load limitation, Circuits 2-3-4 have a combined load limitation of 2.5 amps. REMOTE power supply has a 3.0 amps limitation per circuit and an 8.0 amp combined limitation for all 4 circuits. Changes in circuiting must incorporate equipment specifications/limitations (see chart below for current vs. candle rating. Distances and ratings shown are for wall applications ONLY, call Norris, Inc. for ceiling devices when applicable.) Twisted-Shielded Cable is NDI recommended for use on SLC wiring for this panel. Untwisted cable inside/outside conduit has a 1000' max distance sizes 12-18AWG.

Room Size	Candle Rating	Load (amps)
20' x 20'	15 cd	0.08 amps
28' x 28'	30 cd	0.10 amps
45' x 45'	75 cd	0.15 amps
54' x 54'	110 cd	0.20 amps

- 4.7K END OF LINE RESISTOR (Panel Circuits)
- A 1 PR #12 AWG TWISTED PAIR CABLE(Up to 10,000 ft)
- A 1 PR #14 AWG TWISTED PAIR CABLE(Up to 8,000 ft)
- A 1 PR #16 AWG TWISTED PAIR CABLE(Up to 4,500 ft)
- B 1 PR #12 AWG FPL CABLE
- D 1 PR #14 AWG FPL CABLE
- E 1 PR #16 AWG FPL CABLE
- F 2C #12 AWG CABLE
- G 2C #14 AWG CABLE
- H 2C #16 AWG CABLE
- K 1 CAT5 CABLE
- L 1 PR #16 AWG TWISTED SHIELDED CABLE

REVISION	DATE
REVISION 2	DATE:
REVISION 1	DATE:
REVISION 0	DATE: 5/24/2013

SYSTEM WIRING RISER

PROJECT NAME
100 State Street (5th FI)
PORTLAND, MAINE

SCALE Graphic
BY: CIC
CK BY:

SAVED AS:
NORRIS INC
Prepared For Tomorrow, Delivered Today
2257 BROOKWAY, SO PORTLAND, MAINE

Important! Duplicate Addresses on devices of different style is NDI an error in design or printing. All electronic devices MUST be placed in a heated room with temperature above 32 degrees