


4TH FLOOR FRAMING PLAN

- NOTES:
- SEE SHEET S0.00 & S0.01 FOR GENERAL STRUCTURAL NOTES AND ADDITIONAL INFORMATION.
 - COORDINATE ALL THRU SLAB PLUMBING & CHASES ETC. W/ ARCH AND MECHANICAL DRAWINGS -TYP.
 - ALL SMALL FRAME BEAMS @ OPENINGS ETC. SHALL BE WR24 -TYP UNO
 - PROVIDE 3" MINIMUM CONCRETE WRAP AROUND ALL EXPOSED STL COLUMNS.
 - ALL STEEL FRAMING, CONNECTIONS, BOLTS ETC. AT EXPOSED GARAGE BELOW TO BE HOT DIP GALV. NOTE: CONC WRAPPED COLUMNS EXCLUDED.
 - 4 1/2" TOTAL DEPTH 3500PSI NORMAL WEIGHT CONCRETE W/ #6x W2.1xW2.1 WWF REINFORCING ON 2" V11 20 GAGE COMPOSITE METAL DECKING SPANNING 10'-0" MAX UNSHORED SPAN. (2 SPAN CONT MIN) UNO
 - 6.1. ALL FLOOR DECKING SHALL BE 2" V11 20 STEEL DECK (20GA) W/ 5/8"x0 PUDDLE WELDS @ 12", (66/4 PATTERN)
 - 6.2. GALV. 230 MIN COATING TOP AND BOT -TYP.
 - 6.3. MAX UNSHORED DECKING SPAN:
 - 6.3.1. 1 SPAN = 8'-2"
 - 6.3.2. 2 SPAN = 10'-3"
 - 6.3.3. 3 SPAN = 10'-7"
 - ALL COMPOSITE BEAMS TO HAVE QUANTITY OF 3/4" Ø x 3 1/2" HAS AS NOTED ON PLANS AS "#x#>". MINIMUM (1) 3/4" x 3 1/2" HAS @ 24" OC. ALONG SPAN -TYP.
 - T.O. STL BEAM ELEV = [131'-1 1/2"] -TYP UNO THIS LEVEL.
 - ALL ELEVATIONS LISTED BASED OFF REFERENCE ELEVATION 100'-0" EQUAL TO USGS 118'-0"
 - (TEMP) INDICATES TEMPORARY BEAMS FOR ERECTION STABILITY.
 - CONCRETE FLOOR DESIGNED AS RESTRAINED ASSEMBLY CONDITION

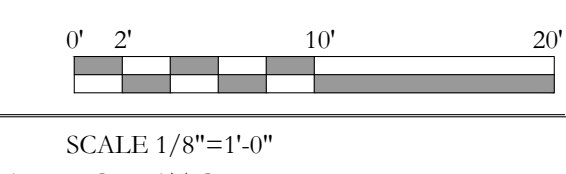

FRAMING KEY

	INDICATES DROPPED BEAM -TYP UNO
	INDICATES FLUSH TOP BEAM -TYP UNO
	INDICATES X-BRACED BAY BELOW
	INDICATES W8x8 DRAG STRUT W/ (10) 3/4"Ø x 3 1/2" HAS. -TYP UNO
	INDICATES BEAM END W/ MOMENT CONN.
	INDICATES COL CONT. (SPICES, SEE COL. SCHED.)
	INDICATES COL ABOVE, SEE COL. SCHED.
	INDICATES COL BELOW
	INDICATES DECKING SPAN -TYP