



© 2015 RYAN SENATORE ARCHITECTURE

667 CONGRESS STREET  
APARTMENTS  
PORTLAND, MAINE

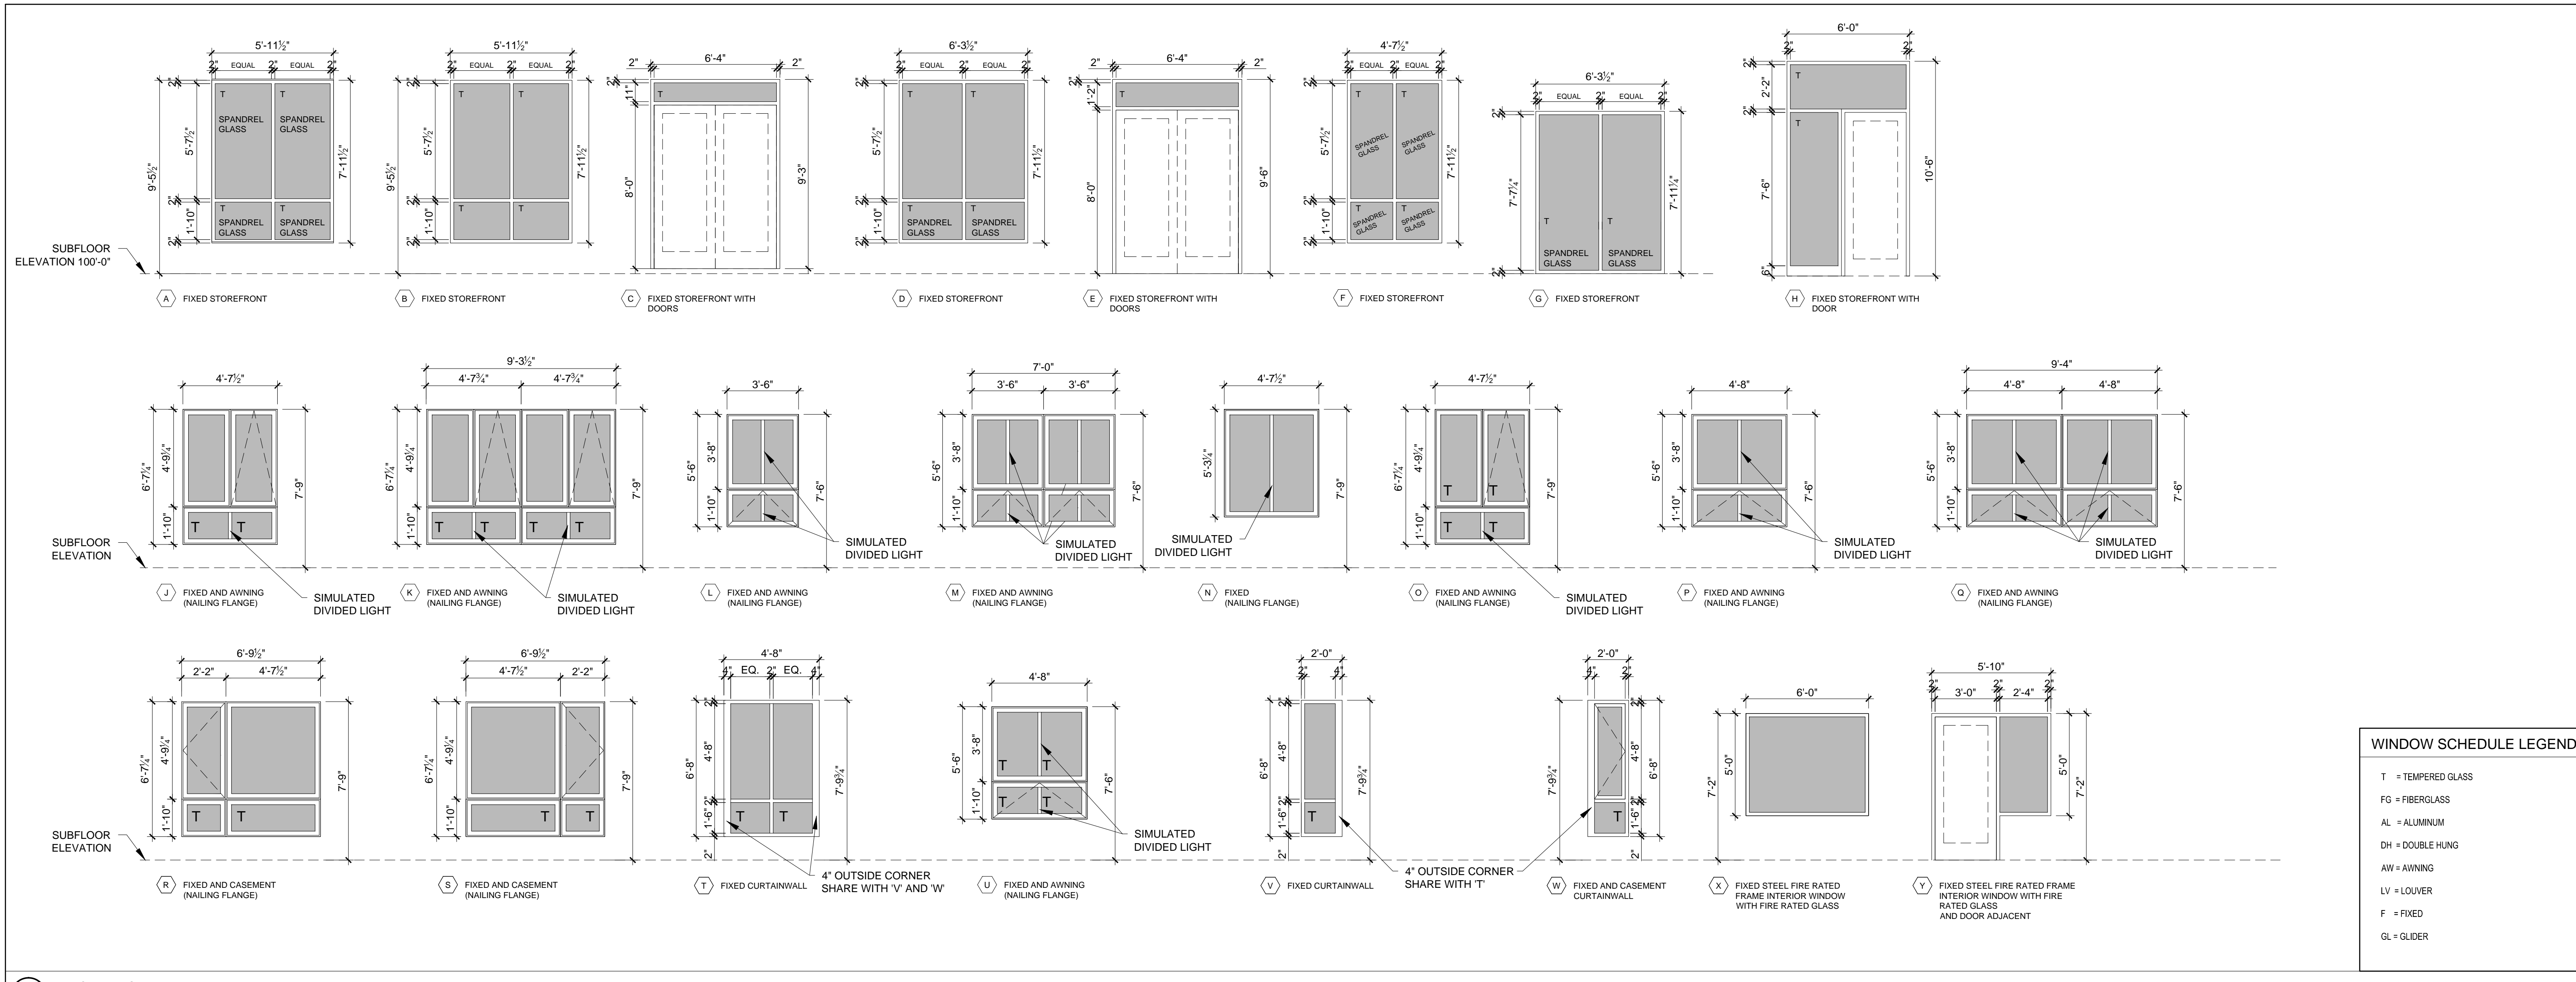

1 WINDOW TYPES  
1/8" = 1'-0"

KEY	ACTION	ROUGH OPENING (WxH) VIF	ROUGH OPENING (WxH) VIF	ROUGH OPENING (WxH) VIF	DETAILS	REMARKS
A	F	6'-0-3/8" X 6'-0-1/4"	-	-	AL	THERMALLY BROKEN STOREFRONT, DEFLECTION HEAD TRACK, SUB SILL RECEPTOR, INSULATED, TEMPERED GLAZING UNITS, VIF, MASONRY OPENING WIDTH, SPANDREL GLASS
B	F	6'-0-3/8" X 6'-0-1/4"	-	-	AL	THERMALLY BROKEN STOREFRONT, DEFLECTION HEAD TRACK, SUB SILL RECEPTOR, INSULATED, TEMPERED GLAZING UNITS, VIF, MASONRY OPENING WIDTH
C	F	6'-0-3/8" X 6'-0-1/4"	-	-	AL	THERMALLY BROKEN STOREFRONT, DEFLECTION HEAD TRACK, INSULATED, TEMPERED GLAZING UNIT
D	F	6'-4-1/2" X 6'-0-1/4"	-	-	AL	THERMALLY BROKEN STOREFRONT, DEFLECTION HEAD TRACK, SUB SILL RECEPTOR, INSULATED, TEMPERED GLAZING UNITS, VIF, MASONRY OPENING WIDTH, SPANDREL GLASS
E	F	6'-0-3/8" X 6'-0-1/4"	-	-	AL	THERMALLY BROKEN STOREFRONT, DEFLECTION HEAD TRACK, INSULATED, TEMPERED GLAZING UNIT
F	F	4'-8-1/2" X 6'-0-1/4"	-	-	AL	THERMALLY BROKEN STOREFRONT, DEFLECTION HEAD TRACK, SUB SILL RECEPTOR, INSULATED, TEMPERED GLAZING UNITS, SPANDREL GLASS
G	F	6'-4-3/8" X 6'-0"	-	-	AL	THERMALLY BROKEN STOREFRONT, DEFLECTION HEAD TRACK, SUB SILL RECEPTOR, INSULATED, TEMPERED GLAZING UNITS, VIF, MASONRY OPENING WIDTH AND HEIGHT, SPANDREL GLASS
H	F	6'-1" X 6'-0-1/2"	-	-	AL	THERMALLY BROKEN STOREFRONT, DEFLECTION HEAD TRACK, SILL RECEPTOR, INSULATED, TEMPERED GLAZING UNIT
J	AF	4'-8-1/4" X 6'-0"	-	-	AL/VL	SIMULATED DIVIDED LIGHT, 4" SASH LIMITER WITH TAMPER RESISTANT HARDWARE, FACTORY REINFORCED MULLS, TEMPERED GLASS, MASONRY OPENING (G.C. TO VERIFY WINDOW SIZE AND BRICK COURSE IN FIELD)
K	AF	5'-4-1/4" X 6'-0"	-	-	AL/VL	SIMULATED DIVIDED LIGHT, 4" SASH LIMITER WITH TAMPER RESISTANT HARDWARE, FACTORY REINFORCED MULLS, TEMPERED GLASS, MASONRY OPENING (G.C. TO VERIFY WINDOW SIZE AND BRICK COURSE IN FIELD)
L	AF	3'-6-1/4" X 5'-6-1/4"	-	-	AL/VL	SIMULATED DIVIDED LIGHT, 4" SASH LIMITER WITH TAMPER RESISTANT HARDWARE, FACTORY REINFORCED MULLS
M	AF	7'-0-3/4" X 5'-6-1/4"	-	-	AL/VL	SIMULATED DIVIDED LIGHT, 4" SASH LIMITER WITH TAMPER RESISTANT HARDWARE, FACTORY REINFORCED MULLS
N	F	4'-8-1/4" X 5'-4"	-	-	AL/VL	SIMULATED DIVIDED LIGHT, MASONRY OPENING (G.C. TO VERIFY WINDOW SIZE AND BRICK COURSE IN FIELD)
O	AF	4'-8-1/4" X 6'-0"	-	-	AL/VL	SIMULATED DIVIDED LIGHT, 4" SASH LIMITER WITH TAMPER RESISTANT HARDWARE, FACTORY REINFORCED MULLS, TEMPERED GLASS, MASONRY OPENING (G.C. TO VERIFY WINDOW SIZE AND BRICK COURSE IN FIELD)
P	AF	4'-8-3/4" X 5'-6-3/4"	-	-	AL/VL	SIMULATED DIVIDED LIGHT, 4" SASH LIMITER WITH TAMPER RESISTANT HARDWARE, FACTORY REINFORCED MULLS
Q	AF	4'-4-3/4" X 5'-6-3/4"	-	-	AL/VL	SIMULATED DIVIDED LIGHT, 4" SASH LIMITER WITH TAMPER RESISTANT HARDWARE, FACTORY REINFORCED MULLS
R	CF	6'-10-1/4" X 6'-8"	-	-	AL/VL	4" SASH LIMITER WITH TAMPER RESISTANT HARDWARE, FACTORY REINFORCED MULLS, TEMPERED GLASS
S	CF	6'-10-1/4" X 6'-8"	-	-	AL/VL	4" SASH LIMITER WITH TAMPER RESISTANT HARDWARE, FACTORY REINFORCED MULLS, TEMPERED GLASS
T	F	4'-8" X 6'-8"	-	-	AL	THERMALLY BROKEN CURTAINWALL, 4" CORNER TO MEET WITH WINDOW TYPES V AND W, DEFLECTION HEAD TRACK, SUBSILL RECEPTOR, INSULATED, TEMPERED GLAZING UNITS
U	AF	4'-8-3/4" X 5'-6-3/4"	-	-	AL/VL	SIMULATED DIVIDED LIGHT, 4" SASH LIMITER WITH TAMPER RESISTANT HARDWARE, FACTORY REINFORCED MULLS, TEMPERED GLASS
V	F	2'-0" X 6'-8"	-	-	AL	THERMALLY BROKEN CURTAINWALL, 4" CORNER TO MEET WITH WINDOW TYPE T, DEFLECTION HEAD TRACK, SUBSILL RECEPTOR, INSULATED, TEMPERED GLAZING UNITS
W	CF	2'-0" X 6'-8"	-	-	AL	THERMALLY BROKEN CURTAINWALL, 4" CORNER TO MEET WITH WINDOW TYPE T, DEFLECTION HEAD TRACK, SUBSILL RECEPTOR, INSULATED, TEMPERED GLAZING UNITS, PUSH OUT CASEMENT WINDOW WITH 4" SASH LIMITER WITH TAMPER RESISTANT HARDWARE, SCREEN
X	F	5'-1" X 6'-1"	-	-	STL	INTERIOR WINDOW, 60 MINUTE FIRE RATED FRAME, 45 MINUTE CLEAR FIRE RATED GLASS
Y	F	5'-10-1/2" X 7'-3-1/2"	-	-	STL	INTERIOR WINDOW, 60 MINUTE FIRE RATED FRAME, 45 MINUTE CLEAR FIRE RATED GLASS, WITH ADJACENT DOOR FRAME INTEGRAL

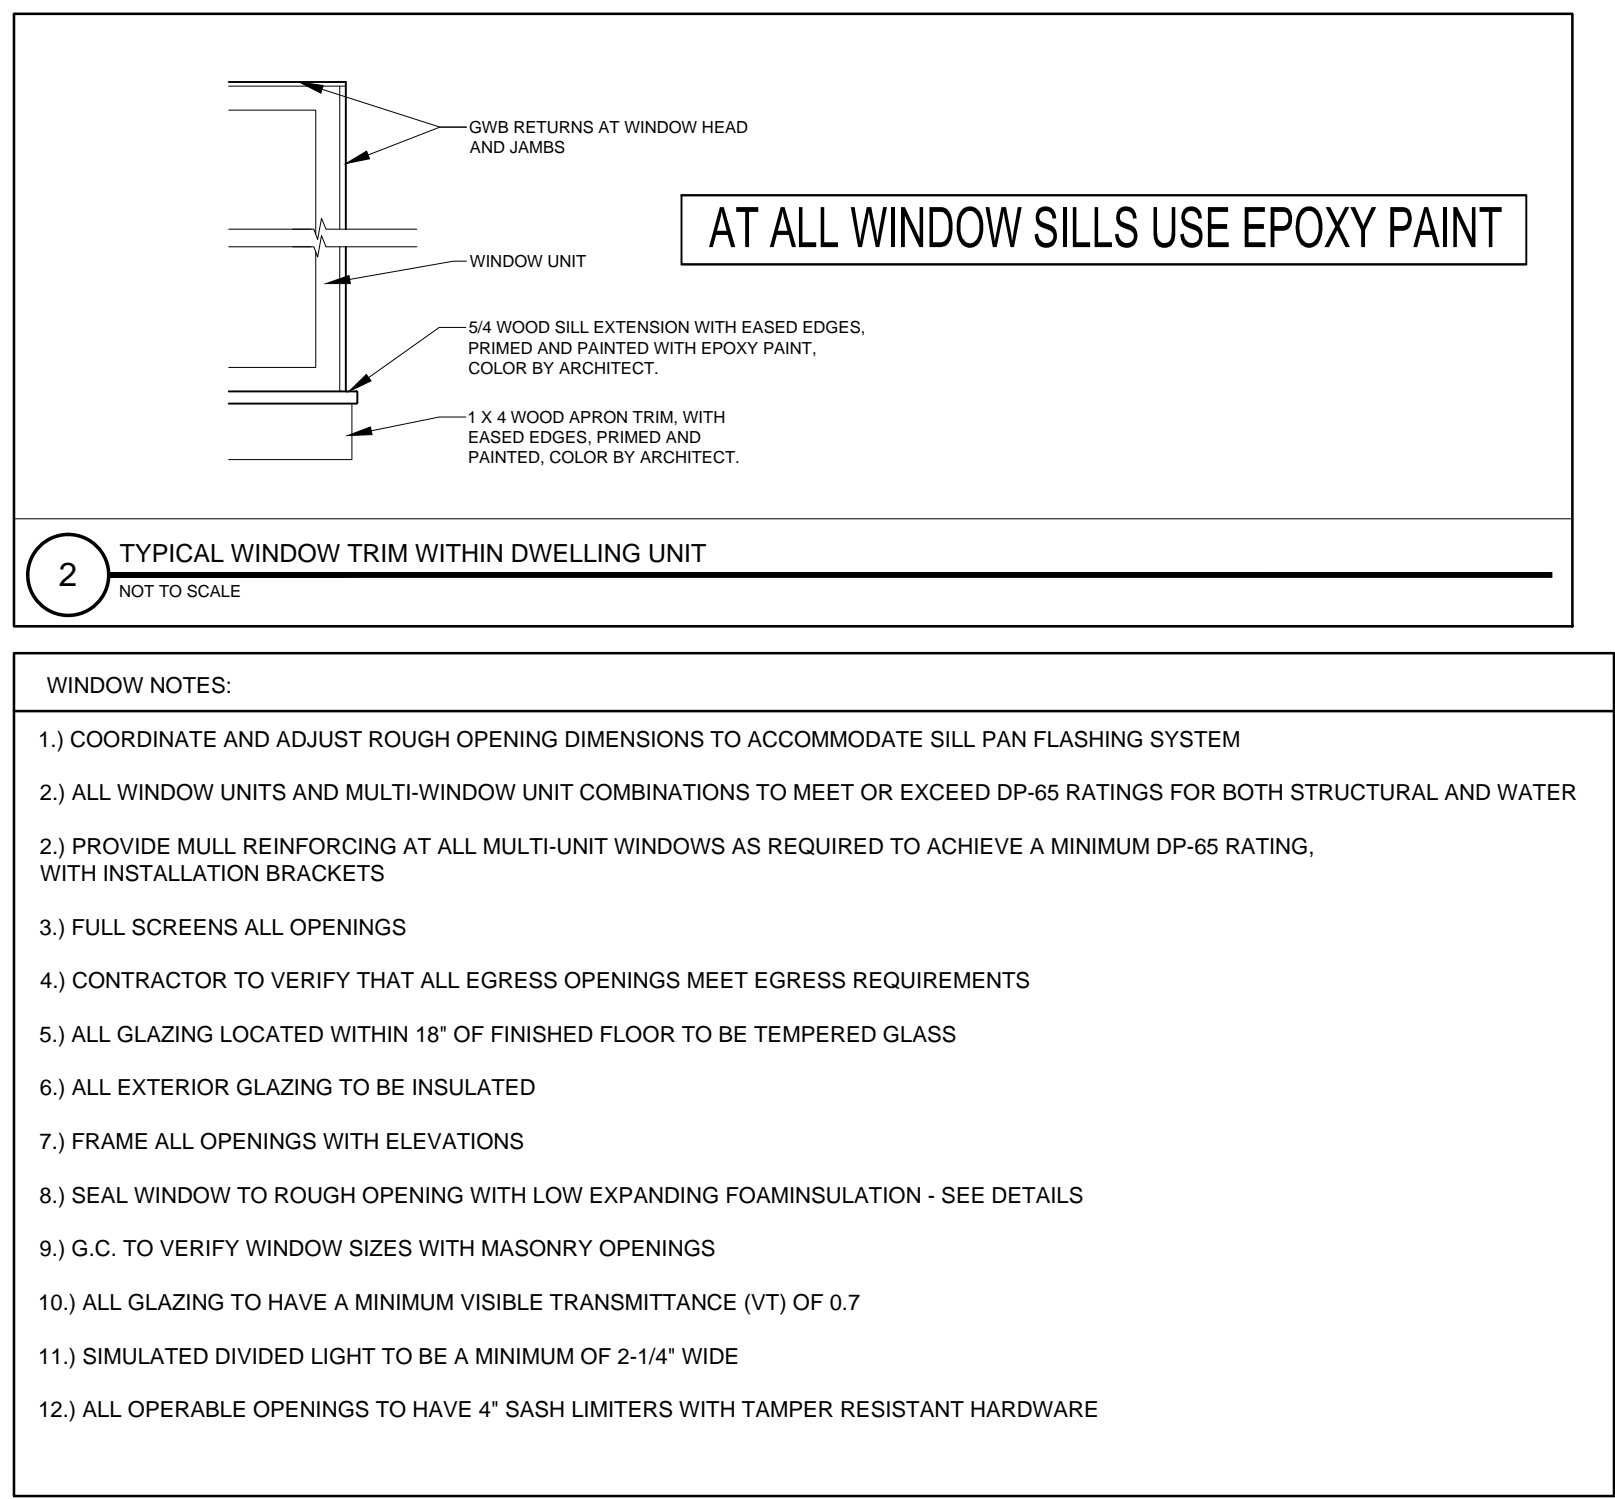

- 2 TYPICAL WINDOW TRIM WITHIN DWELLING UNIT  
NOT TO SCALE
- WINDOW NOTES:
- COORDINATE AND ADJUST ROUGH OPENING DIMENSIONS TO ACCOMMODATE SILL PAN FLASHING SYSTEM
  - ALL WINDOW UNITS AND MULTI-WINDOW UNIT COMBINATIONS TO MEET OR EXCEED DP-65 RATINGS FOR BOTH STRUCTURAL AND WATER, WITH INSTALLATION BRACKETS
  - FULL SCREENS ALL OPENINGS
  - CONTRACTOR TO VERIFY THAT ALL EGRESS OPENINGS MEET EGRESS REQUIREMENTS
  - ALL GLAZING LOCATED WITHIN 18" OF FINISHED FLOOR TO BE TEMPERED GLASS
  - ALL EXTERIOR GLAZING TO BE INSULATED
  - FRAME ALL OPENINGS WITH ELEVATIONS
  - SEAL WINDOW TO ROUGH OPENING WITH LOW EXPANDING FOAMINSULATION - SEE DETAILS
  - G.C. TO VERIFY WINDOW SIZES WITH MASONRY OPENINGS
  - ALL GLAZING TO HAVE A MINIMUM VISIBLE TRANSMITTANCE (VT) OF 0.7
  - SIMULATED DIVIDED LIGHT TO BE A MINIMUM OF 2-1/4" WIDE
  - ALL OPERABLE OPENINGS TO HAVE 4" SASH LIMITERS WITH TAMPER RESISTANT HARDWARE

**RSA**  
RYAN SENATORE ARCHITECTURE  
166 CONGRESS STREET  
PORTLAND, MAINE 04101  
207-650-6414  
senatorearchitecture.com

CONSULTANTS:  
STRUCTURAL  
Structural Integrity  
77 Oak Street  
Portland, ME 04101  
207-774-6414

REVISIONS:

DATE: 2 NOVEMBER 2016  
PROJECT No. 1503  
DRAWN BY: RJS / RRT  
CHECKED BY: RJS  
SCALE: AS NOTED

SHEET TITLE:  
WINDOW SCHEDULE

A7-0