


GENERAL NOTES

- DRAWING NOTES:** CONTRACTOR TO FURNISH AND INSTALL ALL NOTED LABOR AND MATERIALS UNLESS OTHERWISE NOTED.
- CODE COMPLIANCE:** ALL WORK SHALL CONFORM TO THE LATEST EDITION OF STATE, LOCAL AND OTHER CODES WHICH APPLY TO THIS PROJECT OR HAVE JURISDICTION.
- COORDINATION:** IT IS THE RESPONSIBILITY OF THE CONTRACTOR TO COORDINATE ALL DISCIPLINES AND TRADES SO THAT ALL BUILDING SYSTEMS AND COMPONENTS CAN BE ASSEMBLED WITHOUT CONFLICTS. IN THE EVENT THAT THE CONSTRUCTION DOCUMENTS DEFINE CONDITIONS WHICH PROHIBIT, OR MAY PROHIBIT, SUCH ASSEMBLY, THE CONTRACTOR SHALL BRING TO THE ARCHITECTS ATTENTION, IN WRITING AND IN A TIMELY FASHION, SUCH CONDITION. THE CONTRACTOR SHALL NOT PROCEED WITH RELATED WORK WITHOUT A WRITTEN RESOLUTION. THE CONTRACTOR AND HIS/her SUBCONTRACTORS SHALL BE RESPONSIBLE FOR PROVIDING MATERIALS AND SYSTEMS SHOWN IN THE CONSTRUCTION DOCUMENTS REGARDLESS OF WHERE THE INFORMATION IS LOCATED. WHERE COMPONENTS OF A SYSTEM ARE INDICATED THE CONTRACTOR SHALL BE RESPONSIBLE FOR PROVIDING ALL LABOR AND MATERIALS NECESSARY TO COMPLETE THE SYSTEM.
- DISCREPANCIES & CLARIFICATIONS:** IT IS THE RESPONSIBILITY OF THE CONTRACTOR TO BRING TO THE ARCHITECTS ATTENTION, IN WRITING, ANY DISCREPANCIES OR AMBIGUITIES IN THE DRAWINGS AND/OR SPECIFICATIONS. THE CONTRACTOR SHALL NOT PROCEED WITH RELATED WORK WITHOUT A WRITTEN RESOLUTION OR CLARIFICATION FROM THE ARCHITECT.
- LAYOUT:** UNLESS INDICATED OTHERWISE, CENTER WALL FRAMING AND PARTITION FRAMING ON COLUMN LINES. FLOOR PLAN DIMENSIONS ARE TO CENTER OF FRAMING, FACE OF CONCRETE, FACE OF CMU, OR FROM COLUMN CENTERLINES, UNLESS INDICATED OTHERWISE. DOORS AND WINDOWS ARE DIMENSIONED TO CENTERLINES UNLESS INDICATED OTHERWISE.
- CENTERING:** UNLESS INDICATED OTHERWISE, CENTER BUILDING ELEMENTS WITHIN OR BETWEEN OTHER BUILDING ELEMENTS WHEN CONDITIONS OR THE DRAWINGS INDICATE OR IMPLY THAT SUCH IS THE INTENT, WHETHER OR NOT DIMENSIONS ARE INCLUDED.
- SYMMETRY:** WHERE CONDITIONS OR THE DRAWINGS INDICATE OR IMPLY THAT SYMMETRY IS INTENDED, INFORMATION PROVIDED AT ONE SIDE APPLIES EQUALLY TO BOTH SIDES, UNLESS CONDITIONS CLEARLY PRECLUDE SUCH APPLICATION.
- ACCESSIBILITY:** ALL HANDICAPPED ACCESSIBLE BATHROOMS, GRAB BARS, AND DOOR OPENINGS SHALL MEET THE REQUIREMENTS OF TITLE 36-A MR, CHAPTER 6 OF THE MAINE HUMAN RIGHTS COMMISSION TITLE LATEST EDITION & THE DEPARTMENT OF JUSTICE ADA STANDARDS FOR ACCESSIBLE DESIGN.
- DRAWING SCALES:** WORK FROM THE GIVEN DIMENSIONS ONLY. SCALE IS INDICATED ON THE DRAWINGS FOR CONVENIENCE ONLY. IT IS NOT INTENDED THAT INFORMATION BE DETERMINED BY SCALING THE DRAWINGS SINCE SOME ITEMS MAY NOT BE TO SCALE.
- WATER-RESISTANT GWB:** INSTALL WATER-RESISTANT GYPSUM WALL BOARD IN ALL REST ROOMS & TOILET ROOMS OR AT ANY WALL WITH PLUMBING FIXTURES.
- HIGH IMPACT GWB:** INSTALL HIGH IMPACT GYPSUM WALL BOARD IN ALL STAIRWELLS.
- INTERIOR ELEVATIONS:** EXTERIOR ELEVATIONS MAY BE REVERSED FROM AND/OR SIMILAR TO ACTUAL CONDITIONS. SEE FLOOR PLANS FOR WINDOW AND DOOR QUANTITIES AND LOCATIONS. FOR CASEWORK LAYOUTS, AND FOR MONITOR LOCATIONS.
- BUILDING INSULATION:** PROVIDE AS INDICATED IN WALL SECTIONS AND IN ACCORDANCE WITH PARTITION TYPES, WHETHER OR NOT SHOWN IN DETAILS AND OTHER DRAWINGS. FOR CLARITY, INSULATION MAY NOT BE SHOWN IN SOME CASES, EVEN IF IT IS TO BE PROVIDED.
- BLOCKING:** INSTALL BLOCKING BEHIND ALL SURFACE-APPLIED FIXTURES TRIM, CASEWORK, SHELVES, BRACKETS, TOILET ACCESSORIES, CHAIR RAILS, PICTURE RAILS, GRAB BARS, BASE MOLDINGS, AND AS OTHERWISE REQUIRED, WHEN SUCH ITEMS ARE APPLIED ON STUD WALLS.
- PENETRATIONS AT STRUCTURAL MEMBERS:** BEFORE PENETRATING JOISTS, BEAMS OR OTHER STRUCTURAL MEMBERS, CONSULT WITH THE ARCHITECT.
- DAMAGED WORK:** BUILDING OR SITE COMPONENTS WHICH ARE AFFECTED BY NEW WORK, DEMOLITION, OR WHICH MAY BE DAMAGED BY THE GENERAL CONTRACTOR OR ANY SUB-CONTRACTOR SHALL BE REPLACED OR RESTORED TO ORIGINAL CONDITION AND COLOR TO MEET THE APPROVAL OF THE ARCHITECT.
- UTILITIES:** VERIFY THE SIZE AND LOCATION OF ALL UNDERGROUND UTILITIES AND REPORT ANY DISCREPANCIES TO THE ARCHITECT IN WRITING. DO NOT PROCEED WITH WORK UNTIL THE DISCREPANCY HAS BEEN RESOLVED TO THE SATISFACTION OF THE ARCHITECT.
- RATED CONSTRUCTION:** PROVIDE RATED CONSTRUCTION AS REQUIRED BY CODE, AS SPECIFIED, AND AS INDICATED ON DRAWINGS. IT IS THE RESPONSIBILITY OF THE CONTRACTOR TO PROVIDE AND INSTALL ALL COMPONENTS REQUIRED TO CREATE SUCH RATED CONSTRUCTION, REGARDLESS OF WHETHER OR NOT SUCH COMPONENTS ARE INDICATED. PROVIDE CONTINUITY OF SUCH RATED CONSTRUCTION AROUND AND BETWEEN SPACES, INCLUDING AT CHASES AND AT FLOORS, TO MAINTAIN COMPLETE SEPARATIONS, EVEN IF NOT SPECIFICALLY INDICATED.
- SHOP DRAWINGS:** SUBMIT SHOP DRAWINGS TO THE ARCHITECT FOR REVIEW PRIOR TO FABRICATIONS. SUBMITTALS REQUIRED INCLUDE, BUT ARE NOT LIMITED TO, SHOP DRAWINGS FOR ALL PREFABRICATED CONCRETE, STEEL, MILLWORK & SIGNAGE, SAMPLES OF ALL PROPOSED PAINTS, METALS, WALL COVERINGS, LAMINATES, SOLID SURFACE MATERIALS, CERAMIC TILE, AND HARDWARE. SUBMIT MANUFACTURERS DATA FOR ALL LIGHTING SYSTEMS, AND HARDWARE.
- PERMITS:** THE GENERAL CONTRACTOR SHALL OBTAIN AND PAY FOR ANY BUILDING PERMITS REQUIRED AND CARRY ANY INSURANCE COVERAGES REQUIRED.
- INTERIOR FINISHES:** ALL INTERIOR FINISHES AND FURNISHINGS ARE TO BE CLASS 'B' OR 'C' FIRE-RATED (UNLESS OTHERWISE NOTED) AND ARE TO COMPLY WITH IBC AND NFPA.
- ELECTRICAL DESIGN:** REFER TO ELECTRICAL DRAWINGS AND SPECIFICATIONS.
- WASTE REMOVAL:** THE GENERAL CONTRACTOR SHALL DISPOSE OF ALL WASTE AND DEBRIS OFF THE PREMISES.
- TEMPORARY FACILITIES:** PROVIDE ALL TEMPORARY FACILITIES AND SERVICES, CONSTRUCTION AND SUPPORT FACILITIES, AND SECURITY AND PROTECTION AS NEEDED TO PROTECT NEW AND EXISTING CONSTRUCTION FOR THE DURATION OF A COMPLETE INSTALLATION.
- FINAL CLEANING:** EMPLOY EXPERIENCED WORKERS FOR FINAL CLEANING. CLEAN EACH SURFACE TO THE CONDITION EXPECTED IN A COMMERCIAL BUILDING CLEANING PROGRAM.
- MANUFACTURERS INSTRUCTIONS:** ALL MATERIALS & EQUIPMENT SHALL BE INSTALLED ACCORDING TO MANUFACTURER'S SPECIFICATIONS.
- GUARANTEE:** GUARANTEE ALL MATERIALS AND WORKMANSHIP SHALL BE GUARANTEED FOR A PERIOD OF ONE YEAR FROM THE DATE OF FINAL ACCEPTANCE UNLESS OTHERWISE SPECIFIED FOR A LONGER PERIOD OF TIME ON A CERTAIN ITEM.
- ASBESTOS:** ALL MATERIAL USED FOR THE CONSTRUCTION OF THIS PROJECT, WHETHER BUILDING MATERIALS OR APPLIANCE/FIXTURES, SHALL BE NON-ASBESTOS CONTAINING MATERIAL.
- HAZARDOUS FUMES:** THE GENERAL CONTRACTOR SHALL CONFIRM THAT ALL MATERIALS AND EQUIPMENT SPECIFIED AND THEIR FABRICATION OR INSTALLATION WILL NOT RELEASE FUMES OR AROMAS DURING CONSTRUCTION WHICH MAY BE A HAZARD OR NUISANCE TO PERSONNEL.
- PEST CONTROL:** SEAL AND CALK AROUND ALL PENETRATIONS, CRACKS AND CREVICES AND ANY OPENINGS CAPABLE OF HARBORING INSECTS/RODENTS.
- EXPOSED UTILITIES:** ALL EXPOSED UTILITY WIRES AND PIPES (ELECTRICAL, PLUMBING, ETC.) SHALL BE INSTALLED IN A WAY THAT DOES NOT OBSTRUCT OR PREVENT THE CLEANING OF FLOORS, WALLS, AND CEILING AREAS. THEY SHALL BE INSTALLED A MINIMUM OF 6" OFF FLOORS AND 1" OFF WALLS, CEILINGS AND ADJACENT PIPES.
- OWNER SUPPLIED EQUIPMENT:** EQUIPMENT SUPPLIED BY THE OWNER AND INSTALLED BY THE GENERAL CONTRACTOR SHALL BE RESPONSIBLE FOR VERIFYING WITH THE OWNER THE EXACT DIMENSIONS AND EQUIPMENT CONNECTION REQUIREMENTS (INCLUDING ELECTRICAL CIRCUIT REQUIREMENTS) OF EQUIPMENT TO BE SUPPLIED. THE GENERAL CONTRACTOR SHALL MAKE ALL FINAL CONNECTIONS AS NOTED ON THE DRAWINGS, INSTALL THE SET UP IN WORKING ORDER, CHECK WARRANTIES, TEST AND NOT VOID WARRANTIES. THE GENERAL CONTRACTOR SHALL COORDINATE WITH THE OWNER DELIVERY, STORAGE AND INSTALLATION OF ALL OWNER SUPPLIED EQUIPMENT. THE GENERAL CONTRACTOR SHALL STORE EQUIPMENT IF REQUESTED BY THE OWNER UNTIL INSTALLATION. SEE DRAWINGS FOR OTHER OWNER SUPPLIED/GENERAL CONTRACTOR INSTALLED ITEMS.
- SOILS AT FOOTINGS:** REPORT THE LOCATION OF ALL UNSUITABLE SOILS AND MATERIALS BELOW ANTICIPATED LEVEL OF FOOTING TO THE ARCHITECT PRIOR TO THE SETTING OF FORMS.
- ACCESS PANELS:** CONTRACTOR IS RESPONSIBLE FOR COORDINATING QUANTITY AND LOCATION OF ALL REQUIRED ACCESS PANELS FOR ALL MEP CONTROLS, CLEANOUTS, DAMPERS, PULL BOXES, ETC.
- EXISTING HAZARDOUS MATERIALS:** ALL HAZARDOUS MATERIALS INCLUDING BUT NOT LIMITED TO ASBESTOS AND LEAD PAINT ARE TO BE HANDLED, ENCAPSULATED, ABATED AND DISPOSED OF IN ACCORDANCE WITH ANY AND ALL FEDERAL, STATE AND LOCAL REQUIREMENTS AND REGULATIONS.
- INDUSTRY STANDARDS:** ALL WORK SHALL BE PERFORMED IN ACCORDANCE WITH INDUSTRY STANDARDS. STANDARDS INCLUDE BUT ARE NOT LIMITED TO THE FOLLOWING:
AAMA AMERICAN ARCHITECTURAL MANUFACTURERS ASSOCIATION
ACI AMERICAN CONCRETE INSTITUTE
ANSI AMERICAN NATIONAL STANDARDS INSTITUTE
ASTM AMERICAN SOCIETY FOR TESTING AND MATERIALS
AWI ARCHITECTURAL WOODWORK INSTITUTE
"CUSTOM GRADE"
AWS AMERICAN WELDING SOCIETY
IGMA INSULATING GLASS MANUFACTURERS ALLIANCE
NAAMM NATIONAL ASSOCIATION OF ARCHITECTURAL METAL MANUFACTURERS
NRCAN NATIONAL ROOFING CONTRACTORS ASSOCIATION
NTCA NATIONAL TILE CONTRACTORS ASSOCIATION
SMACNA SHEET METAL AND AIR CONDITIONING NATIONAL ASSOCIATION
WDMA WINDOW AND DOOR MANUFACTURERS ASSOCIATION

ABBREVIATIONS

A	AC	AIR CONDITIONING	L	LAB	LABORATORY
ACT	AD	ACOUSTICAL CEILING TILE AREA DRAIN	LAM	LAM	LAMINATED
ADARG	ADARG	AMERICANS WITH DISABILITIES ACT ACCESSIBILITY'S GUIDELINES	LB	LB	POUND
ADD	ADD	ADDITION	LH	LH	LEFT HAND
AFF	AFF	ABOVE FINISHED FLOOR	LCC	LCC	LEAD COATED COPPER
AHU	AHU	AIR HANDLING UNIT	M	MACH	MACHINE
ARCH	ARCH	ARCHITECT/ARCHITECTURAL	MAS	MAS	MASONRY
AWP	AWP	ACOUSTIC WALL PANEL	MATL	MATL	MATERIAL
B	B	BACK-TO-BACK ANGLES	MAX	MAX	MAXIMUM
B TO BLS	B TO BLS	BACK-TO-BACK GENERAL CONTRACTOR BUILDING LINE	MDB	MDB	MEDIUM DENSITY OVERLAY
BLC	BLC	BUILDING LINE	MECH	MECH	MECHANICAL
BLKG	BLKG	BLOCKING	MEZZ	MEZZ	MEZZANINE
BNT	BNT	BASINENT	MFR	MFR	MANUFACTURER
BW	BW	BETWEEN	MIN	MIN	MINIMUM
BWV	BWV	BETWEEN BY OTHERS	MISC	MISC	MISCELLANEOUS
DO	DO	DOORS	MO	MO	MASONRY OPENING
C	C	COURSE (MASONRY)	MTL	MTL	MOUNTED
CER	CER	CERAMIC	MTA	MTA	META
CG	CG	CORNER GUARD	MB	MB	MARKER BOARD
CH	CH	CHANCE	N	N	NORTH
CJ	CJ	CONTROL JOINT	NI	NI	NOT IN CONTACT
CL	CL	CENTERLINE	NOM	NOM	NOMINAL DIMENSION
CLG	CLG	CEILING	NTS	NTS	NOT TO SCALE
CMU	CMU	CONCRETE MASONRY UNIT	O	O	ON/OVER
CO	CO	CLEAN OUT	OC	OC	ON CENTER
CONC	CONC	CONCRETE	OD	OD	OUTSIDE DIAMETER/OUTSIDE DIMENSION
CONJ	CONJ	CONNECT/CONNECTION	OFF	OFF	OFFICE
CONT	CONT	CONTINUOUS	OPN	OPN	OPENING
CPR	CPR	CERAMIC TILE	OPP	OPP	OPPOSITE
CUH	CUH	CABINET UNIT HEATER	OSB	OSB	ORIENTED STRAND BOARD
D	D	DOUBLE	OZ	OZ	OUNCES
DBL	DBL	DOUBLE	P	P	PURCHASED BY OWNER INSTALLED BY CONTRACTOR
DF	DF	DIFFUSER	PC	PC	PLASTER
DIA	DIA	DIAMETER	PLM	PLM	PLASTIC LAMINATE
DIFF	DIFF	DIFFUSER	PL	PL	PREFABRICATE
DN	DN	DOWN	PRF	PRF	PRIME
DR	DR	DRY	PS	PS	POUNDS PER SQUARE FOOT
DSP	DSP	DRY STAND PIPE	PTD	PTD	PAINTED
DWG	DWG	DRAWING	PTN	PTN	PARTITION
E	E	EAST	PVC	PVC	POLYVINYL CHLORIDE
EA	EA	EACH	PWD	PWD	PLYWOOD
ELEV	ELEV	ELEVATION	PT	PT	PRESSURE TREATED
ELEC	ELEC	ELECTRICAL	PERF	PERF	PERFORATED
ENTR	ENTR	ENTRANCE	Q	Q	QUARRY TILE
EQUIP	EQUIP	EQUIPMENT	QTR	QTR	QUARTER
EXP	EXP	EXPANSION BOLT	R	R	RISER/RADIUS
EXT	EXT	EXTERIOR JOINT	RAD	RAD	RADIANT
EPDM	EPDM	ETHYLENE PROPYLENE DIENE MONOMER	RB	RB	RUBBER BASE
EVC	EVC	ELECTRIC WATER COOLER	RC	RC	REFLECTED CEILING PLAN
F	F	FAHRENHEIT	RD	RD	ROOF DRAIN
FB	FB	FLAT BAR	REF	REF	REFRIGERATING BAR
FC	FC	FLOOR FINISH	REF	REF	REFRIGERATOR
FD	FD	FLOOR DRAIN	REIN	REIN	REINFORCED
FE	FE	FIRE EXTINGUISHER	REQ	REQ	REQUIRED
FEC	FEC	FIRE EXTINGUISHER CABINET	RES	RES	RESILIENT
FE	FE	FIRE EXTINGUISHER	REV	REV	REVEAL
FIN	FIN	FLOOR FINISH	REV	REV	REVEAL
FIN	FIN	FLOOR FINISH	ROW	ROW	ROUGH OPENING
FIN	FIN	FLOOR FINISH	ROW	ROW	ROUGH OPENING
FOB	FOB	FACE OF BRICK	S	S	SOUTH
FOC	FOC	FACE OF CONCRETE	SCHED	SCHED	SCHEDULE
FOF	FOF	FACE OF FINISH	SQ	SQ	SQUARE FEET
FOW	FOW	FACE OF STUDS	SH	SH	SIMILAR
FSS	FSS	FIRE SUPPRESSION SYSTEM	SPEC	SPEC	SPECIFICATION
FTG	FTG	FOOTING	SQ	SQ	SQUARE
FR	FR	FIBER REINFORCED GYPSUM	SST	SST	STAINLESS STEEL
FTR	FTR	FIBER TUBE RADIATION	STC	STC	SOUND TRANSMISSION CLASS
FUM	FUM	FUME HOOD	STD	STD	STANDARD
G	G	GAUGE	STR	STR	STRUCTURE/STRUCTURAL
GA	GA	GALVANIZED	SUSP	SUSP	SUSPENSION
GB	GB	GRAB BAR	T	T	TONGUE/GROOVE
GC	GC	GENERAL CONTRACTOR	TEL	TEL	TELEPHONE
GFI	GFI	GROUND-Fault INTERRUPTER	THK	THK	THICK
GL	GL	GLASS/LIGHTING GLAZES	TOP	TOP	TOP OF DECK
GLM	GLM	GLUE-LAMINATED WOOD	TOP	TOP	TOP OF STEEL
GRD	GRD	GROUND	TR	TR	TYPICAL
GWB	GWB	GYPSUM WALL BOARD	TV	TV	TELEVISION
H	H	HOSE BIB	TACK	TACK	TACK BOARD
HB	HB	HOSE BIB	TOC	TOC	TOP OF CONCRETE
HC	HC	HANDICAP	UL	UL	UNDERWRITERS LABORATORIES, INC.
HDM	HDM	HOLLOW METAL	UV	UV	UNIT VENTILATOR
HORIZ	HORIZ	HORIZONTAL	V	V	VINYL COMPOSITION TILE
HR	HR	HOUR	VERT	VERT	VERTICAL
HW	HW	HOT WATER	VIF	VIF	VERIFY IN FIELD
HVAC	HVAC	HEATING VENTILATION AIR CONDITIONING	VOL	VOL	VOLUME
I	I	INSIDE DIMENSION/INSIDE DIAMETER	W	W	WEST
ID	ID	INSIDE DIMENSION/INSIDE DIAMETER	WO	WO	WITHOUT
IN	IN	INCHES	W/	W/	WITH
INFO	INFO	INFORMATION	WOD	WOD	WOOD
INSUL	INSUL	INSULATION	WF	WF	WIDE FLANGE
J	J	JOIST	WP	WP	WORK POINT
JT	JT	JOINT	WT	WT	WEIGHT
K	K	KILN-DRIED			
KIP	KIP	1000 POUNDS			

FIRESTOPPING DETAILS

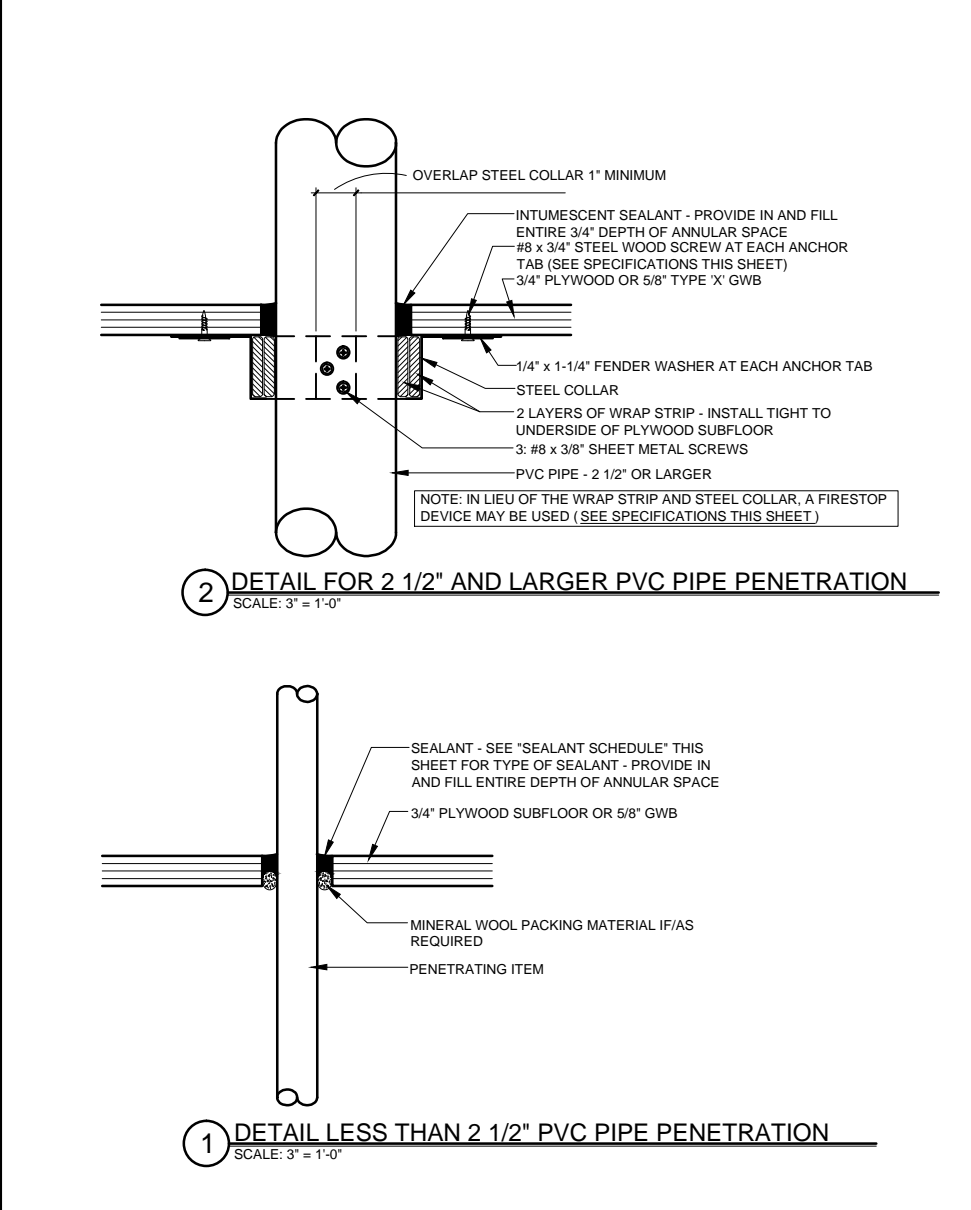

SPECIFICATIONS

WRAP STRIP: 1/4" THICK x 1 1/2" MINIMUM WIDTH INTUMESCENT MATERIAL WITH PLASTIC FILM FACING BOTH SIDES. TEMPORARILY SECURE WITH MASKING TAPE. SPECIFIED TECHNOLOGIES INC. (STI) "SpecShield Red Wrap Strip" OR "SpecShield Blue Wrap Strip" OR EQUAL.

STEEL COLLAR: WRAP STRIP MANUFACTURER'S STEEL COLLAR, FABRICATED FROM .016 INCH THICK GALVANIZED SHEET STEEL, WIDTH TO MATCH WRAP STRIP (1 1/2" MINIMUM), WITH 1 INCH x 2 INCH ANCHOR TABS AND RETAINER TABS. ANCHOR TABS TO BE SYMMETRICALLY OPPOSED AROUND COLLAR. PROVIDE 3 TABS FOR 2 1/2" AND 3" PIPE, PROVIDE 4 TABS FOR 4" PIPE.

INTUMESCENT SEALANT: ONE-PART, INTUMESCENT, LATEX ELASTOMER TESTED TO ASTM E 814. MINIMUM EXPANSION OF 3x AT 1000°F. 3M™ FIRE BARRIER SEALANT CP 25WB-4™ OR EQUAL.

FIRESTOP SEALANT: SINGLE COMPONENT NONCOMBUSTIBLE FIRE RATED SEALANT TESTED TO ASTM E 814. TESTED TO 3000°F. BOSS 136 FIRESTOP/DRAFT SEALANT™ MANUFACTURED BY ACCUMETRIC, LLC. OR EQUAL.

SEALANT SCHEDULE:

INTUMESCENT SEALANT: PROVIDE AT ALL PENETRATIONS THROUGH RATED CONSTRUCTION FOR PENETRATING ITEMS INCLUDING BUT NOT LIMITED TO: PVC PIPE, ROOF LEADER PIPES, GAS PIPES & LINES, SPRINKLER PIPES, ELECTRICAL & COMMUNICATIONS CABLES & WIRES, AND ALARM SYSTEM WIRES. DO NOT USE INTUMESCENT SEALANT AT DOMESTIC HOT WATER OR HYDRONIC HEATING SYSTEM PIPES.

FIRESTOP SEALANT: PROVIDE AT ALL PENETRATIONS THROUGH RATED CONSTRUCTION FOR PENETRATING ITEMS INCLUDING DOMESTIC HOT AND COLD WATER PIPES AND HYDRONIC HEATING SYSTEM PIPES.

NOTE: FOR LOCATIONS OF RATED CONSTRUCTION, SEE ARCHITECTURAL FLOOR PLANS AND SECTIONS.

DRAWING LEGEND

