
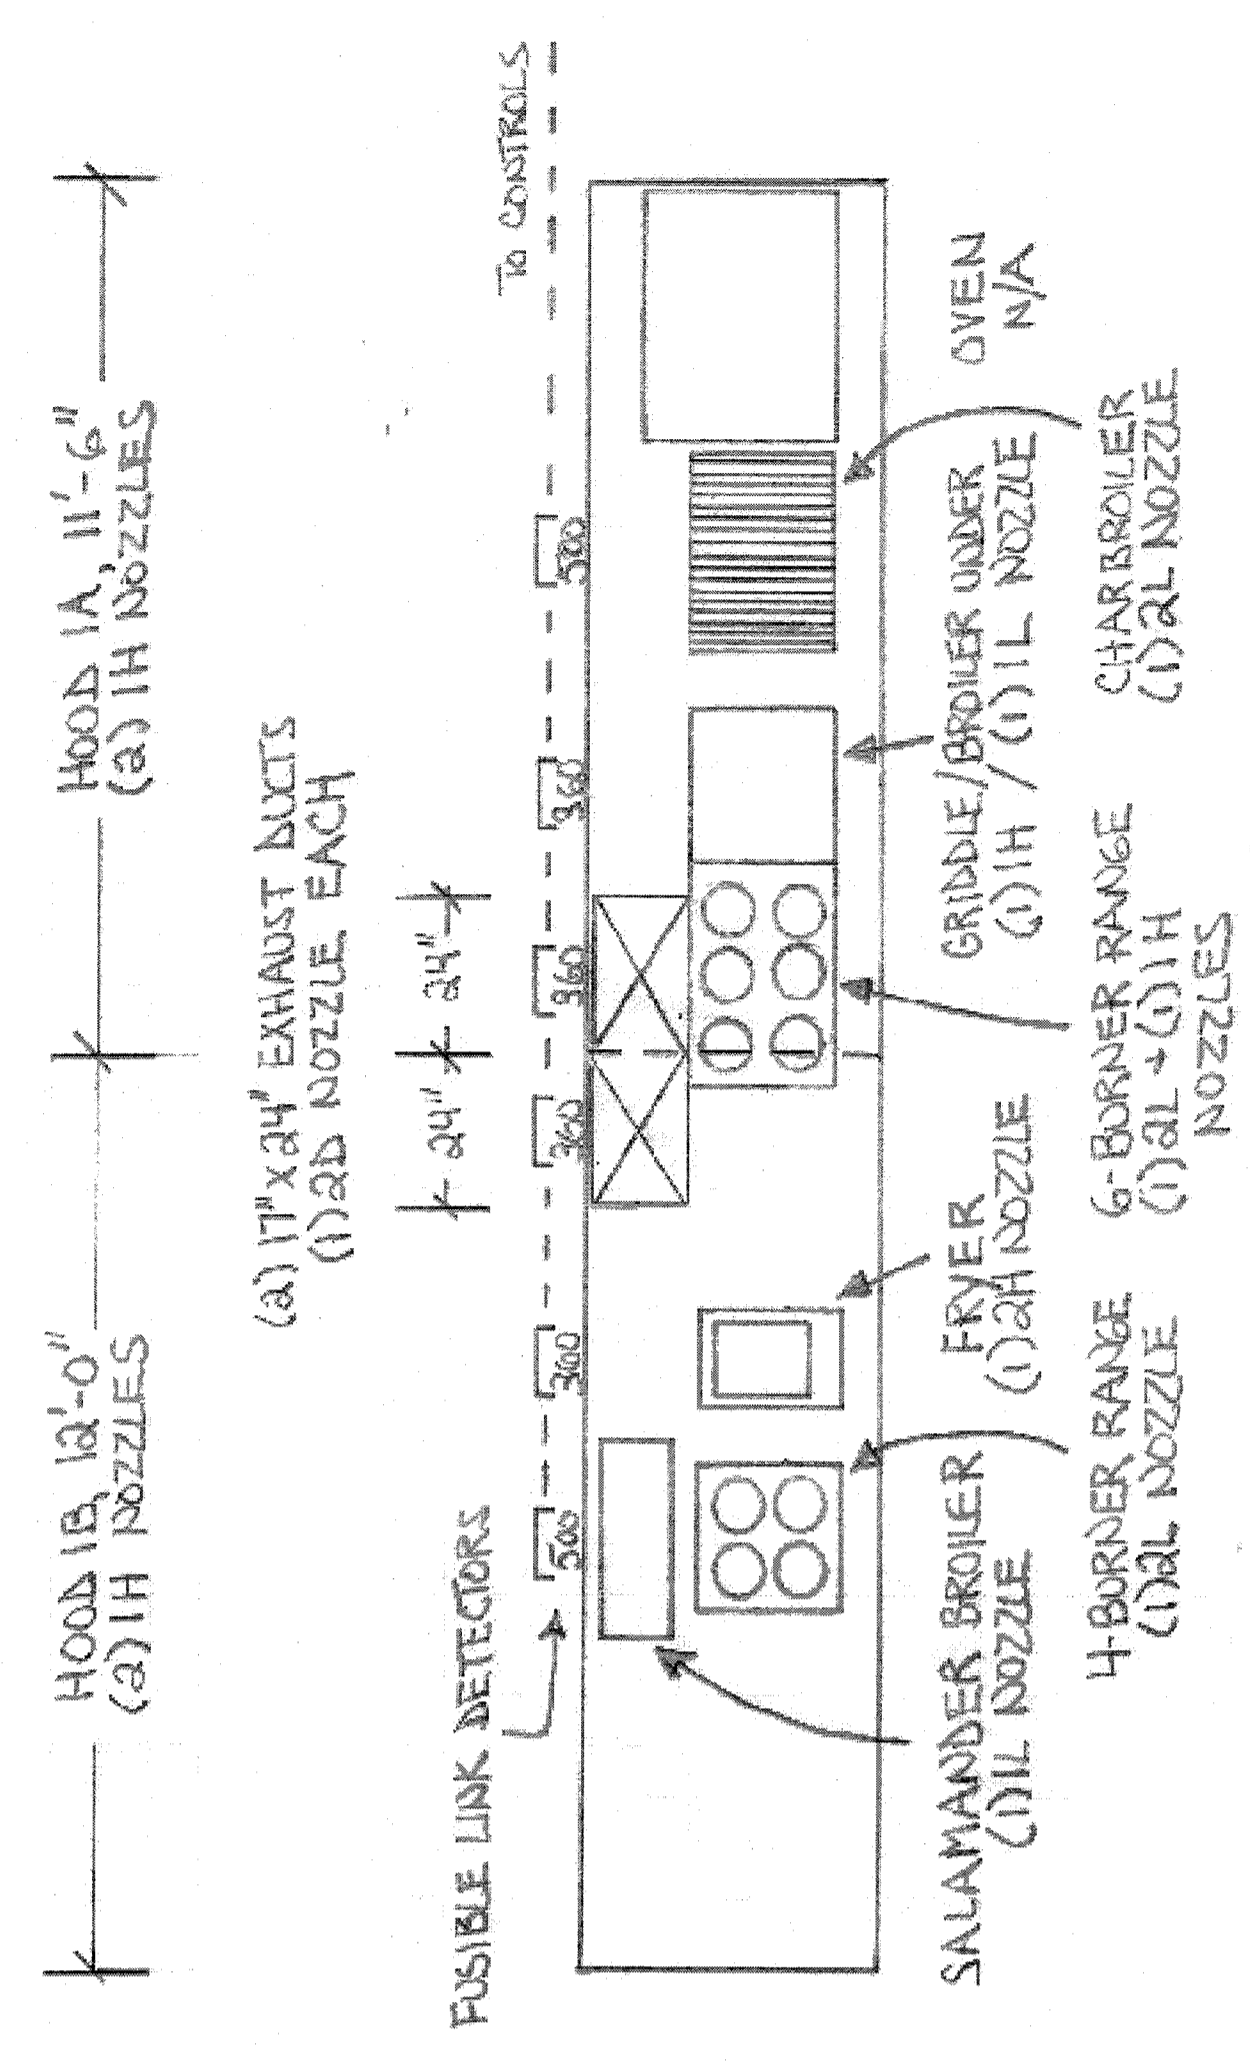


PYRO-CHEM PCL600 / KITCHEN HOOD FIRE SUPPRESSION SYSTEM

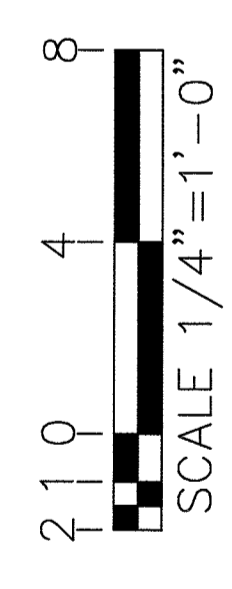

NOZZLE COVERAGE FOR PLENUMS  
DUCTS + APPLIANCES

<b>tyco</b> Fire & Security		<b>SimplexGrinnell</b> Executive Offices - Houston, Texas, USA LOCAL OFFICE: WESTBROOK, ME.		CONTRACT NAME <b>LOCAL SPROUTS CAFE</b> 649 CONGRESS STREET PORTLAND, ME 04101		SCALE: 1/4"=1'-0"	
APPROVALS		SYSTEM INFO		ENGINEERING DEPARTMENT		DRAWN BY: T. PRAY	
<input type="checkbox"/> IN _____ <input type="checkbox"/> OUT _____ <input type="checkbox"/> IN _____ <input type="checkbox"/> OUT _____		SYSTEM NAME/NO. _____ SYSTEM TYPE _____ VALVE SIZE _____ SYSTEM AREA _____		CHECKED BY: T. HIMMAN		PLANS PREPARED AT: SIMPLEXGRINNELL LP 20 THOMAS DRIVE WESTBROOK, ME. 04092 PHONE: 207-842-8440 FAX: 207-842-9439	
REVISIONS		HAZARD CLASSIFICATION		CONTRACT WITH: BAYSIDE MAINE, LLC		CONTRACT NO.: 94689101	
NO. _____		DATE _____		DESCRIPTION: KITCHEN HOOD SUPPRESSION SYSTEM		DATE: MAY 2010	
BY REVISION DESCRIPTION _____		CALCULATION DESIGN DATA		SEE CALC SHEETS		DRAWING NO. 1 OF 1	