
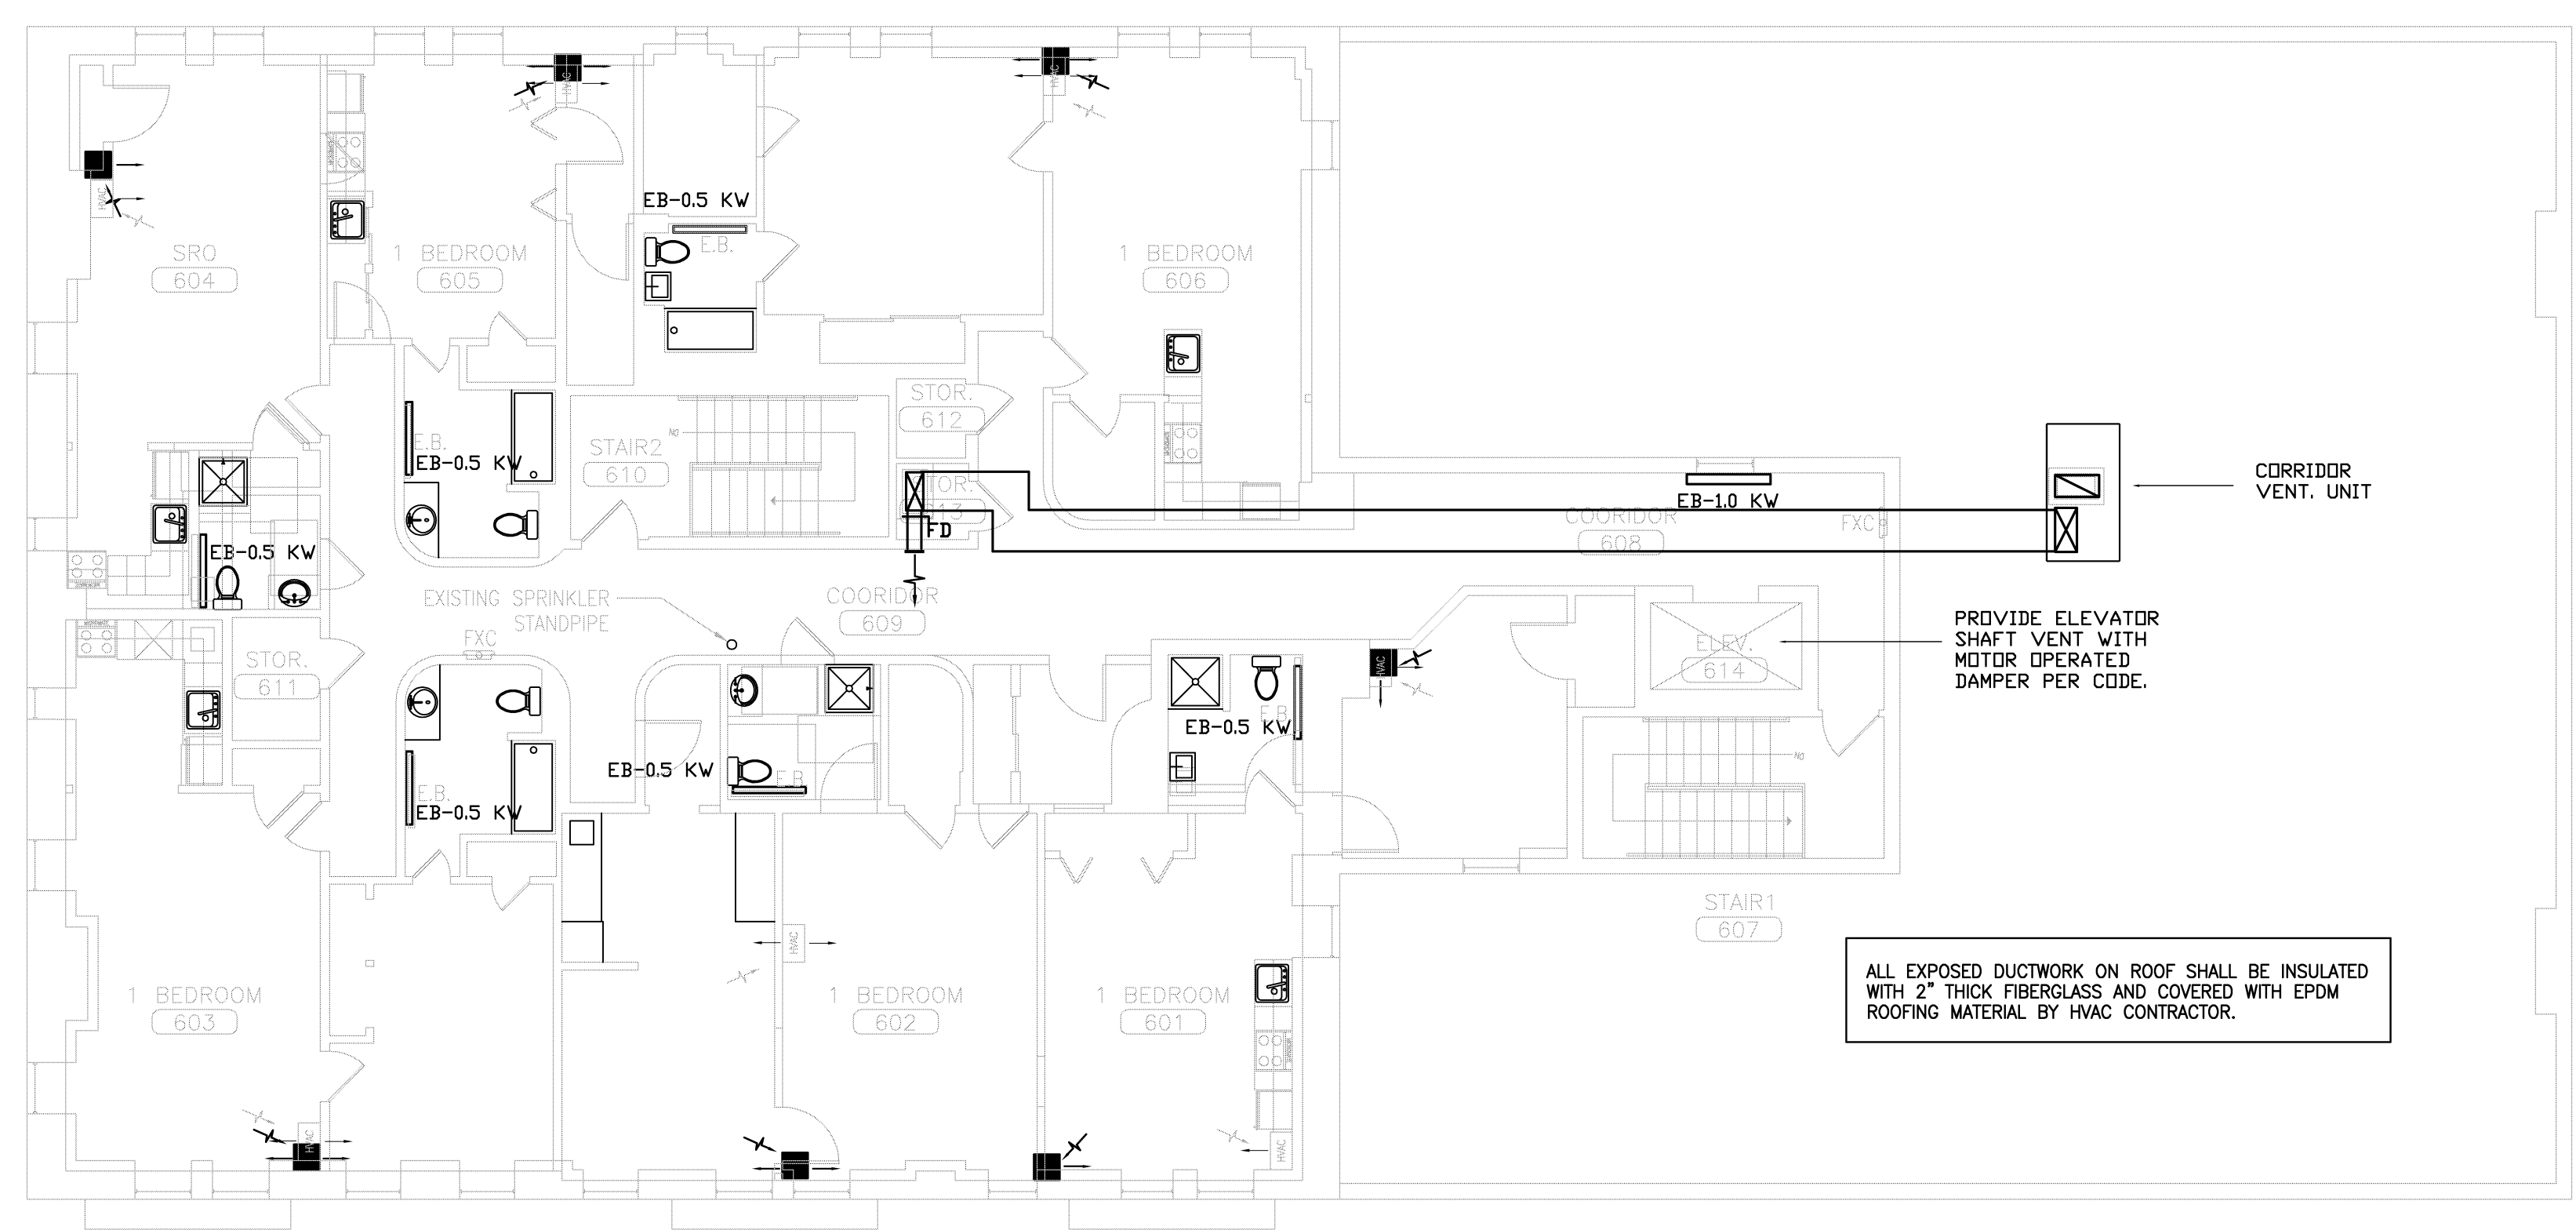


VERTICAL FAN COIL UNIT SCHEDULE							
TAG	CFM	TOT. MBH	SENS. MBH	HEATER KW	V/Ø	MANUFACTURER	UNIT SIZE
2	200	5.9	4.1	1.5	115/1	WHALEN	200
3	300	8.6	6.0	1.5	115/1	WHALEN	300
4	400	11.6	9.0	1.5	115/1	WHALEN	400
5	500	12.5	9.8	1.5	115/1	WHALEN	500
6	600	15.8	12.4	1.5	115/1	WHALEN	600

NOTE: ALL UNITS WITH DOUBLE DEFLECTION GRILLES, PRIVACY BAFFLE, FAN CYCLE CONTROLS (DO NOT PROVIDE CONTINUOUS FAN OPERATION) WITH CONTROL VALVE. SYSTEM WILL OPERATE AS TWO PIPE CHANGE OVER.
 PROVIDE WITH PERMANENT SPLIT CAPACITOR MOTORS, BUILT IN DISCONNECT SWITCH
 INSULATE ALL CHILLED WATER RISERS BETWEEN FLOORS.
 INSTALL ARMAFLEX INSULATION UNDER DRAIN PANS

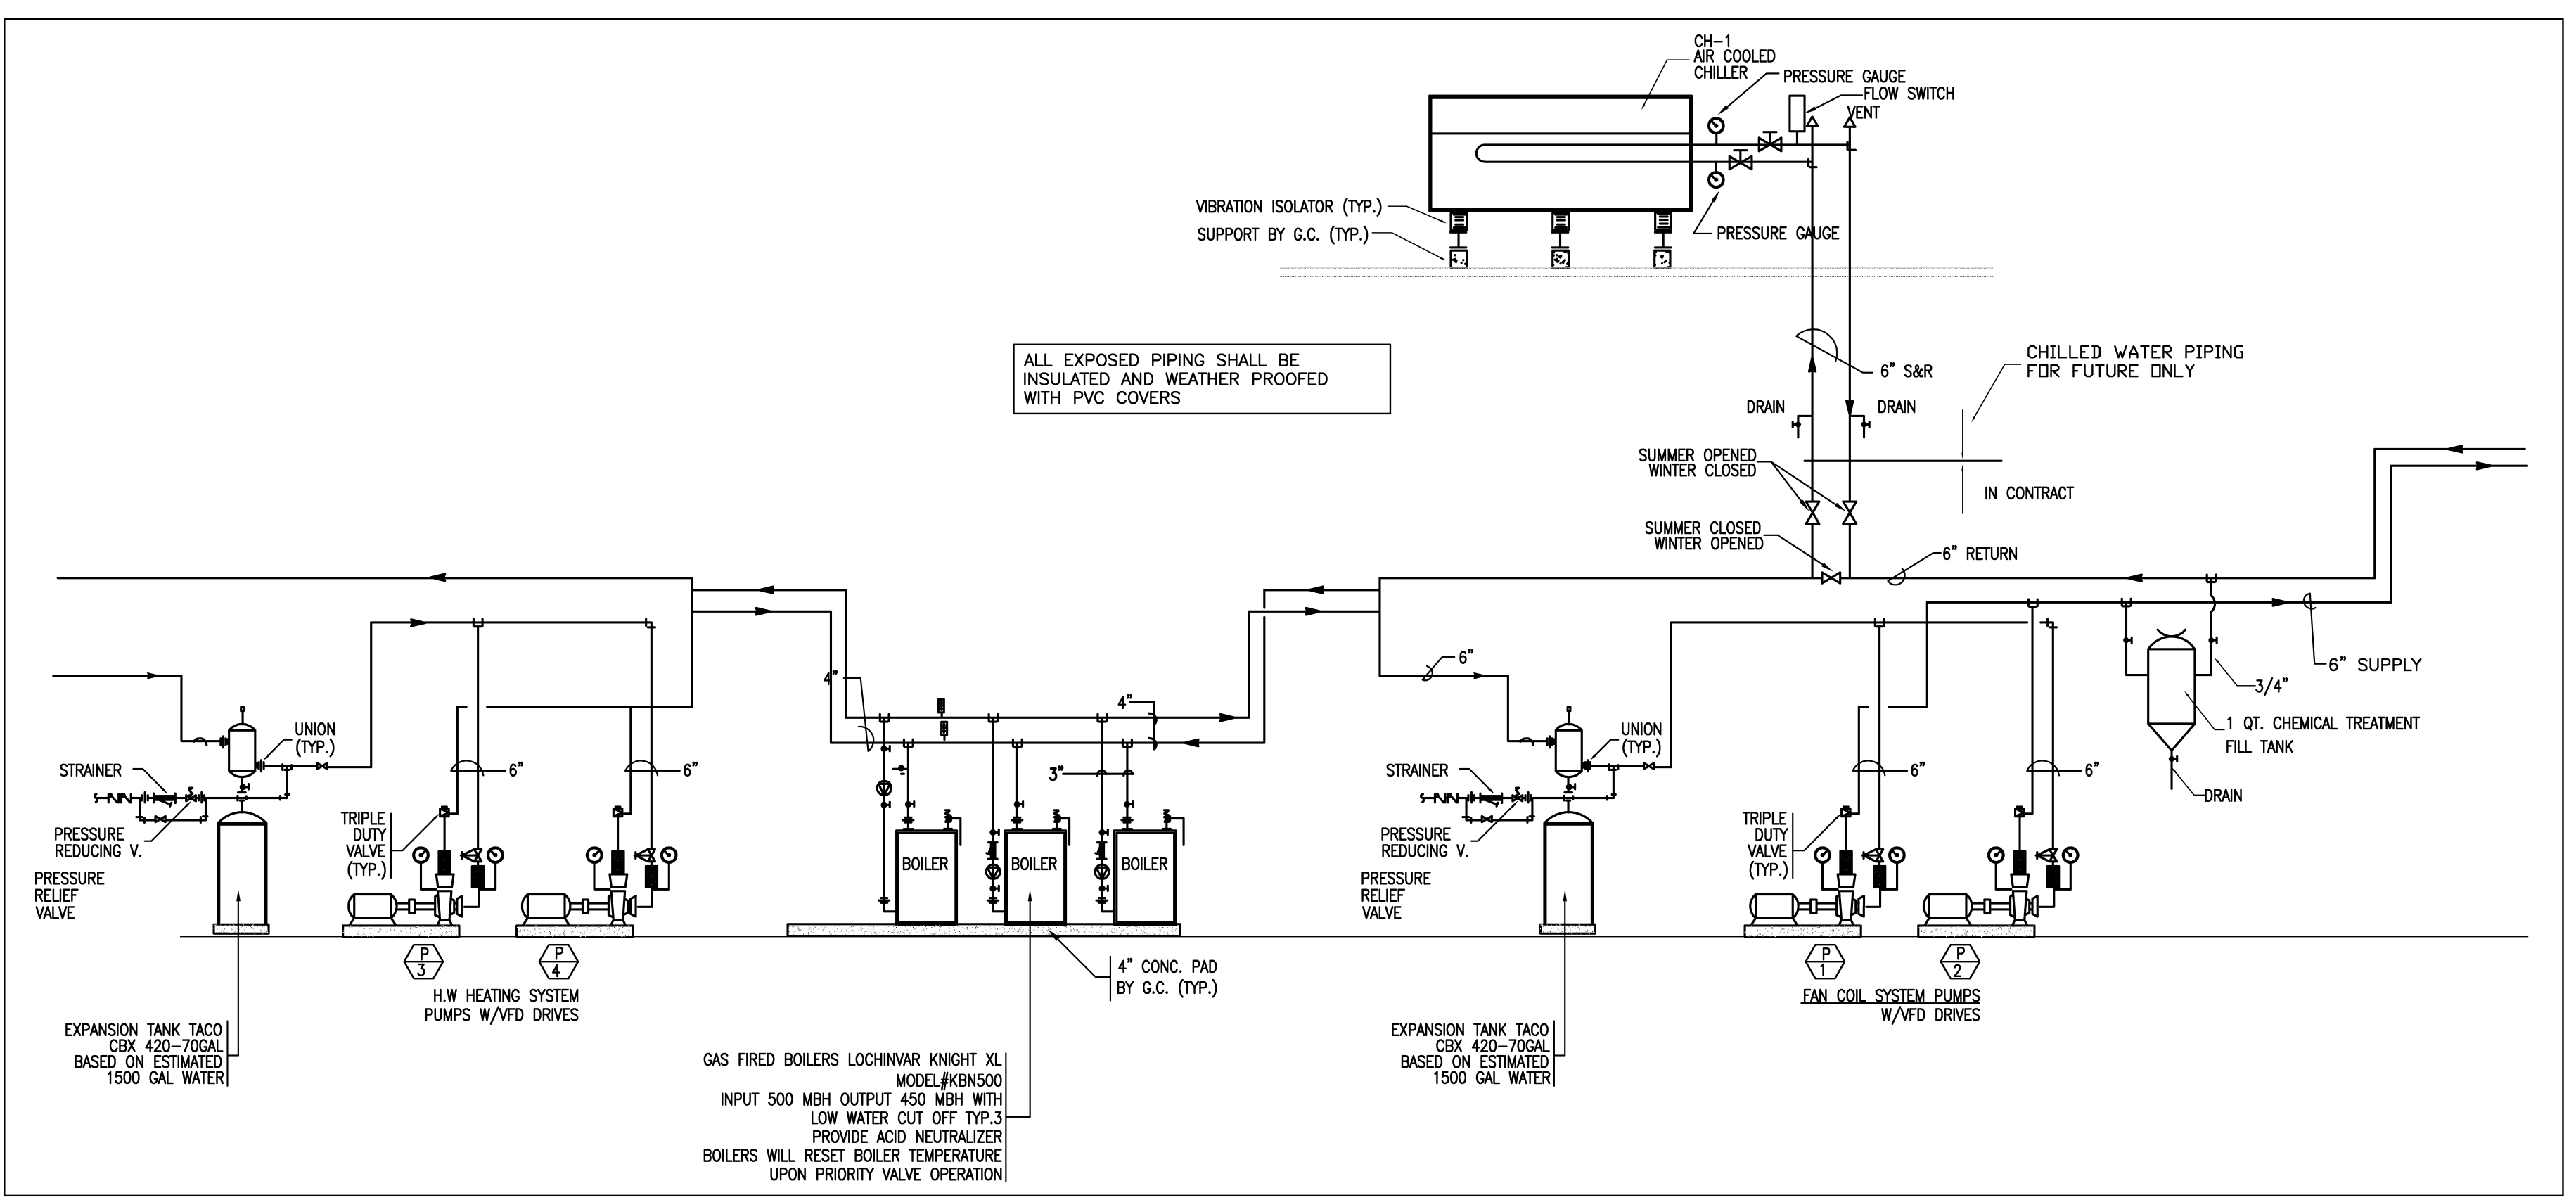

RENOVATIONS TO
 645 CONGRESS ST.
 PORTLAND, ME 04101

Project No: 08.436

Drawing Title:
SIXTH FLOOR MECHANICAL PLUMB. PLAN

Scale: AS NOTED
 Date: 5-27-09

- Revisions:
- ▲
 - ▲
 - ▲
 - ▲
 - ▲
 - ▲

Drawing Number:
MP1.6

ZADE ASSOCIATES LLC
 CONSULTING ENGINEERS
 140 BEACH STREET, BOSTON, MA 02111
 TEL. (617) 338-4406
 FAX. (617) 451-2540
 E-MAIL zadecc@aol.com

