


CITY OF PORTLAND
 FIRE PREVENTION BUREAU
 380 Congress Street, Portland, Maine 04101
 fireprevention@portlandmaine.gov
 (207) 874-8400

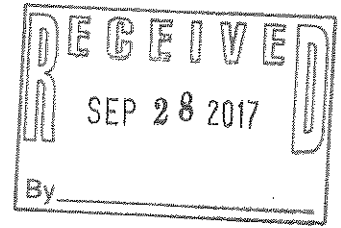

NOTICE OF VIOLATION AND ORDER TO CORRECT

September 11, 2017

Responsible Party 1: HAMPTON COURT PARTNERS LLC 100 GREYSTONE RD ROCKVILLE CENTRE, NY 11570		
Location 562 CUMBERLAND AVE	CBL 047 A002001	Inspection Date 8/15/2017
Inspector John Hardy, Iii	Inspection Type FP Routine Inspection	Status Violations Exist

The City of Portland Fire Department inspected this property, and found the fire and life safety code violations listed below, which you are hereby ordered to correct. You must propose a date of completion to remedy each violation, a final date of completion, and a date of re-inspection.

You must send this form to the Fire Prevention Bureau no later than 9/30/2017.

Your failure to submit a plan of action by the date provided, or to correct any violation within the applicable time frame, may result in legal action against you, the imposition of civil penalties, and the pursuit of other legal remedies.

Violation	Proposed Date of Completion
NFPA 101- 9.6.10.1.1 SMOKE DETECTOR REQUIRED; Where required by another section of this code, single-station and multiple-station smoke alarms shall be in accordance with NFPA 72, National Fire Alarm Code, shall be provided in all occupiable areas in environments that are suitable for proper smoke detector operation. no detector found in basement	11/15/17
NFPA 101- 7.5.1.1 AND 7.5.1.1.1 OBSTRUCTED EGRESS; Exits shall be located and exit access shall be arranged so that exits are readily accessible at all times (7.5.1.1). Where exits are not immediately accessible from an open floor area, continuous passageways, aisles, or corridors leading directly to every exit shall be maintained and shall be arranged to provide access for each occupant to not less than two exits by separate ways of travel, unless otherwise provided in 7.5.1.1.3 and 7.5.1.1.4 (7.5.1.1.1). rear stairwell needs to be cleared of items (outside of unit 2 and 3)	11/15/17
NFPA 80- ANNEX D.4 1-HOUR FIRE DOORS ASSEMBLIES REQ; Listings are provided for floor fire door assemblies that are installed in fire-rated floor-ceiling or roof-ceiling assemblies that have been tested in accordance with the methods described in NFPA 288. The listing indicates the fire-rated assembly and the hourly rating (3 hours, 2 hours, 1.5 hours, 1 hour, .75 hours) for which the door can be permitted to be used so that access to the space above the ceiling or to the floor above can be provided without adversely affecting the fire resistance rating of the entire assembly. The listing provides limitations on the maximum size of an individual door opening and the total area of all door openings permitted for each 100 square feet of floor or ceiling. required leading form basement to rear stairwell	11/15/17

Violation	Proposed Date of Completion
FINAL DATE OF COMPLETED VIOLATION(S)	11 / 15 / 17
FIRE PREVENTION BUREAU RE-INSPECTION OF COMPLETED VIOLATION(S)	12 / 1 / 17

The Bureau reserves the right to reject or modify any proposed plan of action, and may require evidence of sufficient financial and technical capacity to complete the proposed plan. Please contact the Bureau with any questions.


VIOLATOR CERTIFICATION

I agree to remedy the violations listed within the timeframes provided. If I require additional time to comply, I understand that I must contact the Fire Prevention Bureau prior to the deadline to request an extension, which is entirely within the Bureau's discretion to grant or deny.

I further understand that it is my responsibility to schedule a reinspection of my property once the violations have been remedied to do so. My failure to schedule a reinspection shall be deemed an admission that the violations have not been remedied.

If I fail to comply with this agreement, I understand that I am liable for penalties pursuant to the City of Portland Code of Ordinances §§ 1-15 and 10-25, and 30-A M.R.S. § 4452 and may be subject to further legal action.

Date 9/25/17

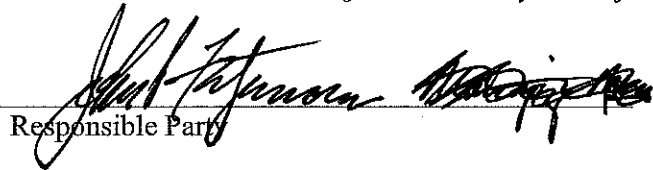
Responsible Party

Date _____

Responsible Party _____

SEEN AND AGREED

Date 9/28/17


Fire Prevention Bureau