

LEGEND

- PS PULL STATION
- S SMOKE DETECTOR
- H HEAT DETECTOR (CONVENTIONAL IF THROUGH MONITOR MODULE)
- CO CARBON MONOXIDE DETECTOR
- NMM 100 MONITOR MODULE (100P NOTES MINI-MODULE)
- S XX STROBE "XX" NOTES CANDELA
- HS XX HORN/STROBE "XX" NOTES CANDELA

WIRING LEGEND

- A 2 COND 16 AWG TWISTED PAIR FPL CABLE
- B 2 COND 14 AWG FPL CABLE
- C 2 COND 18 AWG FPL CABLE
- D CAT-5 CABLE

DEVICE ADDRESSES:

IMPORTANT! DUPLICATE ADDRESSES BETWEEN DEVICES AND MODULES ARE NOT AN ERROR. EACH DEVICE MUST BE LABELED WITH THE LOOP AND SLC ADDRESS. DEVICE EXAMPLE: L1D001 MODULE EXAMPLE: L1M001 NOTE: PULL STATIONS ARE IDENTIFIED AS MODULES BY THE FIRE ALARM CONTROL PANEL.

INSTALLATION NOTES:

FIELD WIRING SHALL BE INSTALLED FOLLOWING THE CURRENT EDITION OF NFPA 70: NATIONAL ELECTRIC CODE(2014), ALL APPLICABLE MUNICIPAL, COUNTY, & STATE CODES, REQUIREMENTS, AND REGULATIONS, AS WELL AS ALL MANUFACTURER GUIDELINES FOR INSTALLATION. CONTROL PANELS, DEVICES, AND ALL OTHER SYSTEM COMPONENTS SHALL BE INSTALLED FOLLOWING THE CURRENT EDITION OF NFPA 72: NATIONAL FIRE ALARM AND SIGNALING CODE(2013), ALL APPLICABLE MUNICIPAL, COUNTY, & STATE CODES, REQUIREMENTS, AND REGULATIONS, AS WELL AS ALL MANUFACTURER GUIDELINES FOR INSTALLATION. THE INSTALLER SHALL FOLLOW CORRECT CONDUCTOR POLARITY, INDICATED CIRCUIT DIVISIONS, PROPER GROUNDING AND SHIELDING WITHOUT EXCEPTION. IMPROPER INSTALLATION CAN RESULT IN INTERFERENCE, TRANSIENT VOLTAGE, OR SHORT CIRCUITS CAUSING UNDESIRABLE OPERATION OR DAMAGE TO THE CONTROL PANEL, DEVICES AND ANY OTHER INTEGRATED COMPONENTS. THE GAUGE OF WIRE USED FOR THE SLC LOOP (IDENTIFIED AS 'A' ON THIS PRINT), SHALL BE DETERMINED BY THE INSTALLER FOLLOWING GUIDELINES AND LIMITATIONS SET FORTH BY THE MANUFACTURER(NOTIFIER DOCUMENT #51253, INTELLIGENT CONTROL PANEL SLC WIRING MANUAL). THE SLC WIRING RISER IS SHOWN DIAGRAMMATICALLY ONLY TO ALLOW FOR VARIANCES IN ACTUAL WIRE DISTANCE, DEVICE PLACEMENT AND STRUCTURAL OR ENVIRONMENTAL REQUIREMENTS. ANY T-TAPPING OF SLC WIRING SHALL FOLLOW ALL REQUIREMENTS IN NOTIFIER DOCUMENT #51253, INTELLIGENT CONTROL PANEL SLC WIRING MANUAL. WIRE FOR THE NOTIFICATION APPLIANCE CIRCUITS (IDENTIFIED AS 'B' ON THIS PRINT), SHALL FOLLOW THE SPECIFIC REQUIREMENTS OF THE WIRING LEGEND. THIS WAS DETERMINED BY THE AVAILABLE DIMENSIONED OR SCALED FLOOR PLAN DEVICE LAYOUT. PLEASE REFERENCE THE VOLTAGE DROP CALCULATIONS LOCATED ON SHEET FA-2 FOR DISTANCE LIMITATIONS. THE INDICATED DISTANCES IN THE VOLTAGE DROP CALCULATIONS FOR EACH CIRCUIT SHALL BE CONSIDERED THE MAXIMUM LENGTH. ANY DISTANCES EXCEEDING THOSE IN THE VOLTAGE DROP CALCULATIONS MUST BE BROUGHT TO THE ATTENTION OF NORRIS INC. TO ASSURE PROPER FUNCTIONALITY AND COMPLIANCE OF THE NOTIFICATION APPLIANCE CIRCUITS. THIS SYSTEM MEETS NFPA REQUIREMENTS FOR OPERATION AT 32-120°F AND A RELATIVE HUMIDITY OF 91-95% AT 87-93°F. HOWEVER, THE USEFUL LIFE OF THE SYSTEM'S STANDBY BATTERIES AND THE ELECTRONIC COMPONENTS MAY BE ADVERSELY AFFECTED BY EXTREME TEMPERATURE RANGES AND HUMIDITY. THEREFORE, IT IS RECOMMENDED THAT THIS SYSTEM AND ITS PERIPHERALS BE INSTALLED IN AN ENVIRONMENT WITH A NORMAL ROOM TEMPERATURE OF 60-80°F. END OF LINE DEVICES MUST BE INSTALLED IN AN EASILY ACCESSIBLE LOCATION AND CLEARLY MARKED OR LABELED.

DESIGN NOTES:

SYSTEM DESIGN PERFORMANCE AND COMPLIANCE WITH ALL APPLICABLE CODES AND REQUIREMENTS IS THE RESPONSIBILITY OF THE DESIGNING ENGINEER. PROPER INSTALLATION OF THIS SYSTEM AND ITS COMPONENTS IS THE RESPONSIBILITY OF THE INSTALLING CONTRACTOR. ANY ALTERATIONS, CHANGES, OR DEFICIENCIES MUST BE BROUGHT TO THE ATTENTION OF THE DESIGNING ENGINEER. NORRIS INC. ASSUMES NO RESPONSIBILITY FOR ERRORS IN SYSTEM DESIGN OR INSTALLATION, AS WELL AS ANY COSTS ASSOCIATED WITH CORRECTING THESE ERRORS, IF ANY EXIST, UNLESS SYSTEM DESIGN OR INSTALLATION WAS PERFORMED BY NORRIS INC.

NOTIFICATION APPLIANCE CIRCUIT VOLTAGE DROPS

556 Cumberland Avenue
Portland, Maine

PANEL	CIRCUIT	WIRE GAUGE	LENGTH	CURRENT DRAW	VOLTAGE DROP	VOLTAGE LOSS	END VOLTAGE	CIRCUIT LOAD
FACP	NAC 1	14	110 FT	.400A	0.21VDC	0.88%	23.79VDC	16%
FACP	NAC 2	14	105 FT	.224A	0.12VDC	0.50%	23.88VDC	9%
FACP	NAC 3	14	120 FT	.224A	0.14VDC	0.58%	23.86VDC	9%
FACP	NAC 4	14	135 FT	.224A	0.15VDC	0.63%	23.85VDC	9%

Calculated @ Maximum Distance/Current

REVISION 0 SUBMITTAL DATE: 01/06/2016


FIRE ALARM SYSTEM WIRING RISER

PROJECT NAME
556 CUMBERLAND AVE
PORTLAND, MAINE 04101

BY: JRS
CK: DG
SCALE: NONE
SHEET: FA-1

NORRIS INC
Prepared For Tomorrow, Delivered Today
2257 BROADWAY, SOUTH PORTLAND, MAINE

Coordinate terminations with telephone representative. Must be completed before fire alarm service visit for final certification.

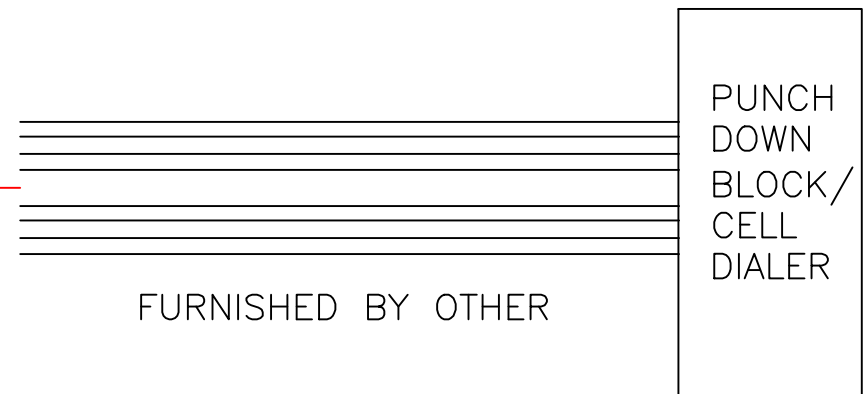

120VAC FROM DEDICATED LOCKING CIRCUIT