

FOOTING SCHEDULE		
MARK	SIZE	REINFORCING
F1	3'-3" x 3'-3" x 1'-2"	4 #5 E.N. BOT.
F2	4'-0" x 4'-0" x 1'-2"	6 #5 E.N. BOT.

FOUNDATION PLAN
 1/4"=1'-0"

TOP OF CONCRETE WALL ELEV = 120.51'
 TOP OF INTERIOR SLAB SHELF, PIER AND DOOR BONDOUTS = 120.01'



SLAB IS 4" THICK FIBER-REINFORCED CONCRETE OVERLAYING A VAPOR BARRIER ON COMPACTED INORGANIC FILL.

..... INDICATES SAW-CUT CONTROL JOINT.

ALL HARDWARE IN CONTACT WITH PRESSURE TREATED WOOD SHALL BE HOT DIPPED GALVANIZED.

ASSUMED DESIGN PARAMETERS:
 ALLOWABLE BEARING CAPACITY 4500 PSF
 SEISMIC SITE CLASS C

ASSUMED DESIGN PARAMETERS AND ADDITIONAL INFORMATION REGARDING SUBSURFACE CONDITIONS, CONSTRUCTION CONSIDERATIONS AND RECOMMENDATIONS ARE TO BE CONFIRMED BY SOIL METRICS LLC. AFTER DEMOLITION OF EXISTING BUILDING.

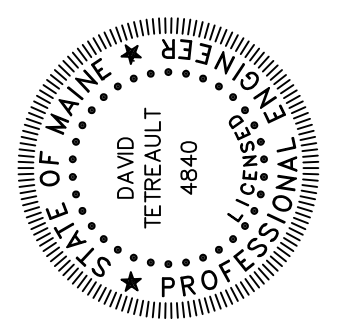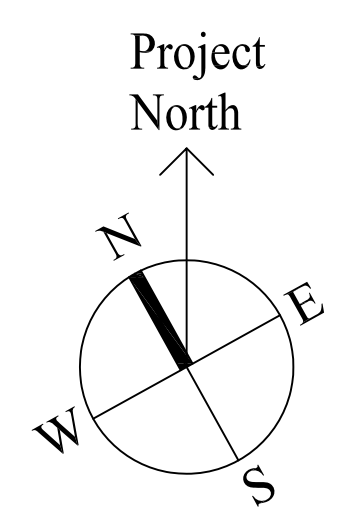

Prepared For:
RANDOM ORBIT, LLC
 17 Chestnut St
 Portland, ME

Consulting Engineer:
STRUCTURAL DESIGN CONSULTING
 22 Calhoun Circle
 Old Orchard Beach, ME
 Tel: 207.934.8038
 Fax: 207.934.8039

Architect:
ARCHETYPE architects
 48 Union Wharf Portland, Maine 04101
 (207) 772-6022 Fax (207) 772-4056

Project:
PELOTON BUILDING
 BRAMHALL SQUARE
 PORTLAND, ME

Revisions:

Scale: 1/4" = 1'-0"

Date:

S1.01