


FireFinder XLS and FS-250 Panels

HTRI Series Interface Modules

Models HTRI-D, HTRI-R and HTRI-S

ARCHITECT AND ENGINEER SPECIFICATIONS

- Interfacing and supervising normally open (NO) or normally closed (NC) contacts
- Integral SPDT relay on Model HTRI-R (up to 4 amps)
- Dual input on Model HTRI-D, using a single address
- Polarity insensitive with *SureWire™* technology
- Multi-color light-emitting diode (LED) indicates status [green / amber / red]
- Easy front access to programming port and wiring terminals
- Mounts 4-inch square, 2-1/4"-deep box (or double-gang box)
- Dynamic supervision
- Comes with 5-x-5" faceplate
- Two-wire operation
- Model DPU programs and verifies address of the device and tests for proper functionality
- Electronic address programming is easy and dependable
- UL Listed & ULC Listed; FM, CSFM and NYMEA Approved

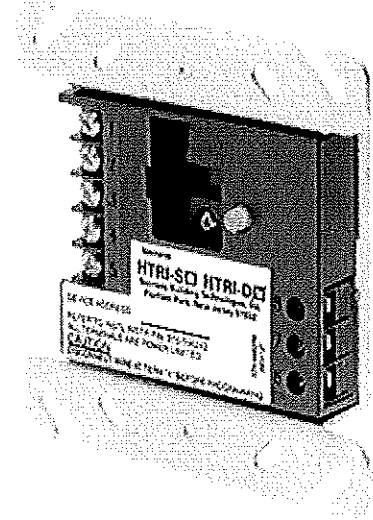

Product Overview

The Siemens Industry, Inc. — Fire Safety HTRI Series Intelligent interface modules are designed to provide the means of interfacing direct shorting devices to the FireFinder XLS and FS-250 Fire Alarm Control Panel loop circuit.

The HTRI Series modules provide the most advanced method of address programming and supervision on the market — combined with sophisticated control panel communication. Each HTRI Series interface module incorporates a microcomputer chip. The HTRI Series microcomputer chip technology and its sophisticated bi-directional communication capabilities with the control panel, achieve the state of an 'intelligent device.'

Specifications

The HTRI Series intelligent interface modules are available in three (3) models. Models HTRI-S and HTRI-R are designed to monitor a (NO) or (NC) dry contact.

The interface module reports the status of the (NO) or (NC) contact to the control panel. Model HTRI-S can only monitor and report the status of the contact, while Model HTRI-R incorporates an addressable Form C relay.

The Model HTRI-R relay and contact device input are controlled at the same address. For the control panel system, the relay and input contact can be controlled as a separate function. The relay is typically used where control or shunting of external equipment is required.

The Model HTRI-D is a dual-input module that is designed to supervise and monitor two (2) sets of dry contacts. Model HTRI-D only requires one (1) address, but responds independently to each input. Model HTRI-D is ideal for monitoring a water-flow switch and its respective valve tamper switch.

Model HTRI has a multi-color LED that flashes 'green' when operating in *normal*; 'amber' if unit is in *trouble* condition, and 'red' to indicate a change of state.

Specifications (continued)

Model HTRI-D flashes twice — once for each address, and Model HTRI-R LED indicates a change of state in the relay. The device's microcomputer chip has the capacity of storing, in memory, identification information; as well as important operating-status information.

Siemens Industry, Inc., — Fire Safety innovative technology allows all HTRI Series intelligent interface modules to be programmed by using the Device Programming / Test Unit. Model DPU is a compact, portable and menu-driven accessory that makes programming and testing an interface device faster, easier and more dependable than previous methods.

Model DPU eliminates the need for mechanical addressing mechanisms, such as: program jumpers, DIP switches or rotary dials, since Model DPU electronically sets the HTRI Series interface address into the interface microcomputer-chip non-volatile memory. Vibration, corrosion and other conditions that deteriorate mechanical addressing mechanisms are no longer a cause for concern.

The HTRI Series is fitted with screw terminals for connection to an addressable circuit. The HTRI Series is fully compatible on the same FireFinder XLS and FS-250 circuits with all intelligent H-Series detectors, HMS Series addressable manual stations, or any other addressable intelligent modules, such as Model HZM or Model HCP.

All HTRI Series intelligent interface modules are ©UL listed. Environmental operating conditions for all HTRI Series modules are 32°F (°C) to 120°F (49°C) with a relative humidity of no greater than 93%, non-condensing.

Electrical Ratings

Current Draw
(Active or Standby) 1mA

Model HTRI-R Relay Ratings


Resistive: 4 Amps, 125 VAC
4 Amps, 30 VDC

Inductive: 3.5A, 120 VAC (0.6P.F.)
3.0A, 30 VDC (0.6P.F.)
2.0A, 120 VAC (0.4P.F.)
2.0A, 120 VAC (0.35P.F.)
2.0A, 30 VDC (0.35P.F.)

Notice: This marketing catalog sheet is not intended to be used for system design or installation purposes. For the most up-to-date information, refer to each product's installation instructions.

Mounting Diagram

Models HTRI-S, HTRI-D and HTRI-R mount directly into a 4-inch square, 2 ¼-inch deep box or a double-gang box (user supplied). A 5-inch square, off-white faceplate is included with each HTRI Series module.

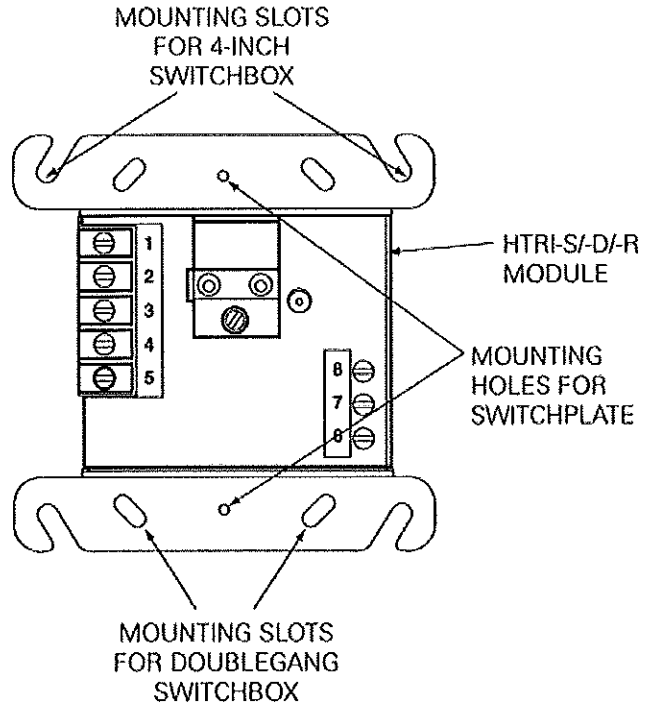

Details for Ordering

Model Number	Part Number	Description	Shipping Wgt.	
			Lb.	Kg.
HTRI-S	500-033370	Single Input	7 oz.	2
HTRI-R	500-033300	Single Input w/Relay	7 oz.	2
HTRI-D	500-033360	Dual Input	7 oz.	2

SIEMENS Industry, Inc.
Building Technologies Division

Fire Safety
8 Fernwood Road
Florham Park, NJ 07932
Tel: (973) 593-2600
FAX: (908) 547-6877
URL: www.SBT.Siemens.com/FIS

(S1)
Printed in U.S.A.

Fire Safety
2 Kenview Boulevard
Brampton, Ontario
L6T 5E4 / Canada
Tel: (905) 799-9937
FAX: (905) 799-9858

June 2010
Supersedes sheet dated 12/04
(Rev. 1)

SIEMENS

Installation Instructions

Model HTRI-M

Addressable Interface Module

The **SIEMENS** Model HTRI-M Series Addressable interface module interfaces direct shorting devices to the DLC loop of the FireFinder-XLS System or the FS-DLC loop of the FS-250 System. It is also approved for 1076, Proprietary Burglary.

The HTRI-M can monitor a normally open or closed dry contact and it can report the status of the contact.

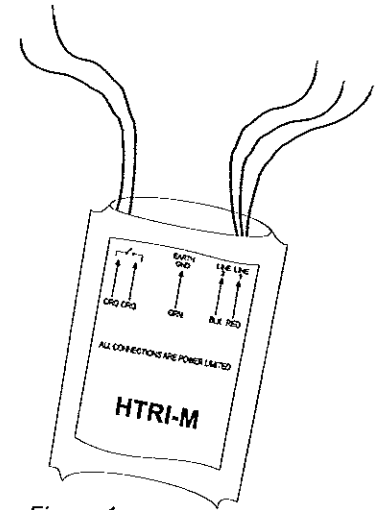


Figure 1
HTRI-M Module

PROGRAMMING

Refer to Figure 1 to locate the red and black DLC/FS-DLC loop circuit wires of the HTRI-M.

Connect the Addressable Loop Driver circuit wires of the HTRI-M to the **SIEMENS** Model DPU Programmer/Tester. Use the cable provided with the Programmer/Tester and the 2 alligator clip to banana plug adapters provided.



To Prevent Damage To The DPU:


DO NOT connect a HTRI-M to the DPU until all field wiring is removed from the red and black DLC/FS-DLC loop circuit wires of the HTRI-M.



Connection from the DPU to the HTRI-M is not polarity sensitive. Refer to Figure 3 for the proper connections to the control panel.

(Refer to Figure 2.) Follow the instructions in the **DPU Programmer/Tester Manual** (P/N 315-033260) to program the desired address into HTRI-M.

Record the device address on the label located on the HTRI-M. The HTRI-M can now be installed and wired to the system.

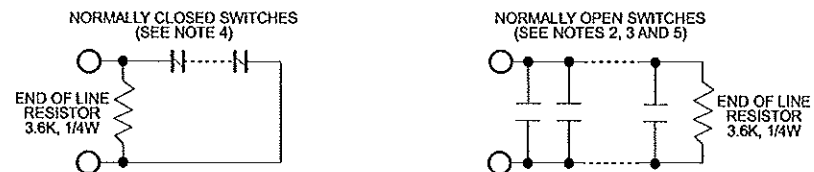

NOTES:

1. There can be any number of normally closed or normally open switches.
2. The end of line resistor must be located at the last switch.
3. Do not wire a normally closed switch across the end of line resistor.
4. Only for use with security and status applications.
5. Do not use N.O. switches for security applications.

Figure 2
Wiring Switches

Siemens Building Technologies
Fire Safety

WIRING

(Refer to Figure 3.) Refer to the wiring diagram and wire the addressable interface module accordingly.



Recommended wire size: 18 AWG minimum
14 AWG maximum

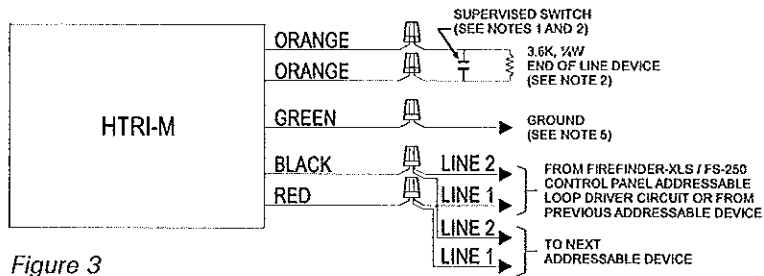


Figure 3
Installing the HTRI-M Wiring

NOTES:

1. All supervised switches must be held closed and/or open for at least a quarter of a second to guarantee detection.
2. End of line device: 3.6K, 1/4W resistor, P/N 140-820185. For Canadian applications, use Model EL-33 with 3.6K, 1/4W resistor.
3. HTRI-M is polarity insensitive. Line 1 and Line 2 can be either line of the loop.
4. The supervised switches have the following ratings:
 - Voltage maximum: 27 VDC
 - Current maximum: 3.5mA during polling
 - Contact resistance maximum: 10 ohms
 - Maximum cable length: 200 feet (18 AWG)

$C_{\text{Line to line}}: 0.02\mu\text{F}$ $C_{\text{Line to shield}}: 0.04\mu\text{F}$
Max line size: 14 AWG Min line size: 18 AWG



Ground shield ONLY at the specified location on the Control Panel.

5. The green wire must be connected to earth ground.
 - a. Use wire nuts to pass the shield wire through the electrical box with **NO** connection to the device green wire.
 - b. Use shielded wire to connect the switch wiring.
 - c. Tie the switch wiring shield to earth ground.
6. For proprietary burglary application:
 - a. Use a TSW-1/2 tamper switch to monitor the main enclosure.
 - b. Monitor each HTRI-M related to this application continuously by using a listed motion detector (to prevent tampering).
7. In supervisory: HTRI-M draws 1.5mA
8. All circuits are power limited.

MOUNTING

The SIEMENS Model HTRI-M mounts directly into a single gang switchbox (user supplied)

Connect the appropriate wires using wire nuts. Tuck the HTRI-M module inside the electrical box and dress the wiring as required. (See Figure 4.)

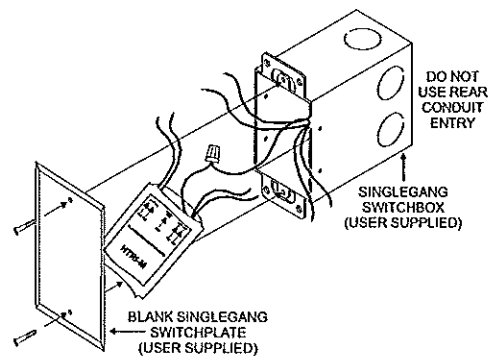


Figure 4
Mounting the HTRI-M