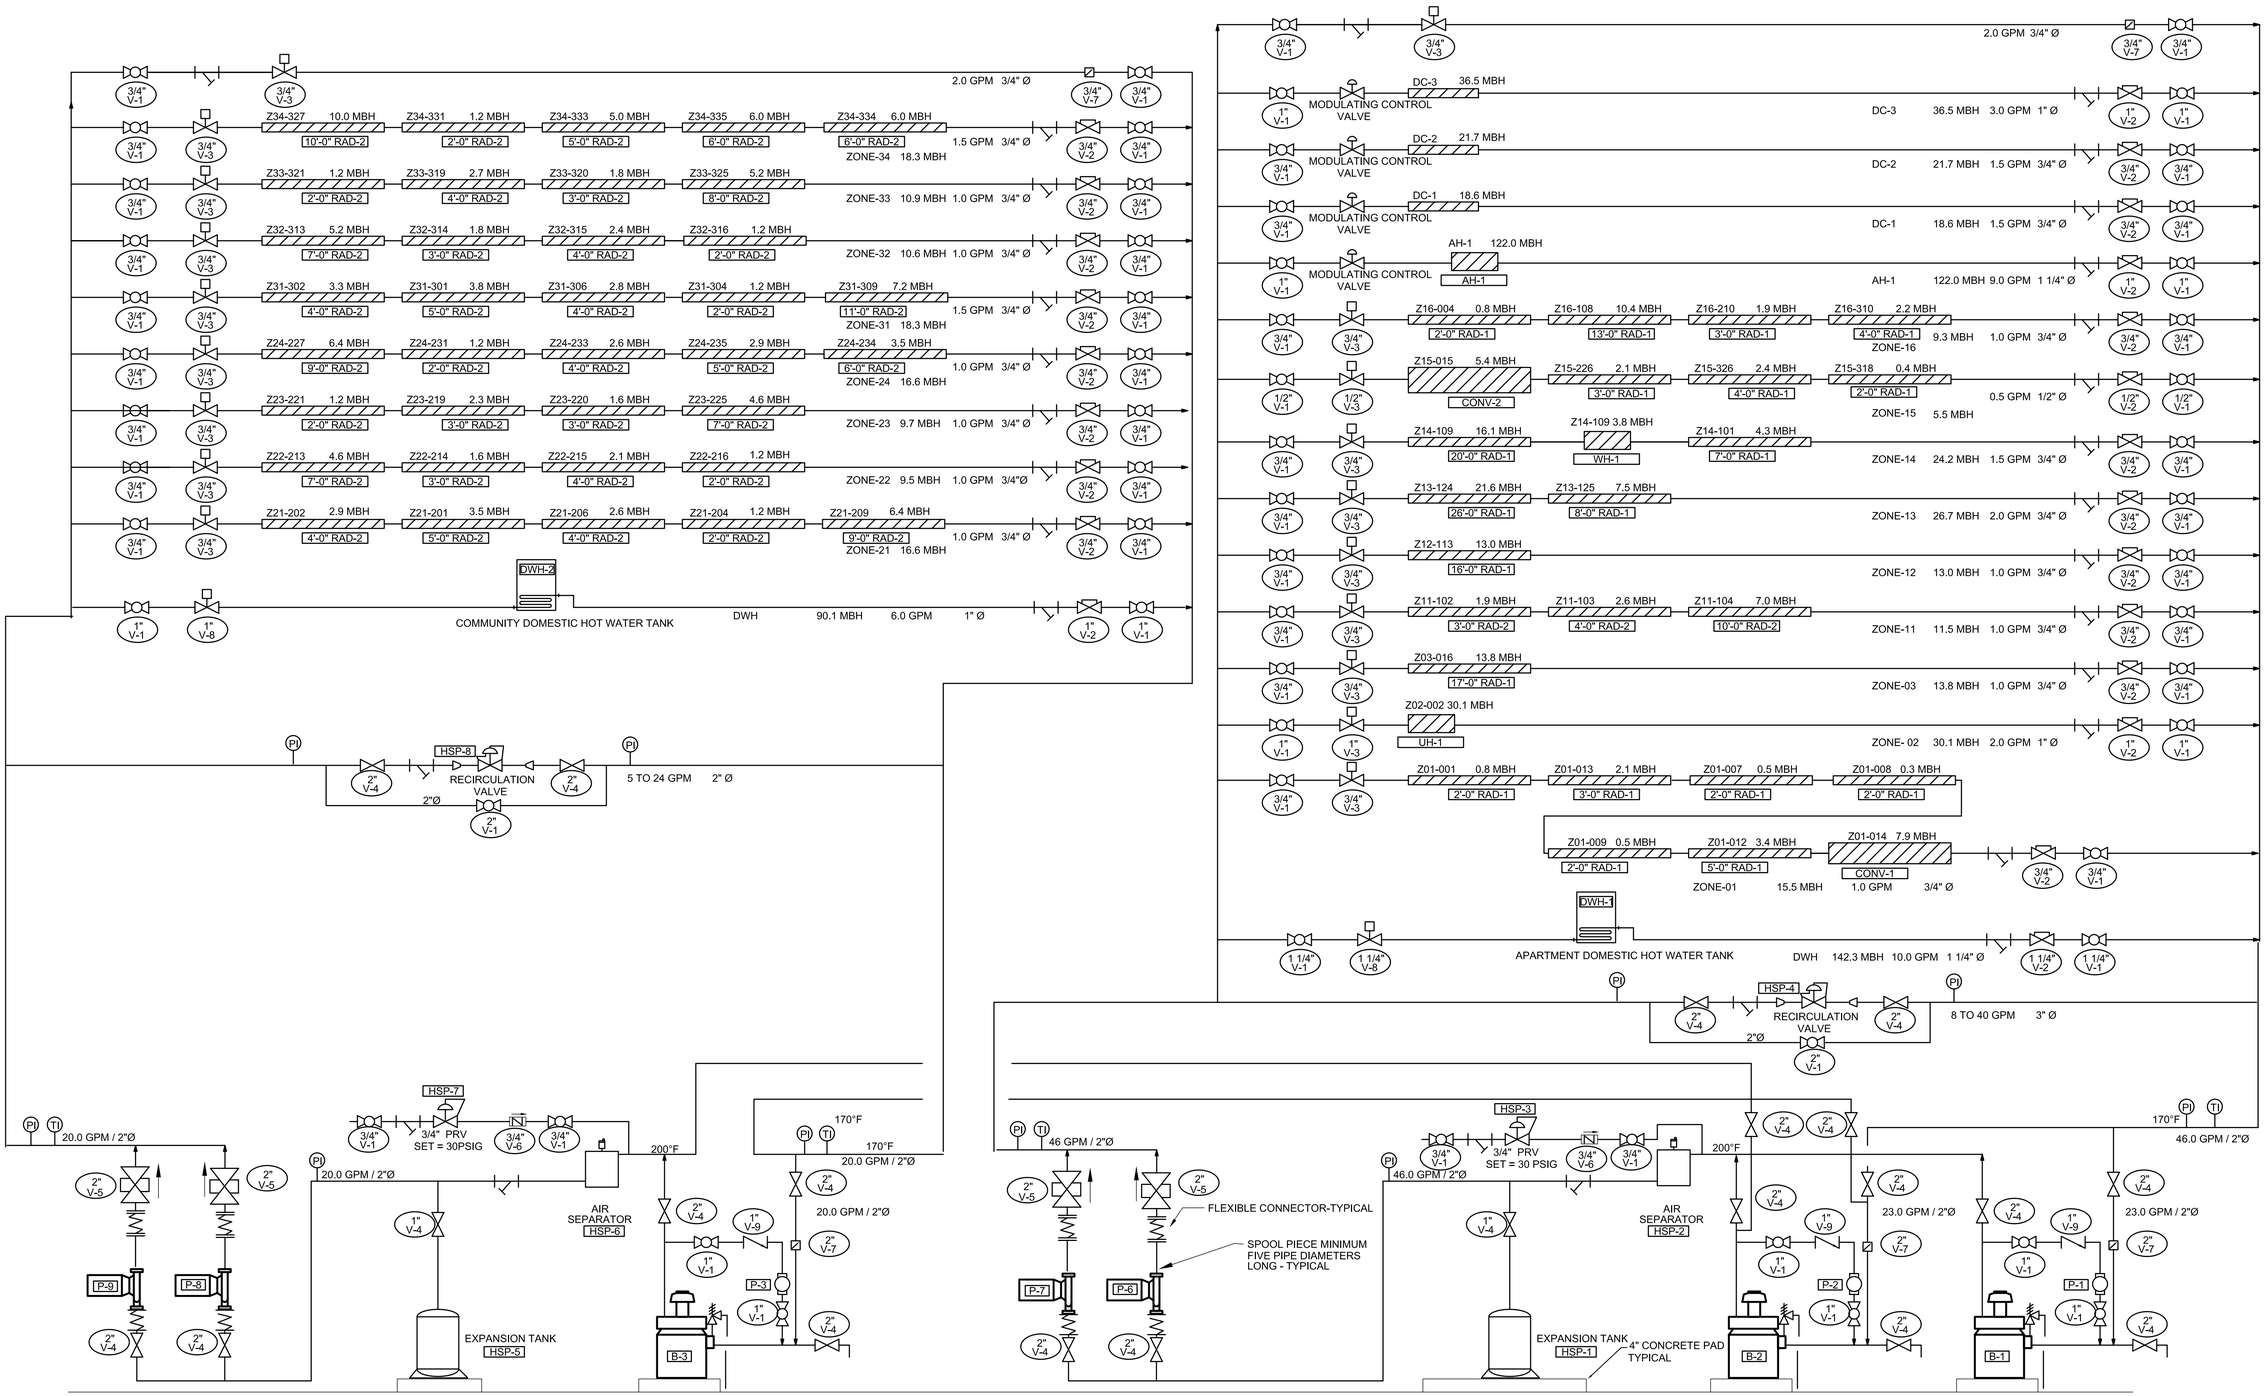

NOTES:

ACTUAL SEQUENCE OF TAKE-OFFS AND RETURNS TO HEADERS IS DIFFERENT THAN INDICATED ON THIS DIAGRAM

FLOW RATES ARE FOR 30°F TEMPERATURE DIFFERENTIAL WITH 185°F AVERAGE TEMPERATURE.

RADIATOR LENGTH INDICATES TOTAL LENGTH REQUIRED FOR PROPER HEATING. LENGTH MAY NEED TO BE INSTALLED IN SHORTER SEGMENTS DUE TO WALL CONFIGURATION.

STATE OF MAINE
RICHARD P. WHITNEY
No. 4844
REGISTERED PROFESSIONAL ENGINEER

© CRY TFH ARCHITECTS

PROP

GRANT & MELLEN SREET
PARKSIDE NEIGHBORHOOD CENTER & AFFORDABLE HOUSING
PEOPLE'S REGIONAL OPPORTUNITY PROGRAM
PORTLAND, MAINE

TFH ARCHITECTS
100 COMMERCIAL STREET
PORTLAND MAINE 04101
TELEPHONE 207 775 6141
ARCHITECTURE PLANNING

CONSULTANTS:

CIVIL:
Pinkham & Greer
170 US Route One
Falmouth, ME 04105
207-781-5242

STRUCTURAL:
Structural Design Consulting
Five Balsam Lane
Falmouth, ME 04105-2445
207-878-8038

MECHANICAL:
Whitney Engineering
10 Danforth Place
Portland, ME 04102
207-833-2921

ELECTRICAL:
Bennett Engineering
7 Bennett Road
Freeport, ME 04032
207-865-9475

REVISIONS:

REV.	DATE	DESCRIPTION
-	-	-
-	-	-
-	-	-
-	-	-
-	-	-

DATE:	01/29/04
PROJECT No.	PNO
DRAWN BY:	AWH
CHECKED BY:	RPW
SCALE:	NONE

SHEET TITLE:
FLOW DIAGRAM
HYDRONIC HEAT SYSTEM

BUILDING A

HVAC2.1

T:\00_TFH Projects\PROP\0114_Mellen Grant\Semd-Review\Received\Whitney\021004 bid docs\100%\HVAC 1.dwg, Model, 3/1/2004 9:53:25 AM