


- GENERAL NOTES**
- A.) FIRE ALARM SYSTEM WIRING SHALL COMPLY WITH THE NATIONAL ELECTRIC CODE, APPLICABLE STATE AND LOCAL CODES AND SHALL BE COORDINATED WITH THE LOCAL AUTHORITY HAVING JURISDICTION.
 - B.) CAUTION; DO NOT CONNECT ANY POWER TO THE CONTROL PANEL (BATTERIES OR 120VAC) UNTIL ALL FIELD WIRING HAS BEEN TESTED.
 - C.) DO NOT INSTALL FIRE ALARM CONTROL PANEL OR ANY ADDRESSABLE DEVICES IN UNHEATED SPACE.
 - D.) DO NOT INSTALL ANY AC CURRENT CARRYING CONDUCTORS CLOSE TO OR IN THE SAME RACEWAY WITH FIRE ALARM SYSTEM CONDUCTORS.
 - E.) SOLID LINES REPRESENT CONNECTIONS MADE BY THE SYSTEM INSTALLER.
 - F.) ALL RELAYS ARE SHOWN IN NORMAL SUPERVISORY CONDITION. ALL RELAYS ARE FORM "C" TYPE.

- INSTALLATION NOTES**
- A.) SMOKE DETECTORS SHALL NOT BE MOUNTED ANY CLOSER THAN 3' FROM ANY AIR DUCT OPENINGS.
 - B.) ELEVATOR LOBBY SMOKE SHALL BE MOUNTED WITHIN 10' OF THE ELEVATOR DOOR.
 - C.) MANUAL PULL STATIONS SHALL BE MOUNTED PER ADA REQUIREMENTS: 48" AFF OR 42" AFF TO COMPLY WITH SIDE/FRONT REACH REQUIREMENTS.
 - D.) WALL MOUNTED HORN STROBES AND STROBES SHALL BE MOUNTED 6" FROM CEILING, OR 96" TO 80" AFF TO THE CENTER OF THE STROBE.
 - E.) HORN STROBES AND STROBES SHALL BE MOUNTED 15" FROM THE CORNER OF THE WALL. IF THIS IS NOT POSSIBLE, DEVICE SHALL BE CENTERED ON THAT WALL.
 - F.) CEILING MOUNTED HALLWAY DEVICES SHALL BE LOCATED IN A SYMMETRICAL MANNER DOWN THE CENTER OF THE HALLWAY WHEN POSSIBLE.

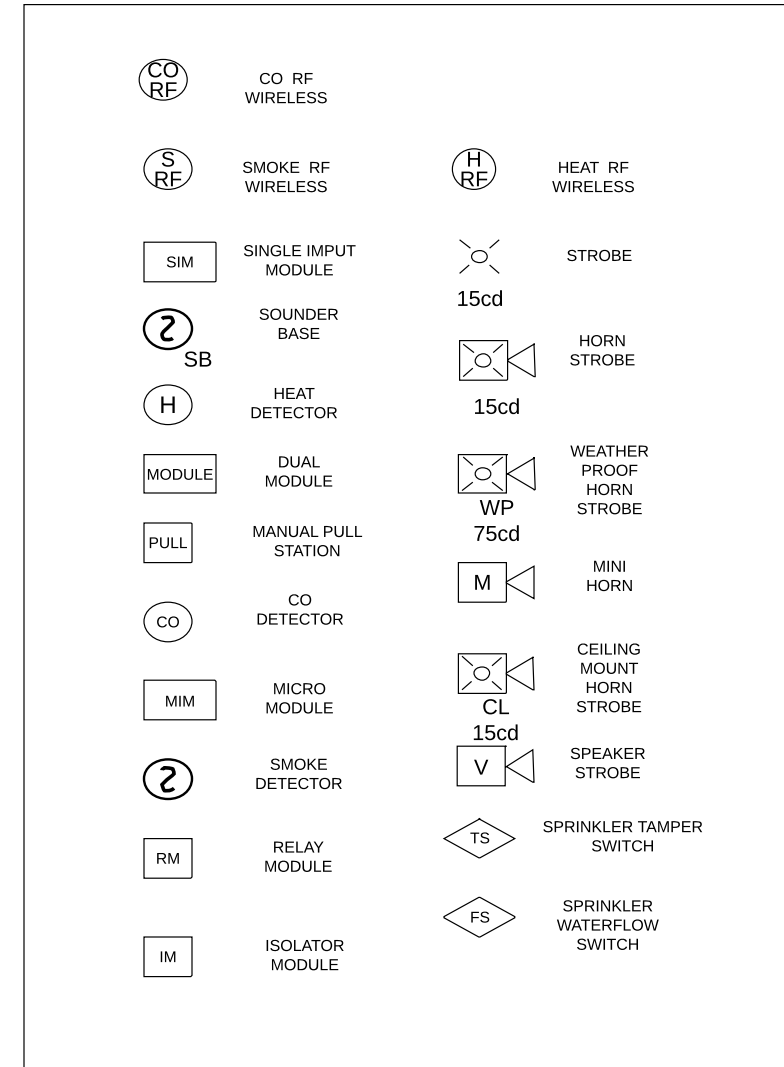

PROTECTION PROFESSIONALS

DATE 11/30/17

REVISION: 1.0

62 MELLEEN STREET

SCALE: NS

2ND FLOOR

SHEET: 3 OF 5

DESIGNER: JEREMY LAMBERT