1 EXISTING PADMOUNT TRANSFORMER SHALL BE REPLACED BY CMP. REMOVE EXISTING TRANSFORMER PAD. PROTECT EXISTING PRIMARY AND SECONDARY CONDUIT AND WIRING DURING DEMOLITION AND EXCAVATION. SEE A6/ES-101 FOR FURTHER INFORMATION.

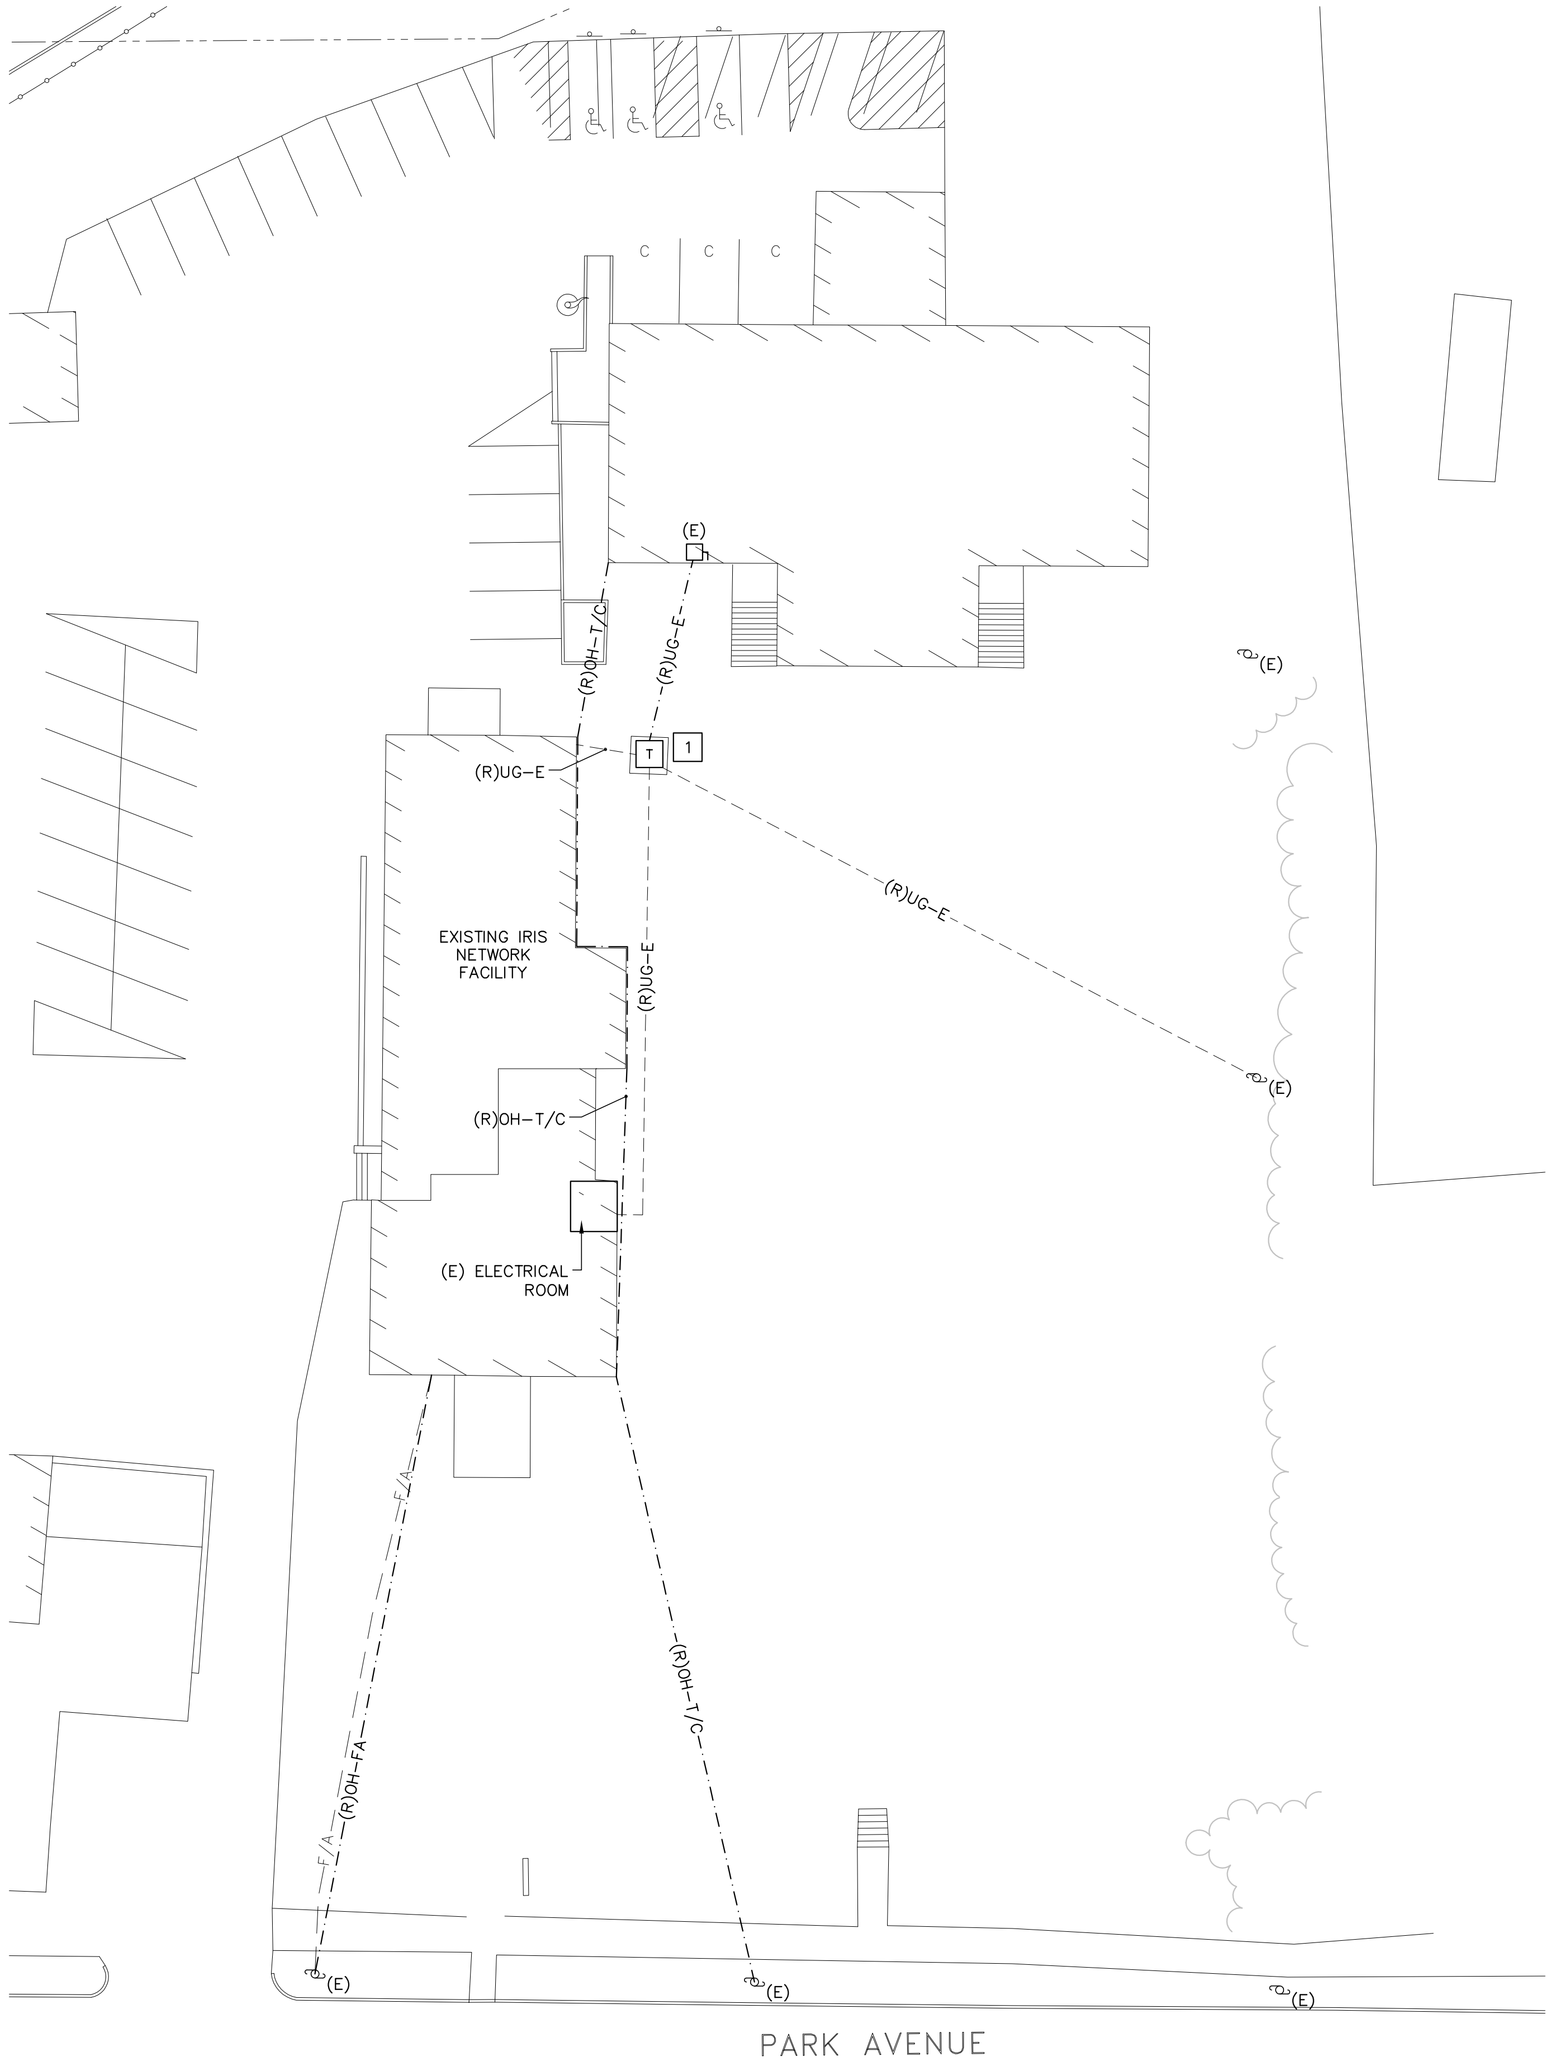

A1	ELECTRICAL SITE DEMOLITION PLAN
1" = 20'-0"	

1 NEW PADMOUNT TRANSFORMER TO BE PROVIDED BY CMP AT EXISTING TRANSFORMER LOCATION. PROVIDE TRANSFORMER VAULT PER DETAIL A1/ES-100 WITH BOX OUTS TO FIT OVER PRIMARY AND SECONDARY CONDUITS. COORDINATE TRANSFORMER UPGRADE WITH CMP AND THE OWNER.

2 REFER TO FLOOR PLAN FOR BUILDING MOUNTED EXTERIOR LIGHTING CONNECTION AND CONTROL.

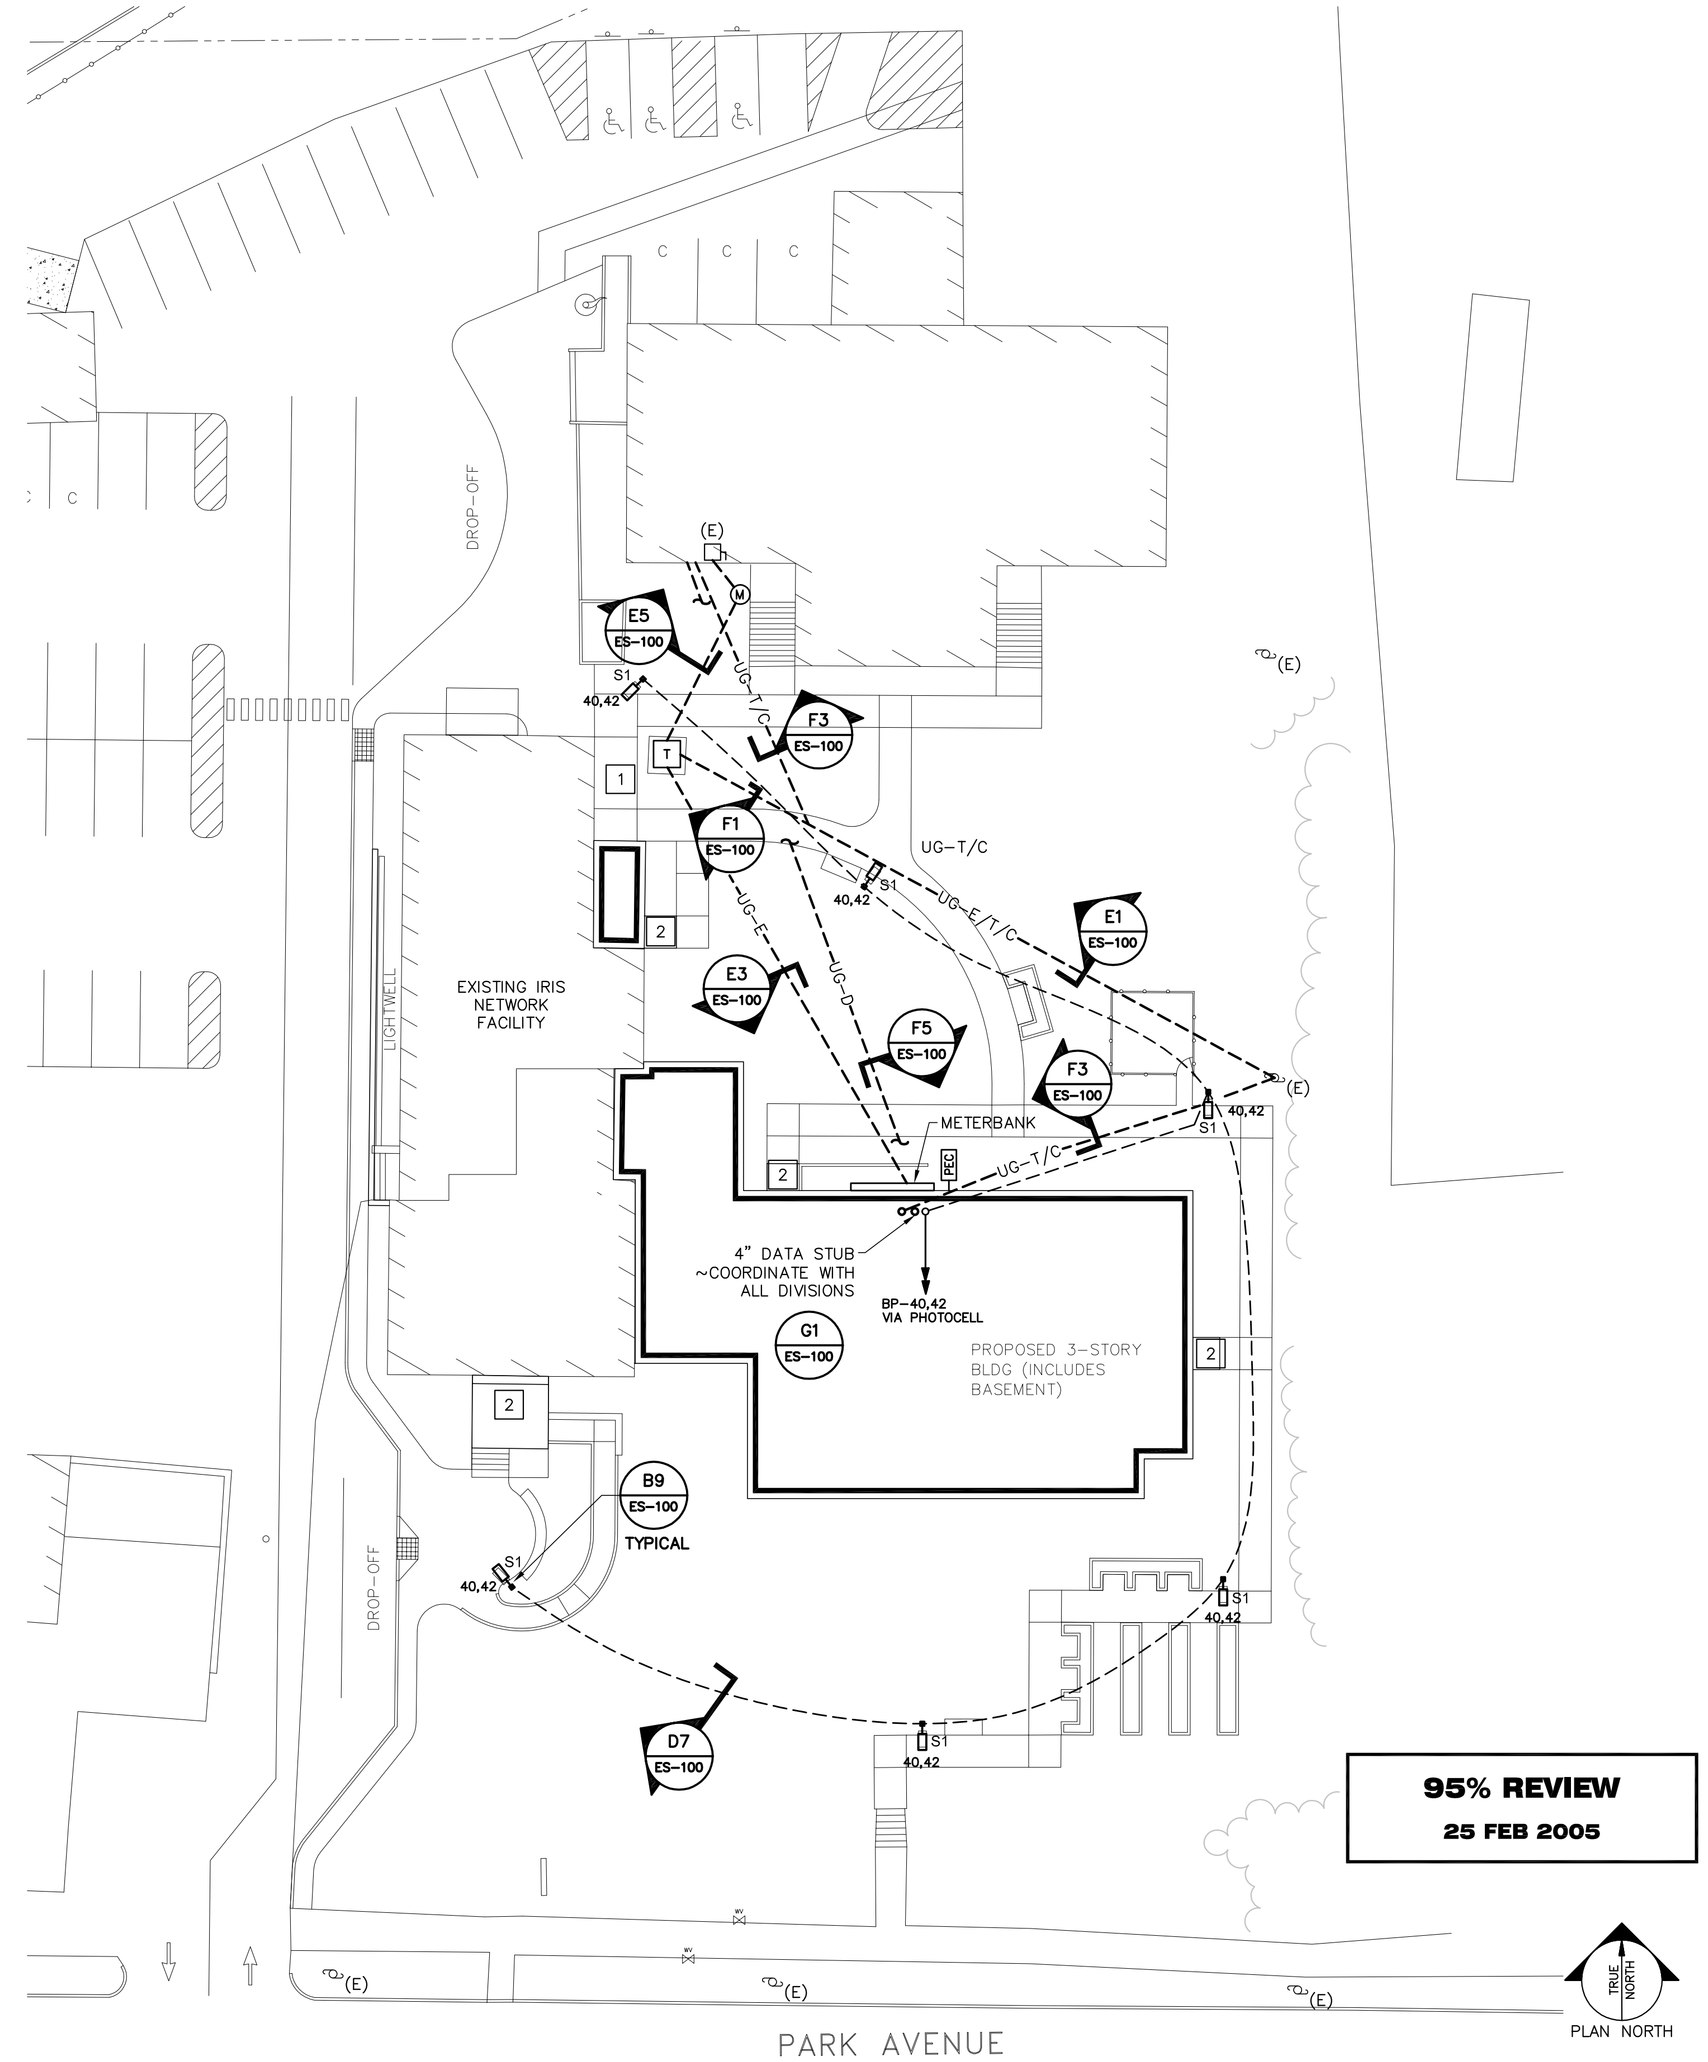

95% REVIEW
25 FEB 2005

A6	ELECTRICAL SITE NEW CONDITIONS PLAN
1" = 20'-0"	

ARCHITECT:
SEMPLE & DRANE ARCHITECTS
496 CONGRESS STREET
PORTLAND, MAINE 04101
TEL:(207) 761-4231 FAX:774-0152
sda@sempledrane.com

ENGINEERING:
allied engineering, inc.
Telephone No: 207-854-0126 • Fax No: 207-854-0003
E-mail: info@alliedengineering.com • www.alliedengineering.com

OWNER:
IRIS NETWORK
PORTLAND, MAINE 40101

PROJECT:
IRIS PARK APARTMENTS
RENOVATION & ADDITIONS
PORTLAND, MAINE 04101

DRAWING:
SITE DEMO AND NEW CONDITIONS PLAN

REVISIONS:

SCALE: AS NOTED
CAD FILE: 0306ES.DWG
DATE:

SHEET:
ES-101

2-24-2005