


NOTE:

1. SEE SHEET M-001 FOR LEGEND AND ABBREVIATIONS.

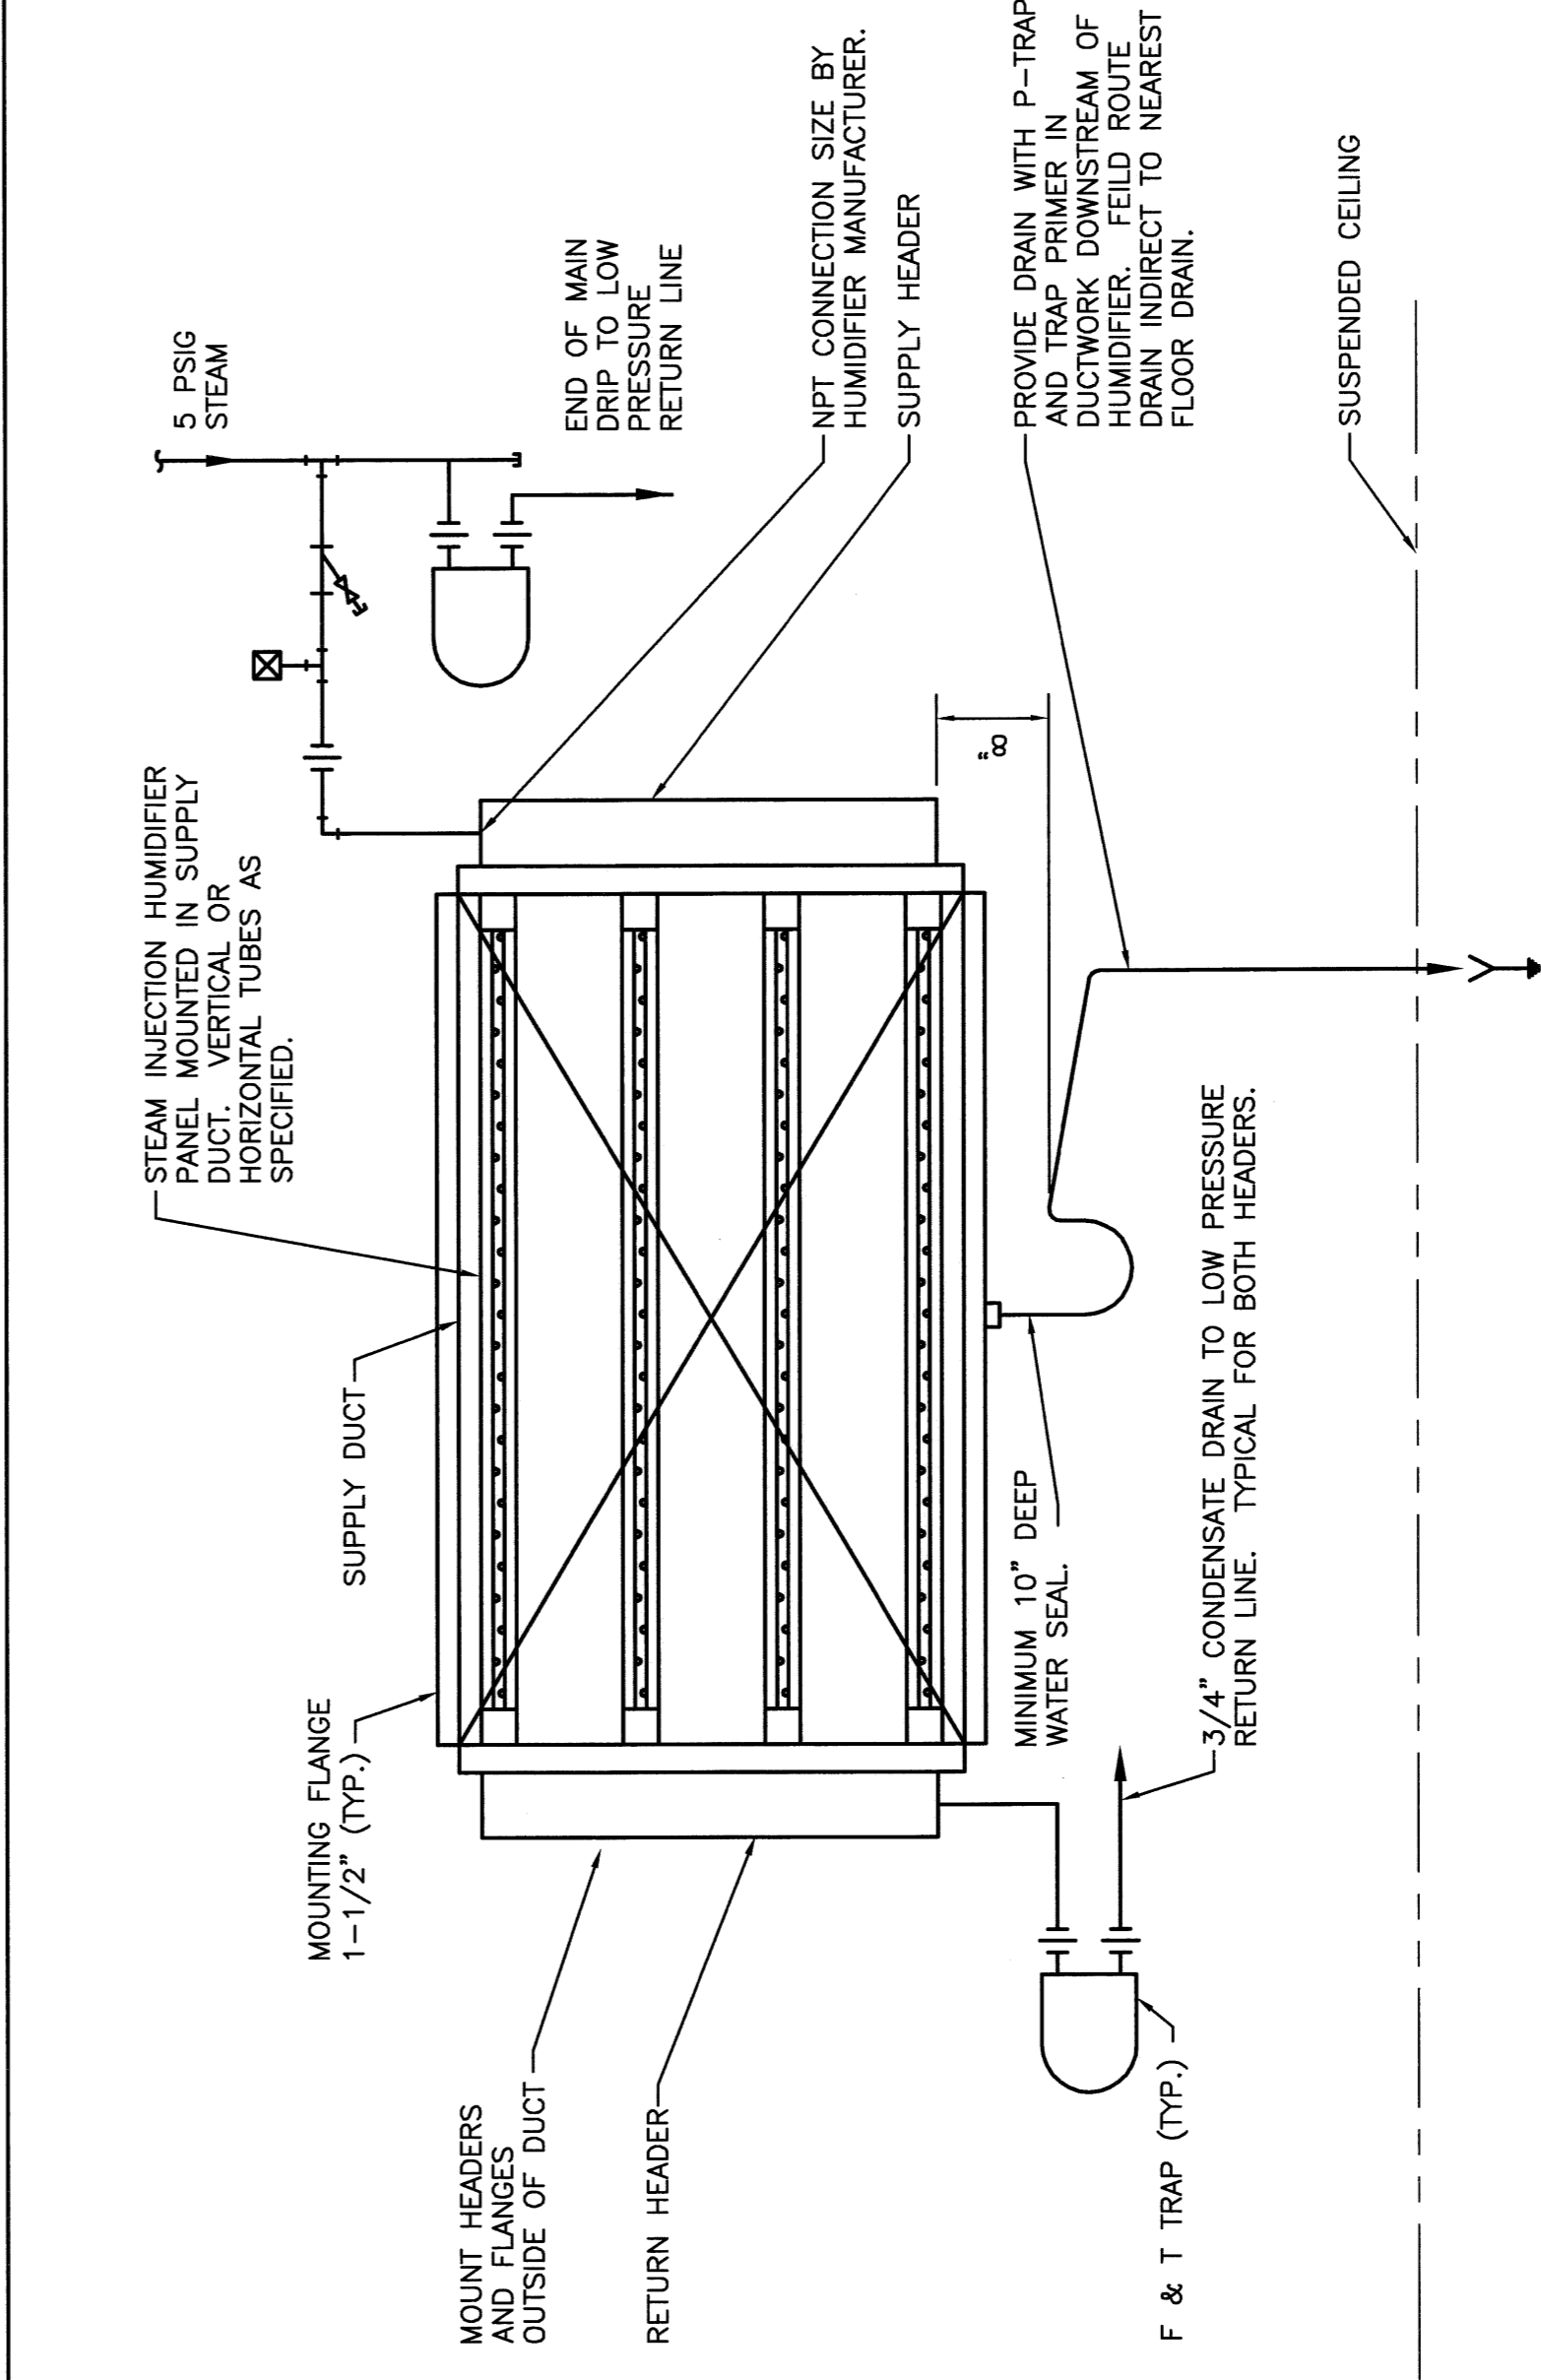


NOTES:

1. SLOPE ALL DRAIN PIPING A MINIMUM OF 1/8" PER FOOT UNLESS NOTED OTHERWISE.
2. INSTALL IN STRICT ACCORDANCE WITH THE MANUFACTURER INSTRUCTIONS. MAINTAIN ACCESS TO ALL EQUIPMENT.
3. EQUIPMENT SUPPLIER TO CONFIRM STEAM SUPPLY PIPE SIZE.
4. SUBMIT SHOP DRAWINGS INDICATING INSTALLATION DETAILS.
5. INSULATE STEAM SUPPLY AND RETURN PIPING WITH FIBERGLASS WITH ALL SERVICE JACKET.
6. FABRICATE SEAMS AT BOTTOM OF DUCT WATER TIGHT 2 FT UPSTREAM AND 6 FT DOWNSTREAM OF INJECTION PANEL.

REV.	ISSUED FOR CONSTRUCTION	DESCRIPTION	DATE
0			9-12-08

ISSUED FOR CONSTRUCTION
9-12-08

CURRENT ISSUE STATUS:

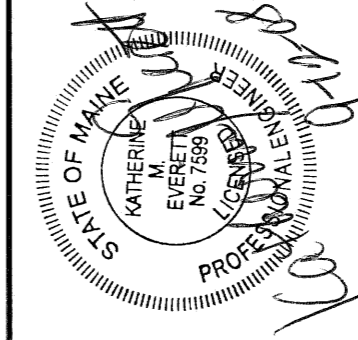

144 Fore Street, 8th Floor
Portland, Maine 04103
Tel: (207) 722-5800
Fax: (207) 722-5805
www.spartec.com

SMART

ARCHITECTURE
ENGINEERING
PLANNING
INTERIOR DESIGN
COMMISSIONING

MAINE MEDICAL CENTER - L.L. BEAN WING 2ND FLOOR
SURGICAL SERVICES

PORTLAND, MAINE

DETAILS

SHEET TITLE	NOT TO SCALE	DATE
		9-12-08

PROJECT MANAGER	CDP	GRAPHIC SCALE:
		0'

JOB CAP/PRW/IN:	DIL

DATE OF RECORD:	KME	SHEET No.

SMART CAD FILE:	PROJECT No.
M-502-08098	08098

A9 DUCT MOUNTED HUMIDIFIER DETAIL

NOT TO SCALE