

NOTE:

- SEE SHEET M-001 FOR LEGEND AND ABBREVIATIONS.
- PROVIDE NEW CONTROLS FOR ALL EXISTING TO REMAIN TERMINAL (VAV) BOXES, INCLUDING DAMPER, ACTUATOR, HW CONTROL VALVE, AIRFLOW AND ROOM TEMPERATURE END CONTROL VALVE, AND ROOM TEMPERATURE END CONTROL SYSTEM. BALANCE AND CALIBRATE TERMINAL BOX PER THE EQUIPMENT SCHEDULE ON DRAWING M-601.
- BALANCING CONTRACTOR TO MEASURE AND RECORD AIRFLOWS AT EXISTING SUPPLY, RETURN AND EXHAUST TERMINALS. PROVIDE MEASUREMENT POINTS TO INDICATE AIRFLOWS AT NEW AIR TERMINALS AND TO PRESENT AIRFLOWS AT EXISTING AIR TERMINALS. EXISTING INFORMATION ONLY.
- ADJUST AND SERVICE EXISTING SPRINKLER DRINKS AS REQUIRED TO MEET THE NEW LAYOUT. PROVIDE SPRINKLER COVERAGE PER NFPA 13, LIGHT HAZARD OCCUPANCY. NEW SPRINKLER HEADS TO BE INSTALLED IN ALL NEW AREAS. CONTRACTOR TO MATCH EXISTING STYLE AND FINISH.
- COORDINATE AND SPANER DOWN TIME WITH OWNER AND COMPLY WITH REQUIREMENTS OF NFPA 13.


KEYED NOTES:

- (E) 10x6.
- (E) E-1, 75 CFM.
- (E) R, 440 CFM.
- (E) R, 385 CFM.
- (E) S, 205 CFM.
- (E) S, 50 CFM.
- (E) S, 150 CFM.
- (E) TB-26.
- (E) R, 545 CFM.
- (E) S, 525 CFM.
- (E) R, 540 CFM.
- (E) TB-25.
- (E) R, 340 CFM.
- (E) S, 350 CFM.
- (E) R, 200 CFM.
- (E) E, 50 CFM.
- (E) S, 70 CFM.
- (E) TB-8.
- (E) R, 230 CFM.
- (E) R, 70 CFM.
- (E) R, 115 CFM.
- (E) 16x12 TOILET EXHAUST TO T.E. RISER.
- (E) 16x10 GENERAL EXHAUST TO G.E. RISER.
- RELOCATE NEW 14x12 SOILED EXHAUST TO (E) 20x14 S.E. RISER. PROVIDE FIRE DAMPER AT SHFT WALL.
- (E) ISOLATION EXHAUST RISER.
- RELOCATE EXISTING SUPPLY AIR DIFFUSER AS NEEDED TO CLEAR NEW DUCT.
- 30" SA-UP TO AHU-84 IN 4TH FLOOR MECHANICAL ROOM. PROVIDE A FIRE DAMPER AT MECHANICAL ROOM FLOOR PENETRATION. PROVIDE INSULATION IN MECHANICAL ROOM UNDER SEPARATE PROJECT.
- 36" SA-UP TO MECHANICAL ROOM FLOOR MECHANICAL ROOM. PROVIDE A FIRE DAMPER AT MECHANICAL ROOM FLOOR PENETRATION. DUCT CONTINUATION IN MECHANICAL ROOM IS UNDER A SEPARATE PROJECT.
- PROVIDE LONG RADIUS ELBOWS (PREFERRED) OR MITERED ELBOW WITH TURNING VANES.

ISSUED FOR CONSTRUCTION	DATE
0	9-12-08
1	

ISSUED FOR CONSTRUCTION
9-12-08

CURRENT ISSUE STATUS:

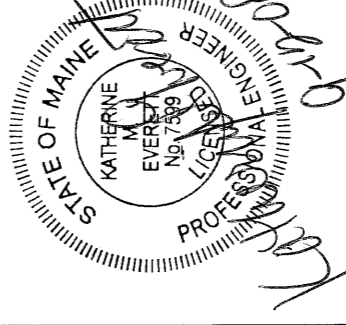

SMRT
ARCHITECTURE
ENGINEERING
PLANNING
INTERIOR DESIGN
COMMISSIONING

14176 State St., 2nd Fl.
Portland, Maine 04108
Tel: (207) 773-8466
Fax: (207) 773-8078
www.smrtinc.com

MAINE MEDICAL CENTER - L.L. BEAN WING 2ND FLOOR
INPATIENT SERVICES
PORTLAND, MAINE

HVAC
DUCTWORK PLAN

SHEET TITLE	1/8" = 1'-0"	DATE	9-12-08
PROJECT NUMBER	00P	GRAPHIC SCALE	0'
JOB C/D/DRAWN	BGG		
DATE OF RECORD	RBE	SHEET NO.	MH101
SMRT JOB FILE	MH101-08099		
PROJECT NO.	08099		

