

FAN COIL UNIT SCHEDULE

TAG	TYPE	SP IN W.G.	COOLING SMBH	MAX CFM	EWT °F	WATER ΔT	GPM	WPD FT WC	ESP IN WC	ELECTRICAL DATA				MAX UNIT DIMENSIONS	WT #	TYPICAL UNIT MFG & MODEL NO.	NOTES:
										HP	FLA	VOLTS	PH				
FC-1	2-PIPE	N/A	14.2	600	44	12	5	10.5	N/A	1/20	0.35	208	1	47"x15"x8"D	50	MULTIAQUA MHWW-24-H-1	*
FC-2	2-PIPE	N/A	14.2	600	44	12	5	10.5	N/A	1/20	0.35	208	1	47"x15"x8"D	50	MULTIAQUA MHWW-24-H-1	

NOTES: 1.
2.
3.



REGISTER, DIFFUSER & GRILL SCHEDULE

TAG	CFM	NECK SIZE	TYPE	DP	MAX NC	TYPICAL UNIT MFG & MODEL NO.	NOTES
S-1	150	6"ø	SUPPLY	0.04	<20	PRICE MODEL ASPD	1
E-1	160	8"x8"	EXHAUST	0.04	<20	PRICE MODEL 630	2

NOTES: 1. T-BAR LAY-IN MOUNTING
2. SURFACE MOUNTED CEILING
3.

144 Fore Street, P.O. Box 618
Portland, Maine 04108
Tel: (207) 772-8486
Fax: (207) 772-1070
www.smri.com

ARCHITECTURE
ENGINEERING
PLANNING
INTERIOR DESIGN
COMMISSIONING

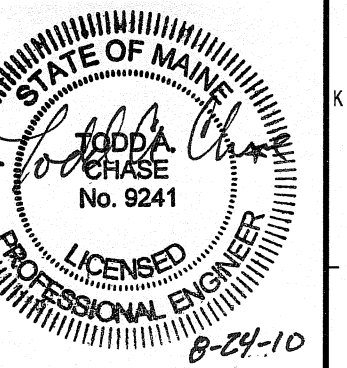

Bramhall Radiology
FLUORO RENOVATIONS
PORTLAND, ME

ISSUED FOR CONSTRUCTION
8.24.10

REV	DESCRIPTION	DATE
0	ISSUED FOR CONSTRUCTION	8.24.10

GRAPHIC SCALE:
1" = 1'

SCALE: NOT TO SCALE
PROJECT MANAGER: DIV
JC/DRAWN BY: KPB
AVE OF RECORD: TAC
PROJECT NO.: 09022-02
DATE: 8.24.10

SHEET TITLE:
MECHANICAL
SCHEDULES

SHEET No.
M-601