

1 BASEMENT LEVEL POWER PLAN
1/8" = 1'-0"

NOTES:




1. SEE E-001 FOR LEGEND, ABBREVIATIONS AND GENERAL NOTES.
2. REFER TO EP402 FOR SIMENS & BOV CABLE AND CONDUIT REQUIREMENTS.

KEYED NOTES:

- 1 RELOCATED, SEE ED101 FOR THE EXISTING LOCATION.
- 2 CHANGE EXISTING QUAD RECEPTACLE TO A GFI TYPE.
- 3 INSTALL 6" ABOVE COUNTER.
- 4 INSTALL 48" AFF.
- 5 INSTALL 54" AFF.
- 6 INSTALL 60" AFF. COORDINATE HEIGHT WITH DEVICES IN RADCU NORTH.
- 7 INSTALL 72" AFF.
- 8 JUNCTION BOX ABOVE CEILING, FURNISHED BY STERIS FOR EQUIPMENT BOOM CIRCUITS.
- 9 CIRCUITS FOR EQUIPMENT BOOM.
- 10 CIRCUIT FOR VIDEO ARM BRAKE.
- 11 PROVIDE SINGLE POLE, 120V, 20A, 22,000 AC CIRCUIT BREAKER IN EXISTING PANEL.
- 12 PROVIDE 2 POLE, 240V, 20A, 22,000 AC CIRCUIT BREAKER IN EXISTING PANEL. REMOVE EXISTING SPARE 2 POLE 30A AND GIVE TO OWNER. RECEPTACLE IS FOR FAN COIL UNIT. COORDINATE LOCATION WITH MECHANICAL CONTRACTOR.
- 13 PROVIDE PENDANT MOUNTED DUPLEX RECEPTACLE WITH BEACON - MEDASIS RETRACTOR. PROVIDE STRAIN RELIEF AT CEILING PLATE AND DUPLEX RECEPTACLE. CORD SHALL BE 500 TYPE, 48" LONG.
- 14 PROVIDE POWER TO DOOR OPERATOR.
- 15 DOOR IS CONTROLLED BY A CARD READER OUTSIDE THE AREA AND A "HAND WAVE" OPERATOR INSIDE THE AREA.
- 16 PROVIDE CONNECTION TO PATIENT LIFT.

144 Fox Street, P.O. Box 618
Portland, Maine 04104
Tel: (207) 775-3846
Fax: (207) 775-1070
www.smartinc.com

ARCHITECTURE
ENGINEERING
PLANNING
INTERIOR DESIGN
COMMISSIONING

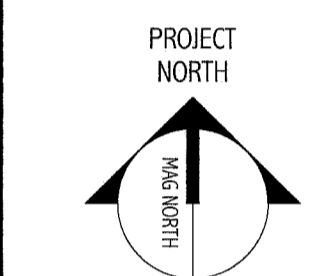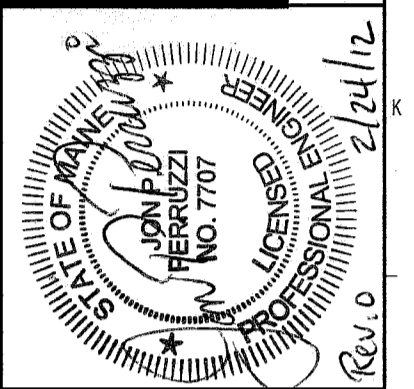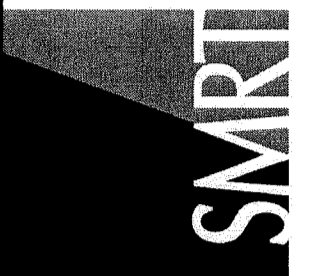

MAINE MEDICAL CENTER
HOLDING, RADCU & PBC RENOVATION
PORTLAND, ME

ISSUED FOR CONSTRUCTION
02.24.12

CURRENT ISSUE STATUS:

REV	DESCRIPTION	DATE
0	ISSUED FOR CONSTRUCTION	2.24.12

GRAPHIC SCALE:
0" 1"

SCALE: 1/8" = 1'-0"
PROJECT MANAGER: DM
DRAWN BY: KPB
A/E OF RECORD: JPP
PROJECT NO: 11063
DATE: 2.24.12

SHEET TITLE:
BASEMENT LEVEL
POWER PLAN

SHEET No.
EP101