


**Notes**



Construction Type: NFPA Type II (222) / BOCA 2A  
 Combined Area C and D Wings: 12,805 GSF  
 (C Wing and Core Area: 8,270 GSF)

**Legend**

- Proposed Sprinkler Main
- Proposed Valve
- Proposed Capped Drain Tee
- Proposed Flow Switch
- Remove Existing Partial Coverage Sprinkler System



**Project Location Diagram**

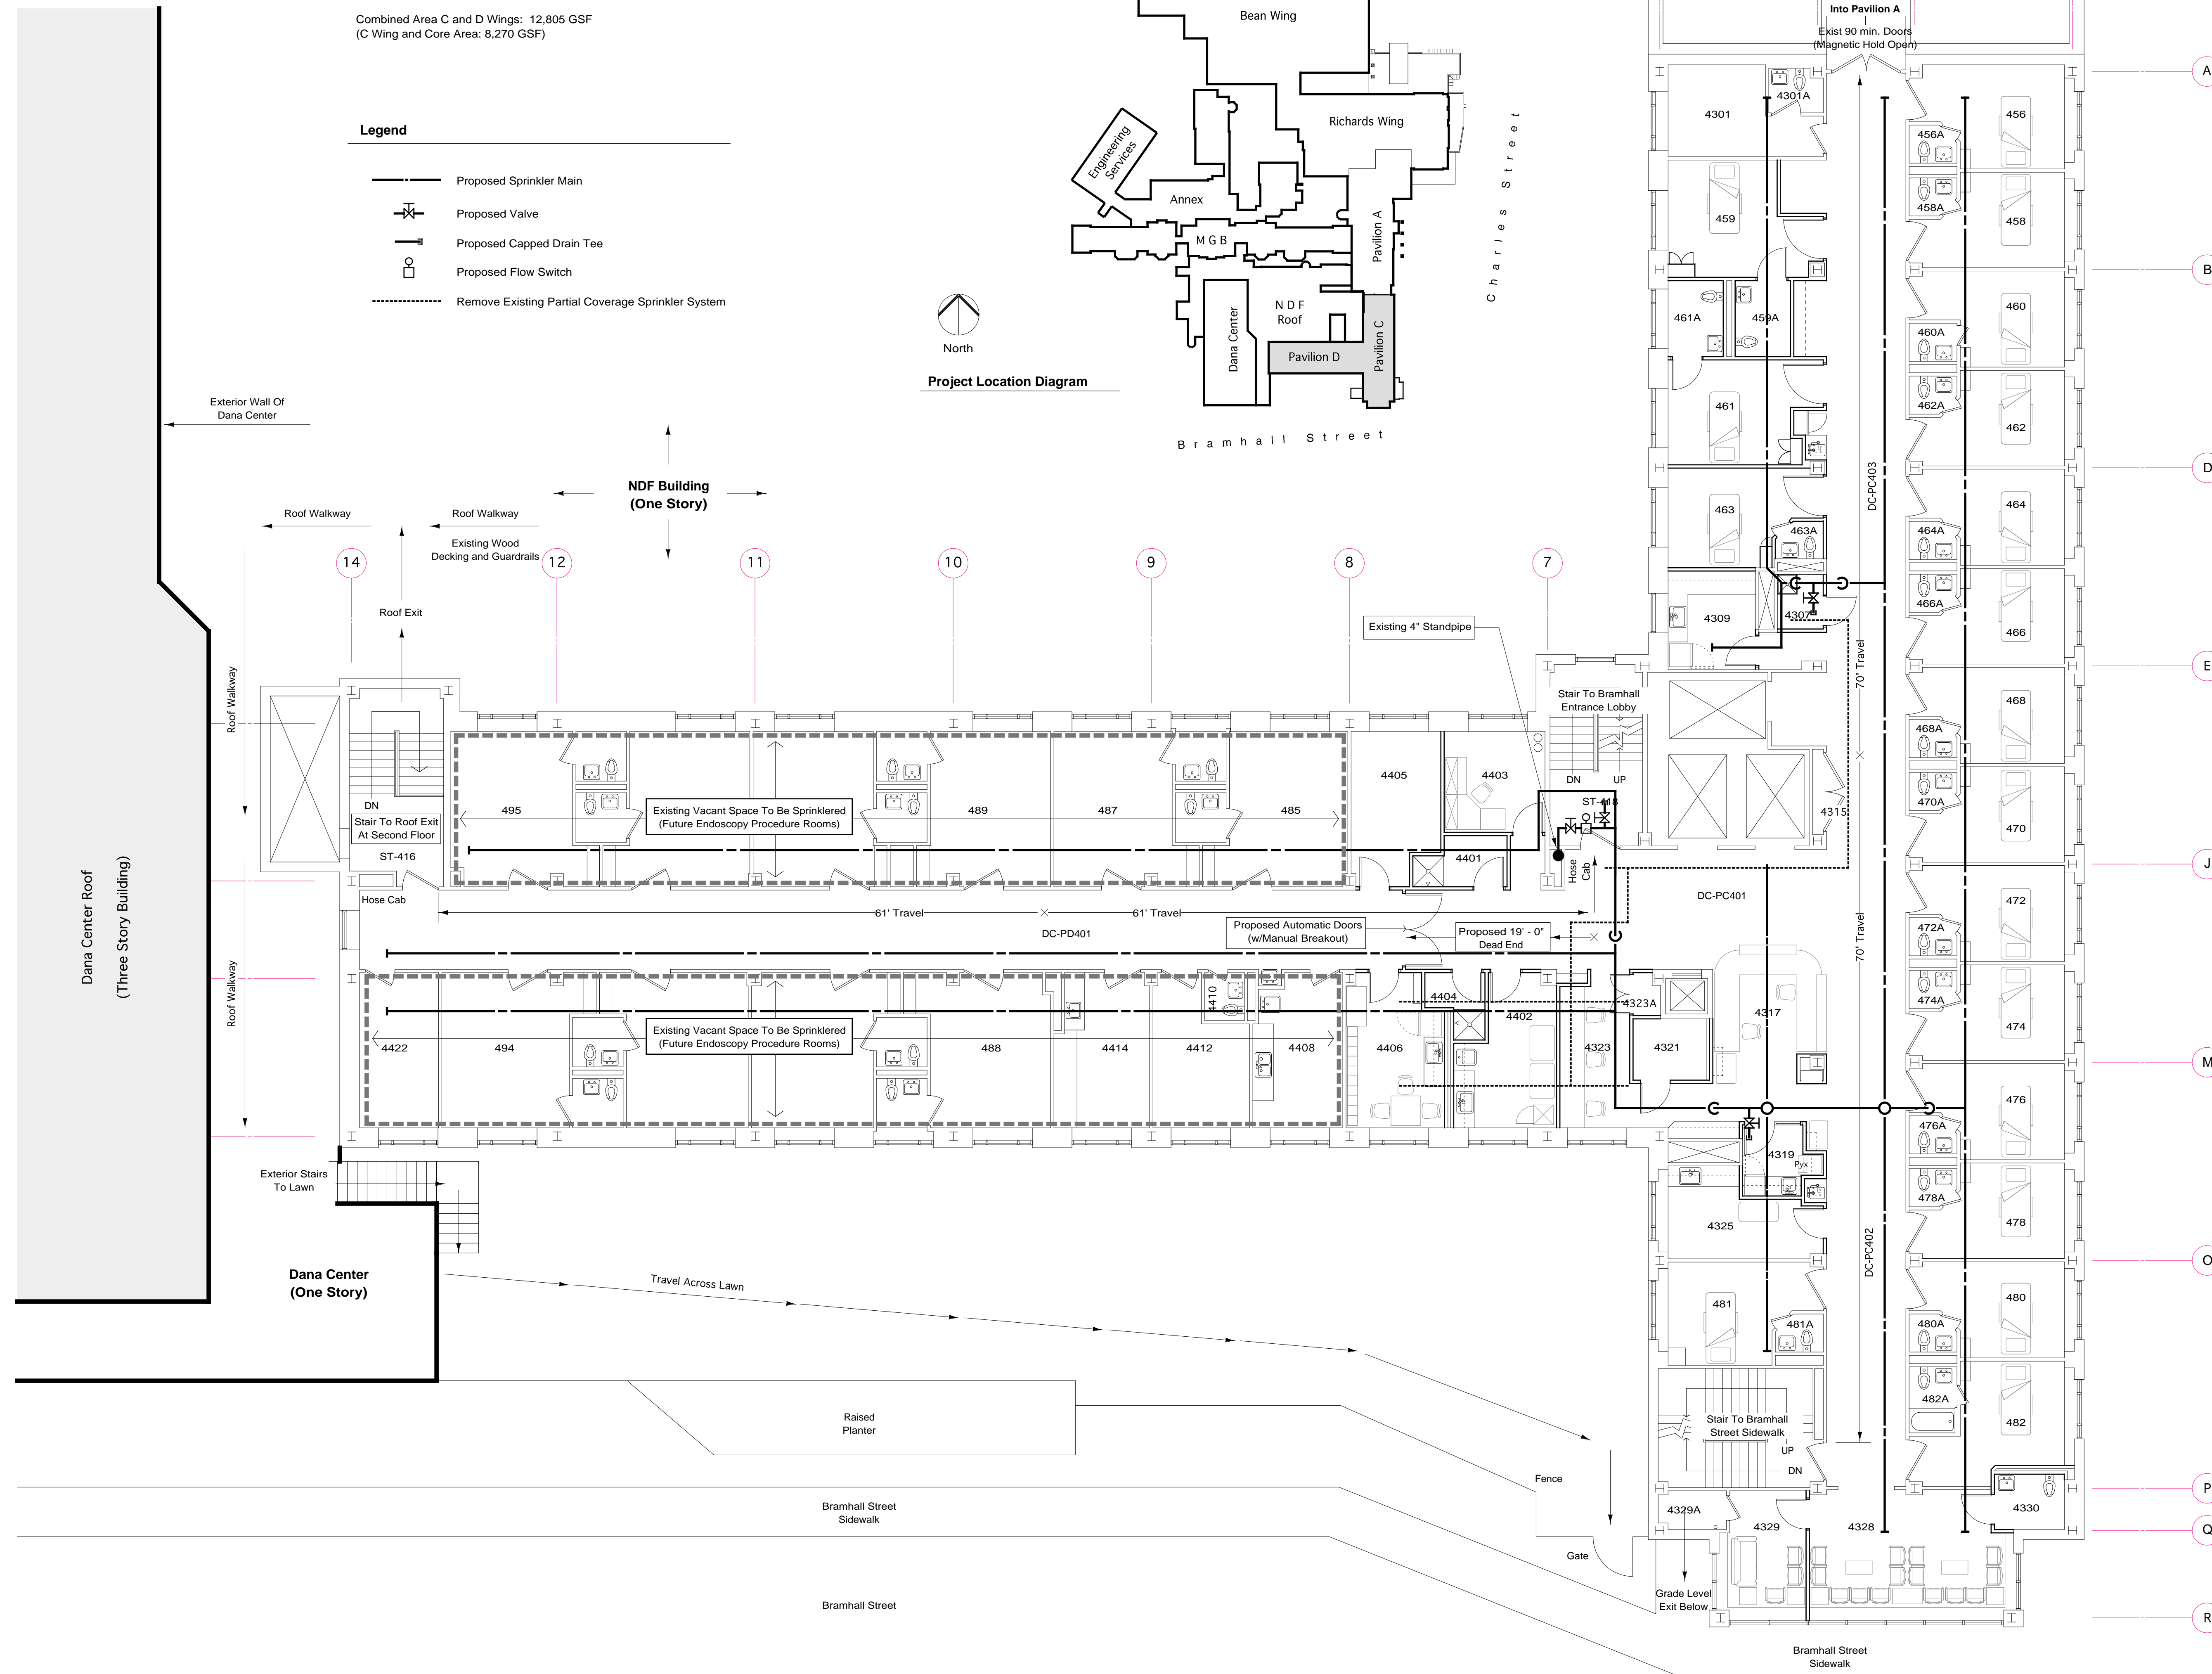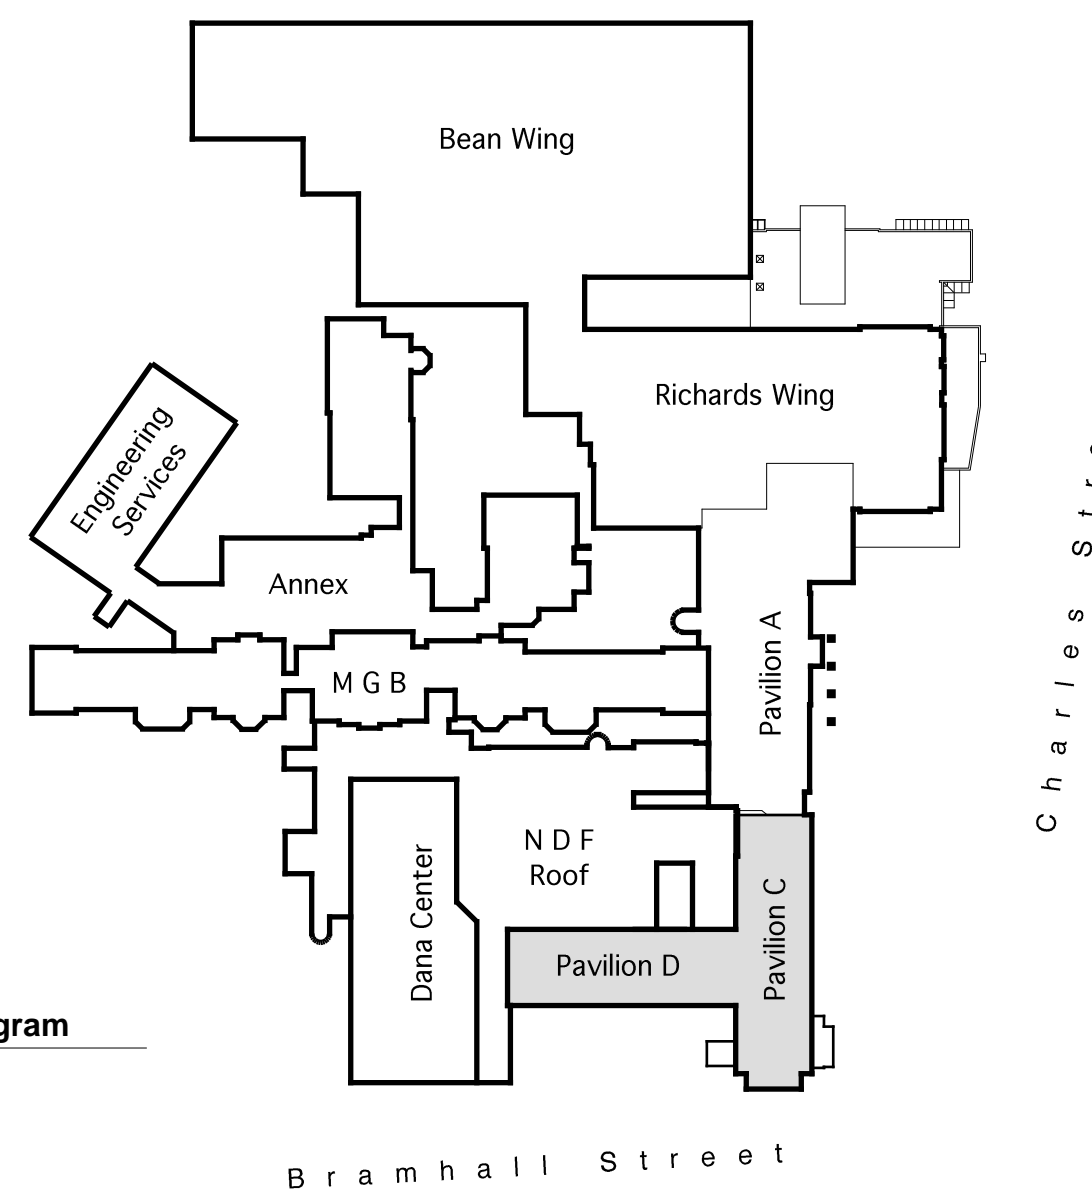

**P 4  
Renovation**

Pavilion C  
Fourth Floor

Maine Medical Center  
Portland, Maine  
04102

*Architect*  
**Winton Scott Architects**  
Portland, Maine

*Mechanical Engineering*  
**Mechanical Systems Engineers**  
Yarmouth, Maine

*Electrical Engineering*  
**Ames & Hewett**  
Winthrop, Maine

**Egress Plan  
FP 1**

Scale: 1/8" = 1' - 0"

October 30, 2001