

GENERAL NOTES







1. PROPOSED ROOMS OVER 100 SF INCLUDE 1 HOUR FIRE RATING OF PARTITIONS, WITH 3/4 HOUR FIRE RATED OPENINGS.
2. ROOMS OVER 50 SF BUT LESS THAN 100 SF SHALL BE SMOKE-TIGHT AND PROVIDED WITH SOLID DOORS WITH CLOSERS.
3. NO MEANS OF EGRESS SHALL BE AFFECTED EXCEPT FOR WIDTH REDUCTIONS NECESSARY FOR TEMPORARY CONSTRUCTION ENCLOSURES. IN SUCH CONDITIONS 48" CLEAR SHALL BE MAINTAINED AND SHALL ALLOW BED TRANSPORT PASSAGE.
4. ANY TEMPORARY PARTITION IN EXIT ACCESS CORRIDORS SHALL NOT REDUCE THE WIDTH OF THE CORRIDOR TO LESS THAN 48" AT ANY TIME DURING THE PERIOD OF CONSTRUCTION OPERATIONS. THIS WIDTH IS ALLOWED IN EXISTING HEALTH CARE FACILITIES UNDER NFPA 101 19.2.3.4


ANY TEMPORARY PARTITION IN A CORRIDOR SHALL NOT IMPACT MORE THAN ONE EXIT ACCESS PATHWAY FROM ANY PATIENT ROOM.
5. EXISTING TRAVEL DISTANCES TO EXITS MEET CURRENT NFPA 101 REQUIREMENTS AND SHALL NOT BE REDUCED BY CONSTRUCTION OPERATIONS.

CONSTRUCTION TYPES

BUILDING	TYPE	PROTECTION
BEAN WING	II - 2,2,2	FULLY SPRINKLERED
RICHARDS WING	II - 2,2,2	FULLY SPRINKLERED
EAST TOWER	II - 2,2,2	FULLY SPRINKLERED
PAVILION C-D	II - 2,2,2	FULLY SPRINKLERED

Legend

-  NEW MED PREP ROOM
-  EXISTING MED PREP ROOM
-  EXISTING OR PROPOSED ONE HOUR FIRE RATED PARTITION
-  SMOKETIGHT DOOR IN EXISTING SMOKE BARRIER PARTITION
-  3/4 HOUR FIRE RATED DOOR
-  EXISTING EXIT

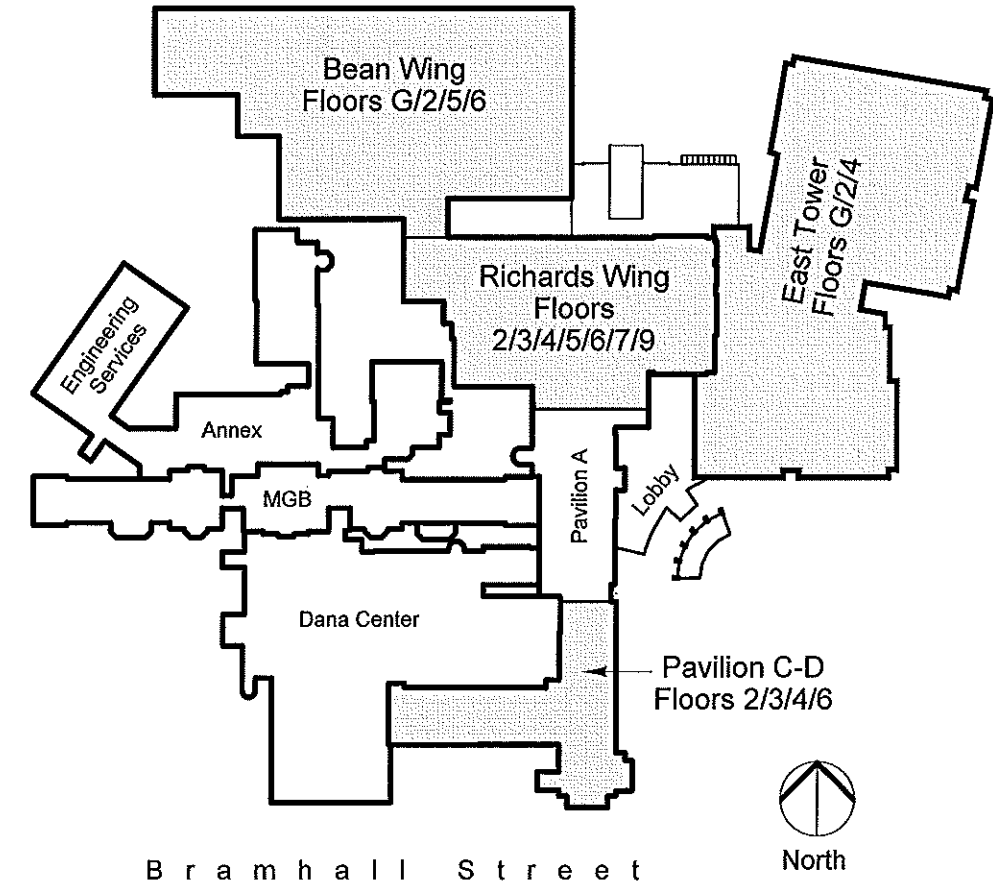

Project Location Diagram




Maine Medical Center Med Rooms Renovations

Life Safety Plans for Portland Fire Department


Winton Scott Architects
5 Milk Street
Portland, Maine 04101

November 16, 2011

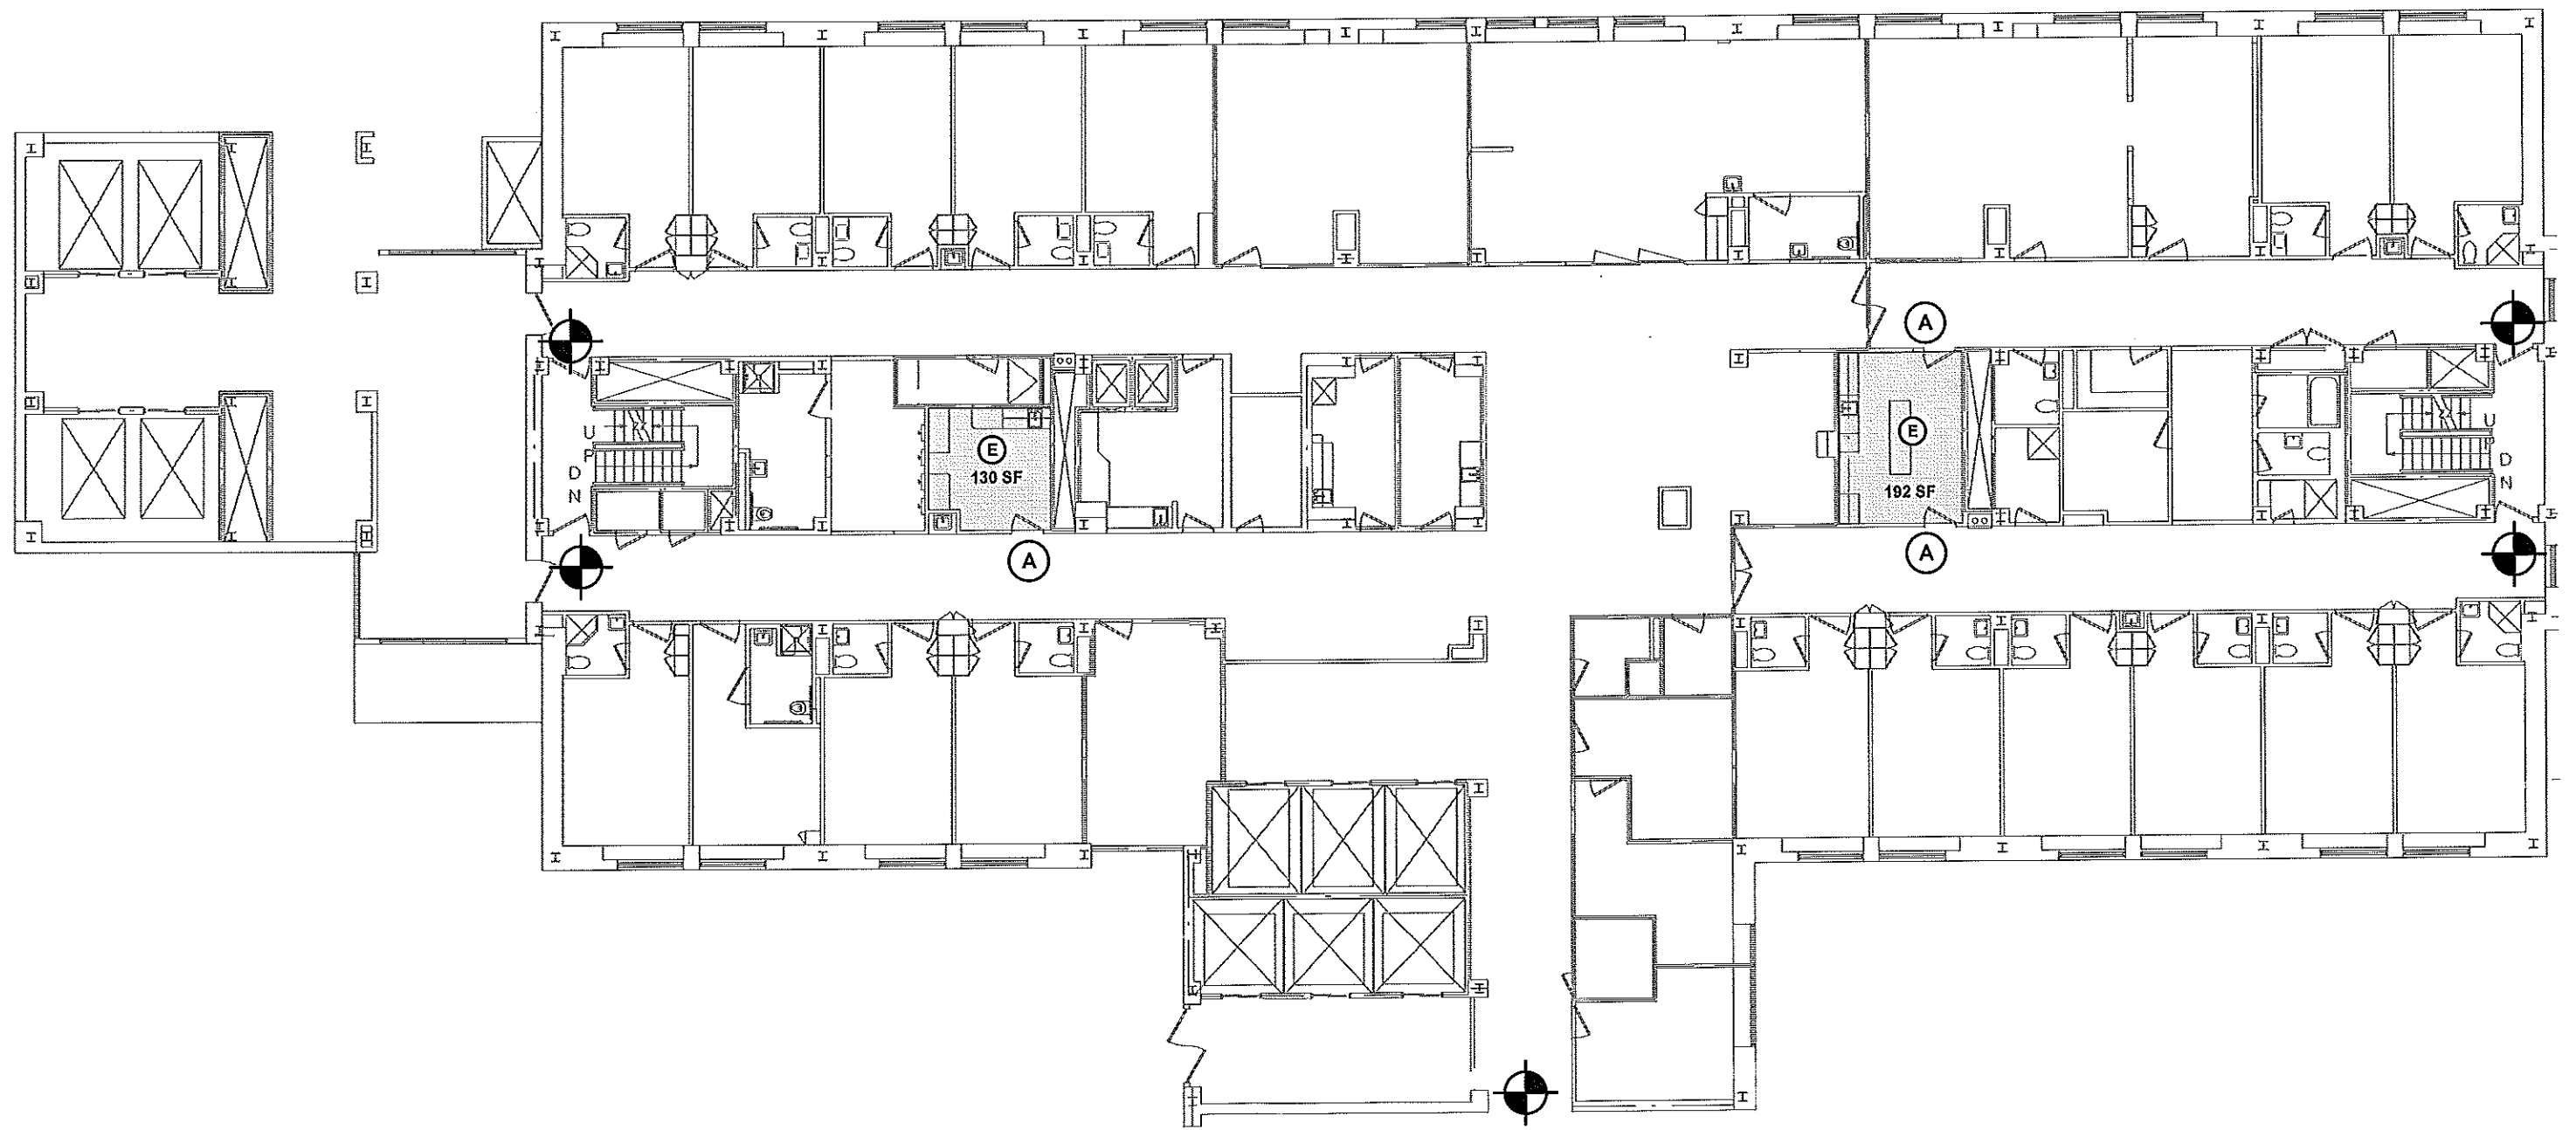


RICHARDS WING EXIT REMOTENESS	
REMOTENESS REQUIRED	69'
REMOTENESS PROVIDED	102'


RICHARDS
SECOND LEVEL

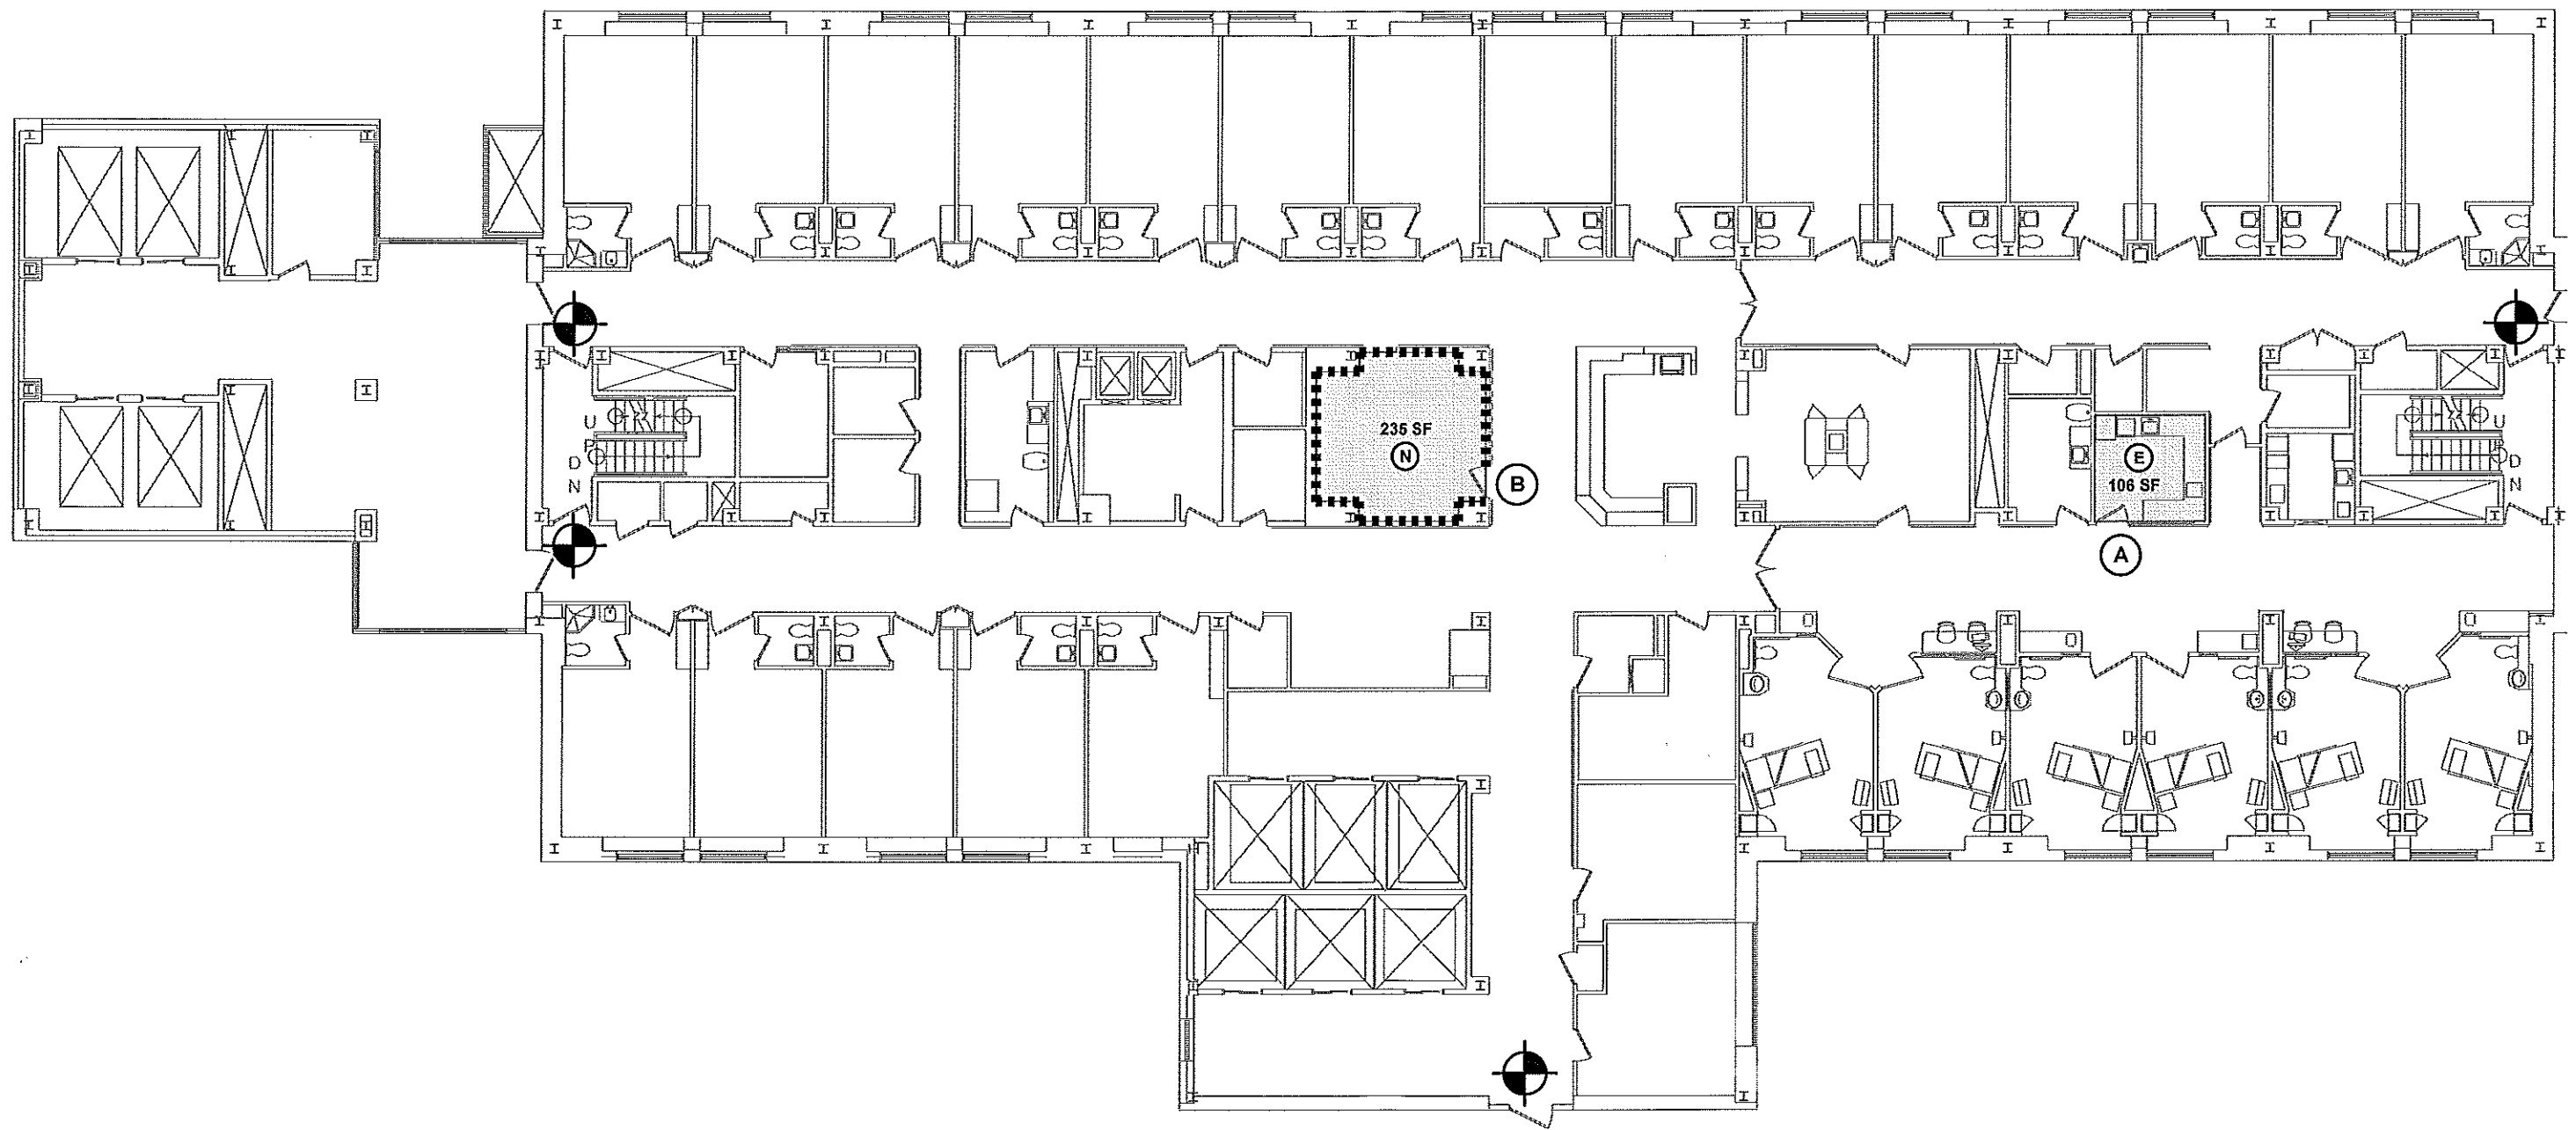


RICHARDS
THIRD LEVEL

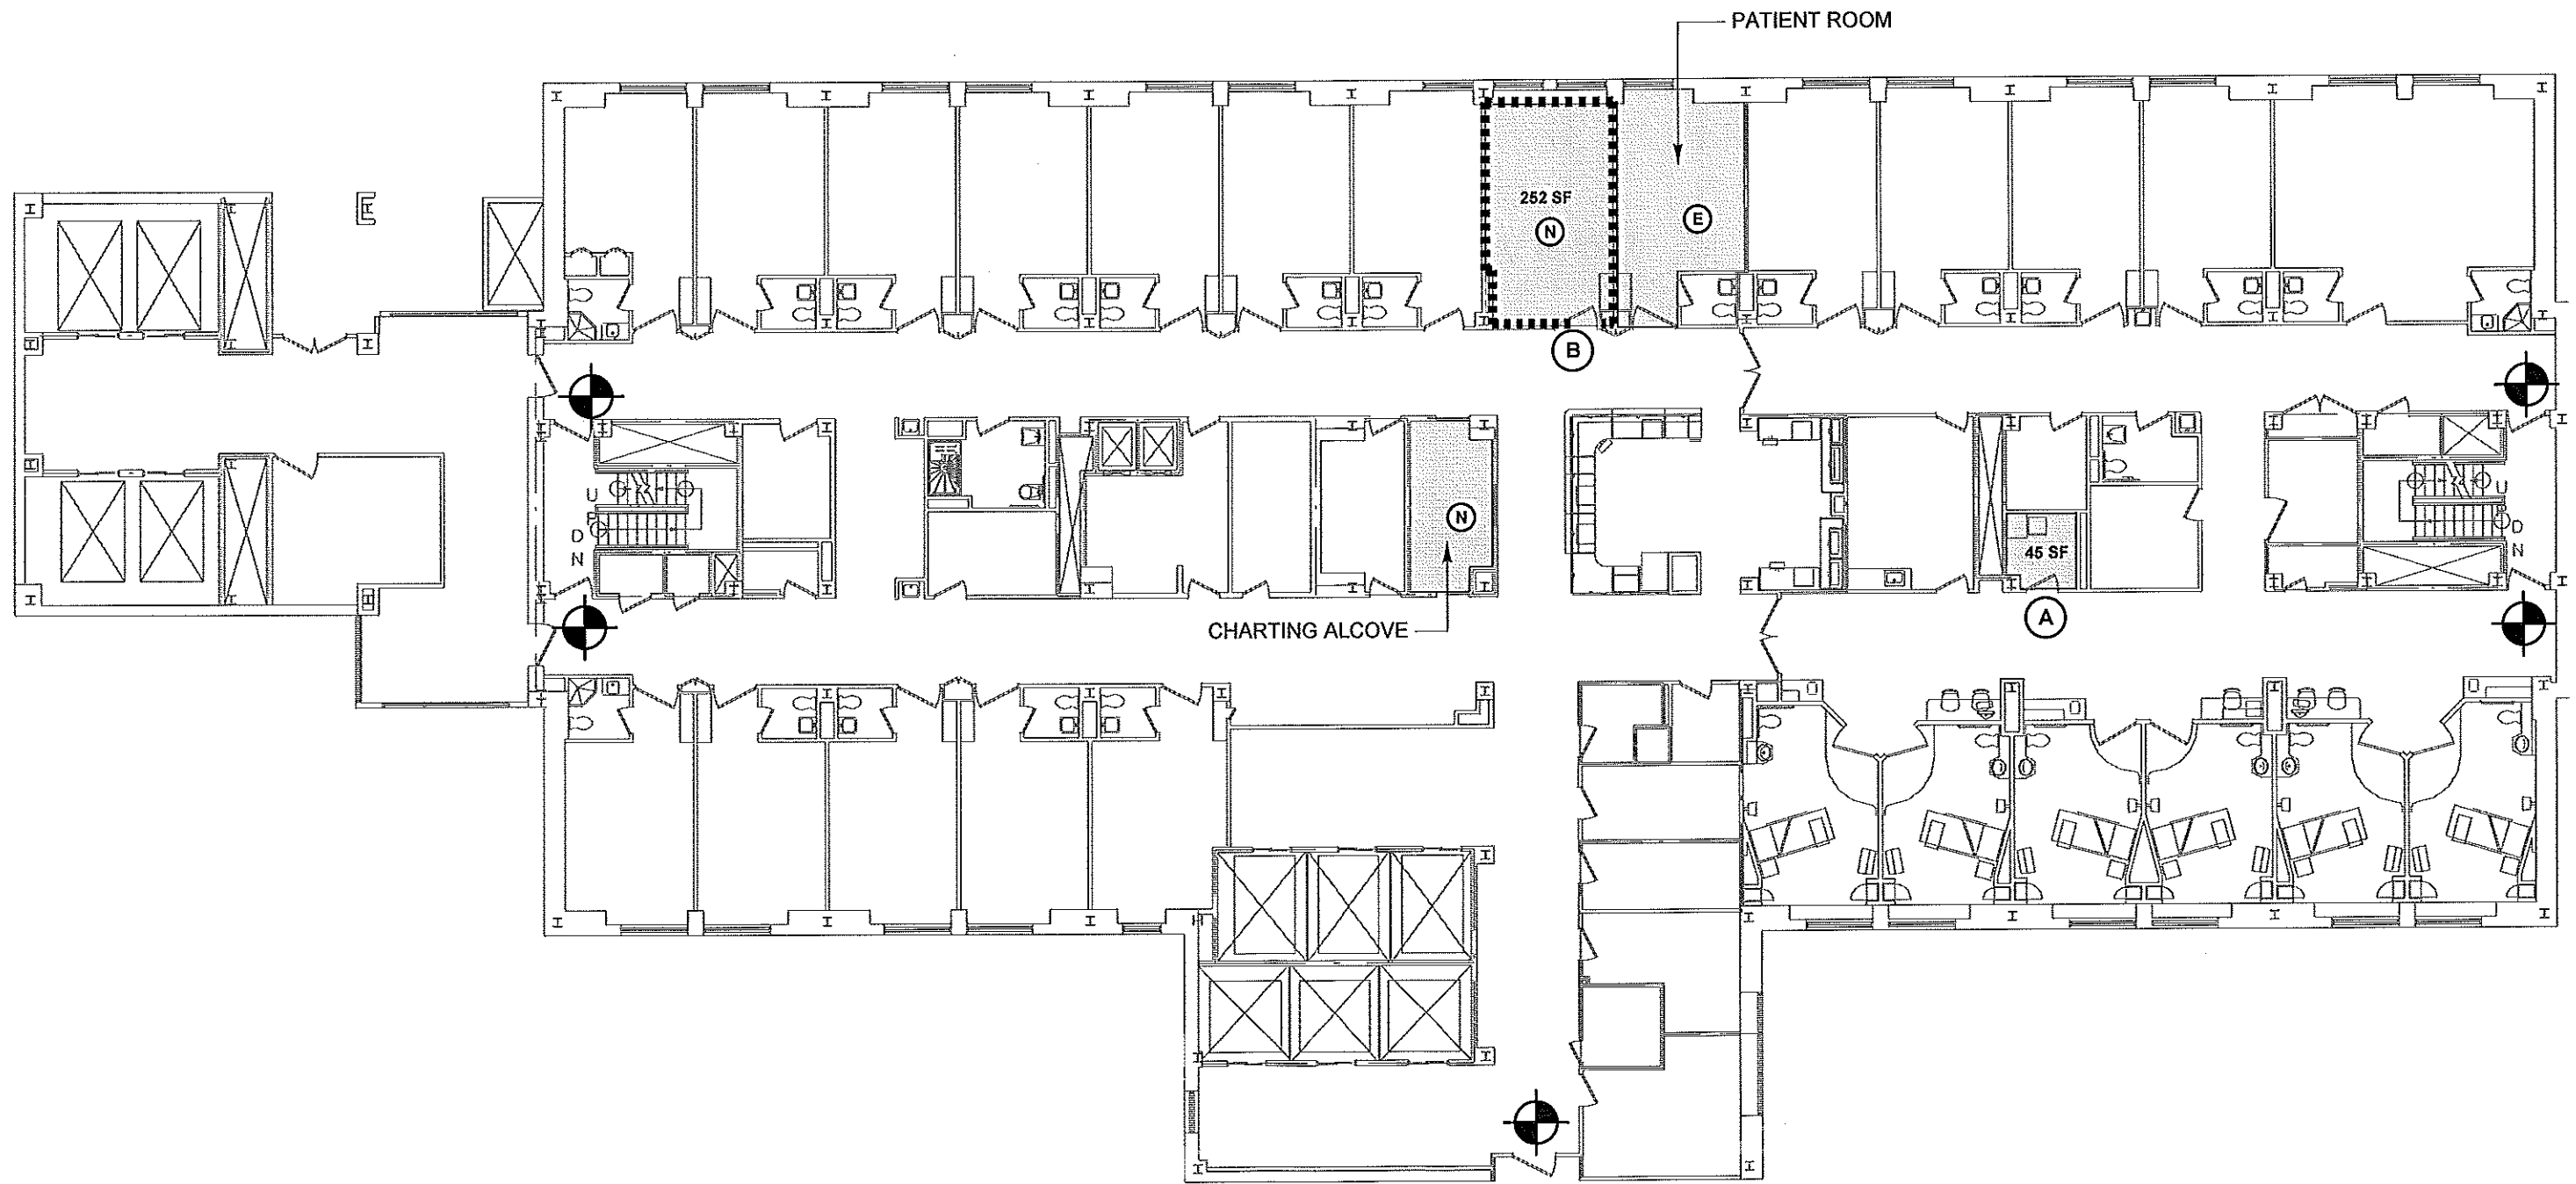


RICHARDS
FOURTH LEVEL

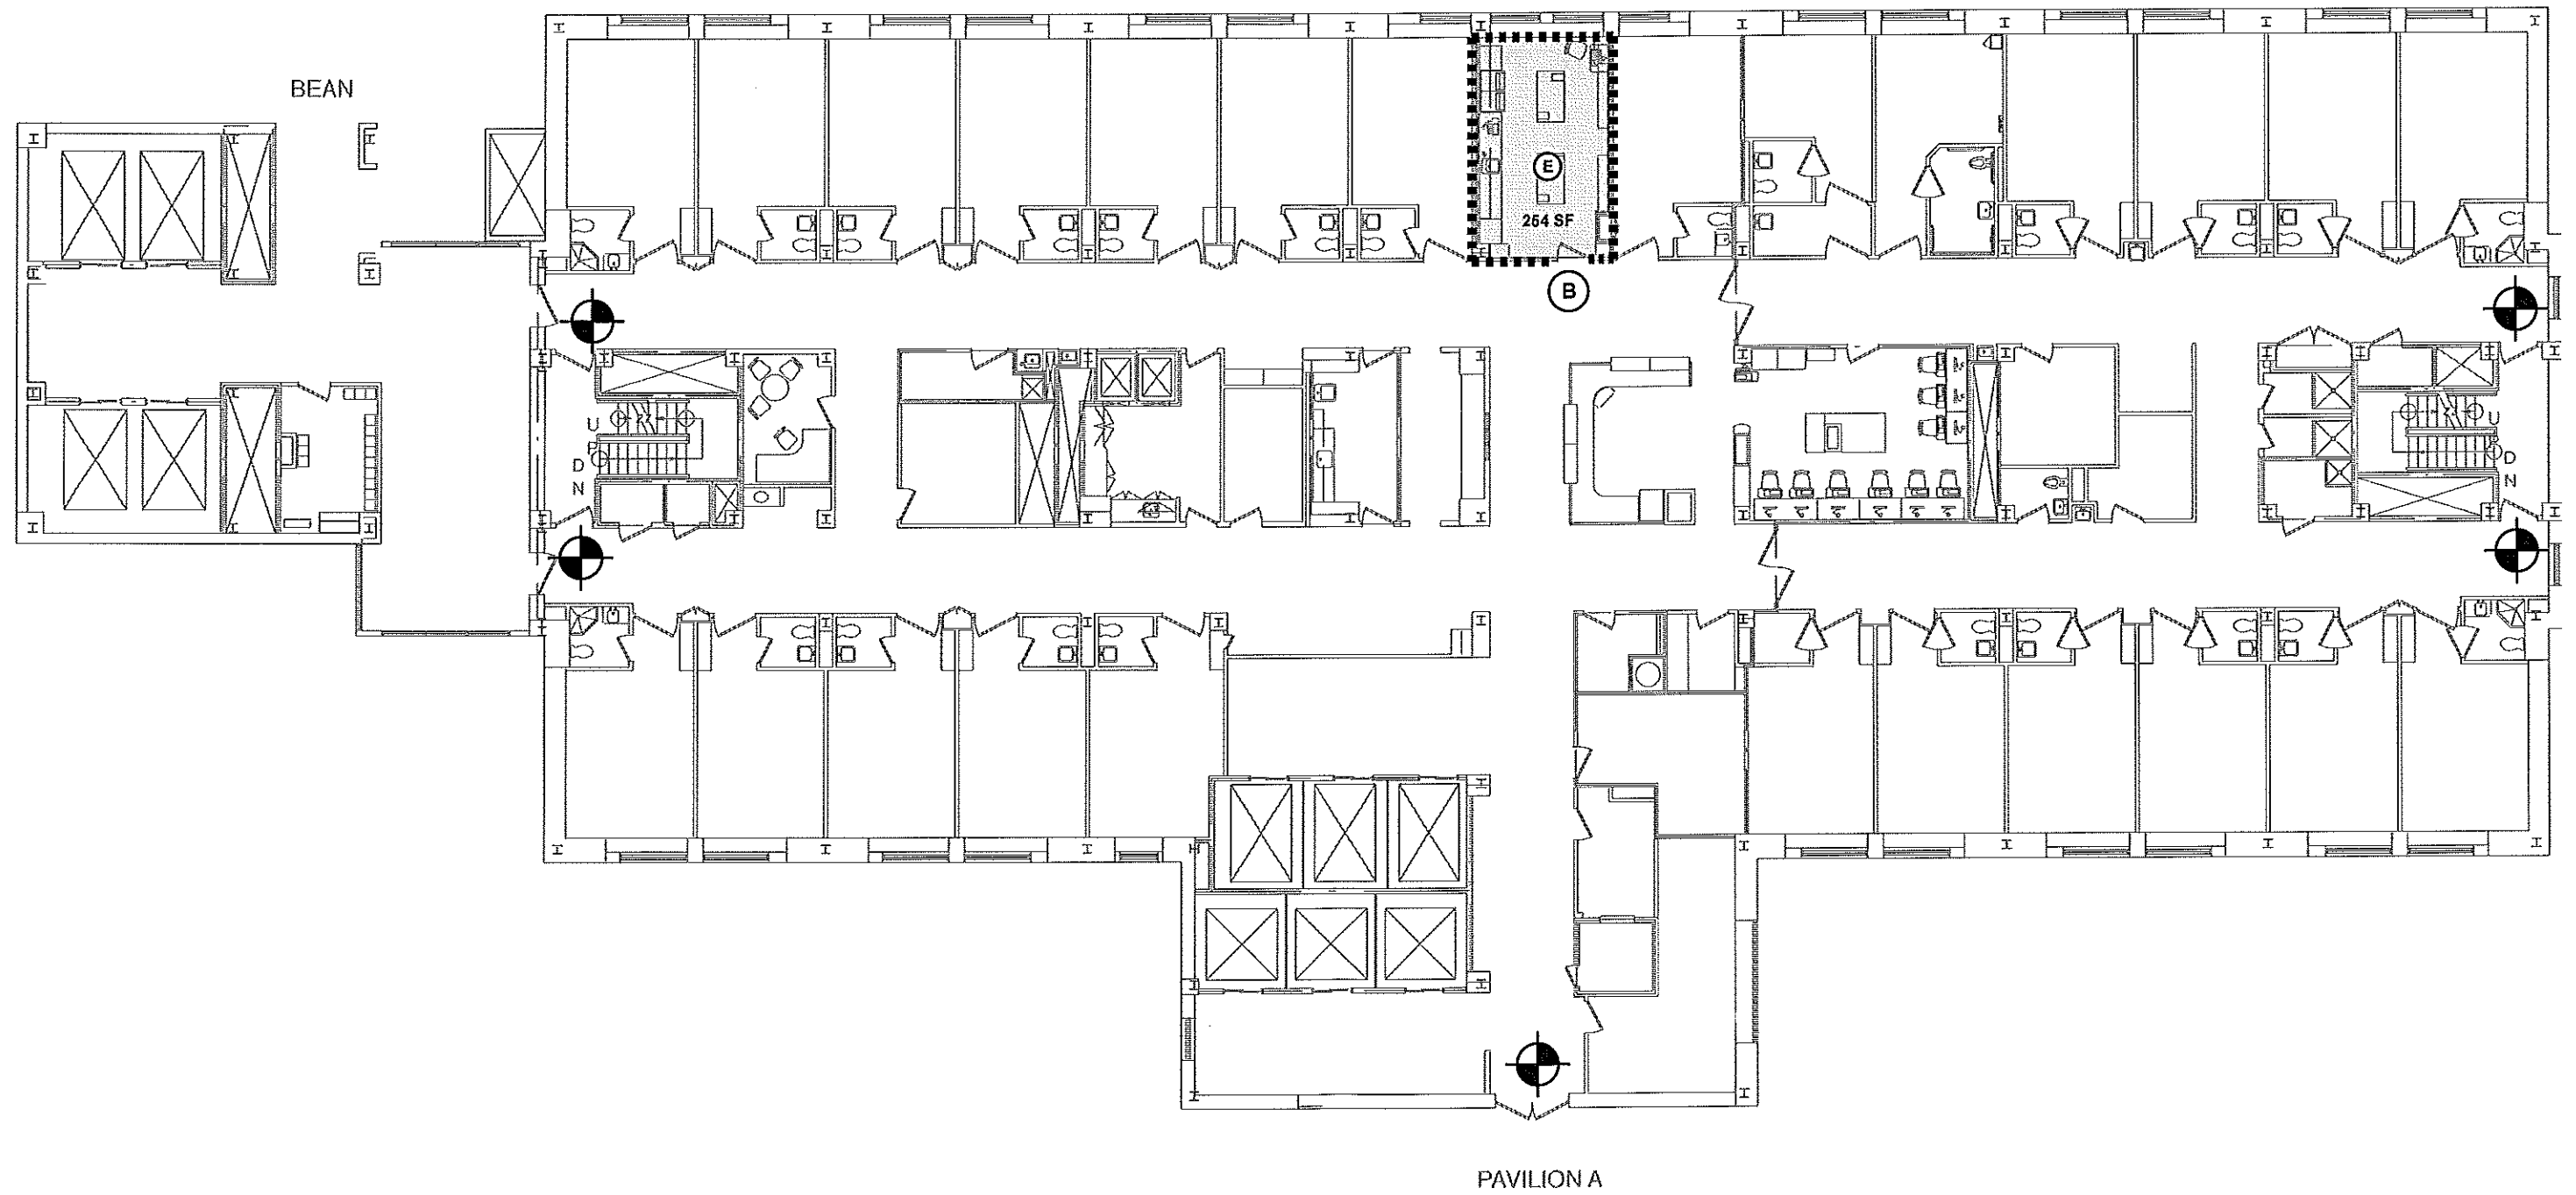

RICHARDS
FIFTH LEVEL

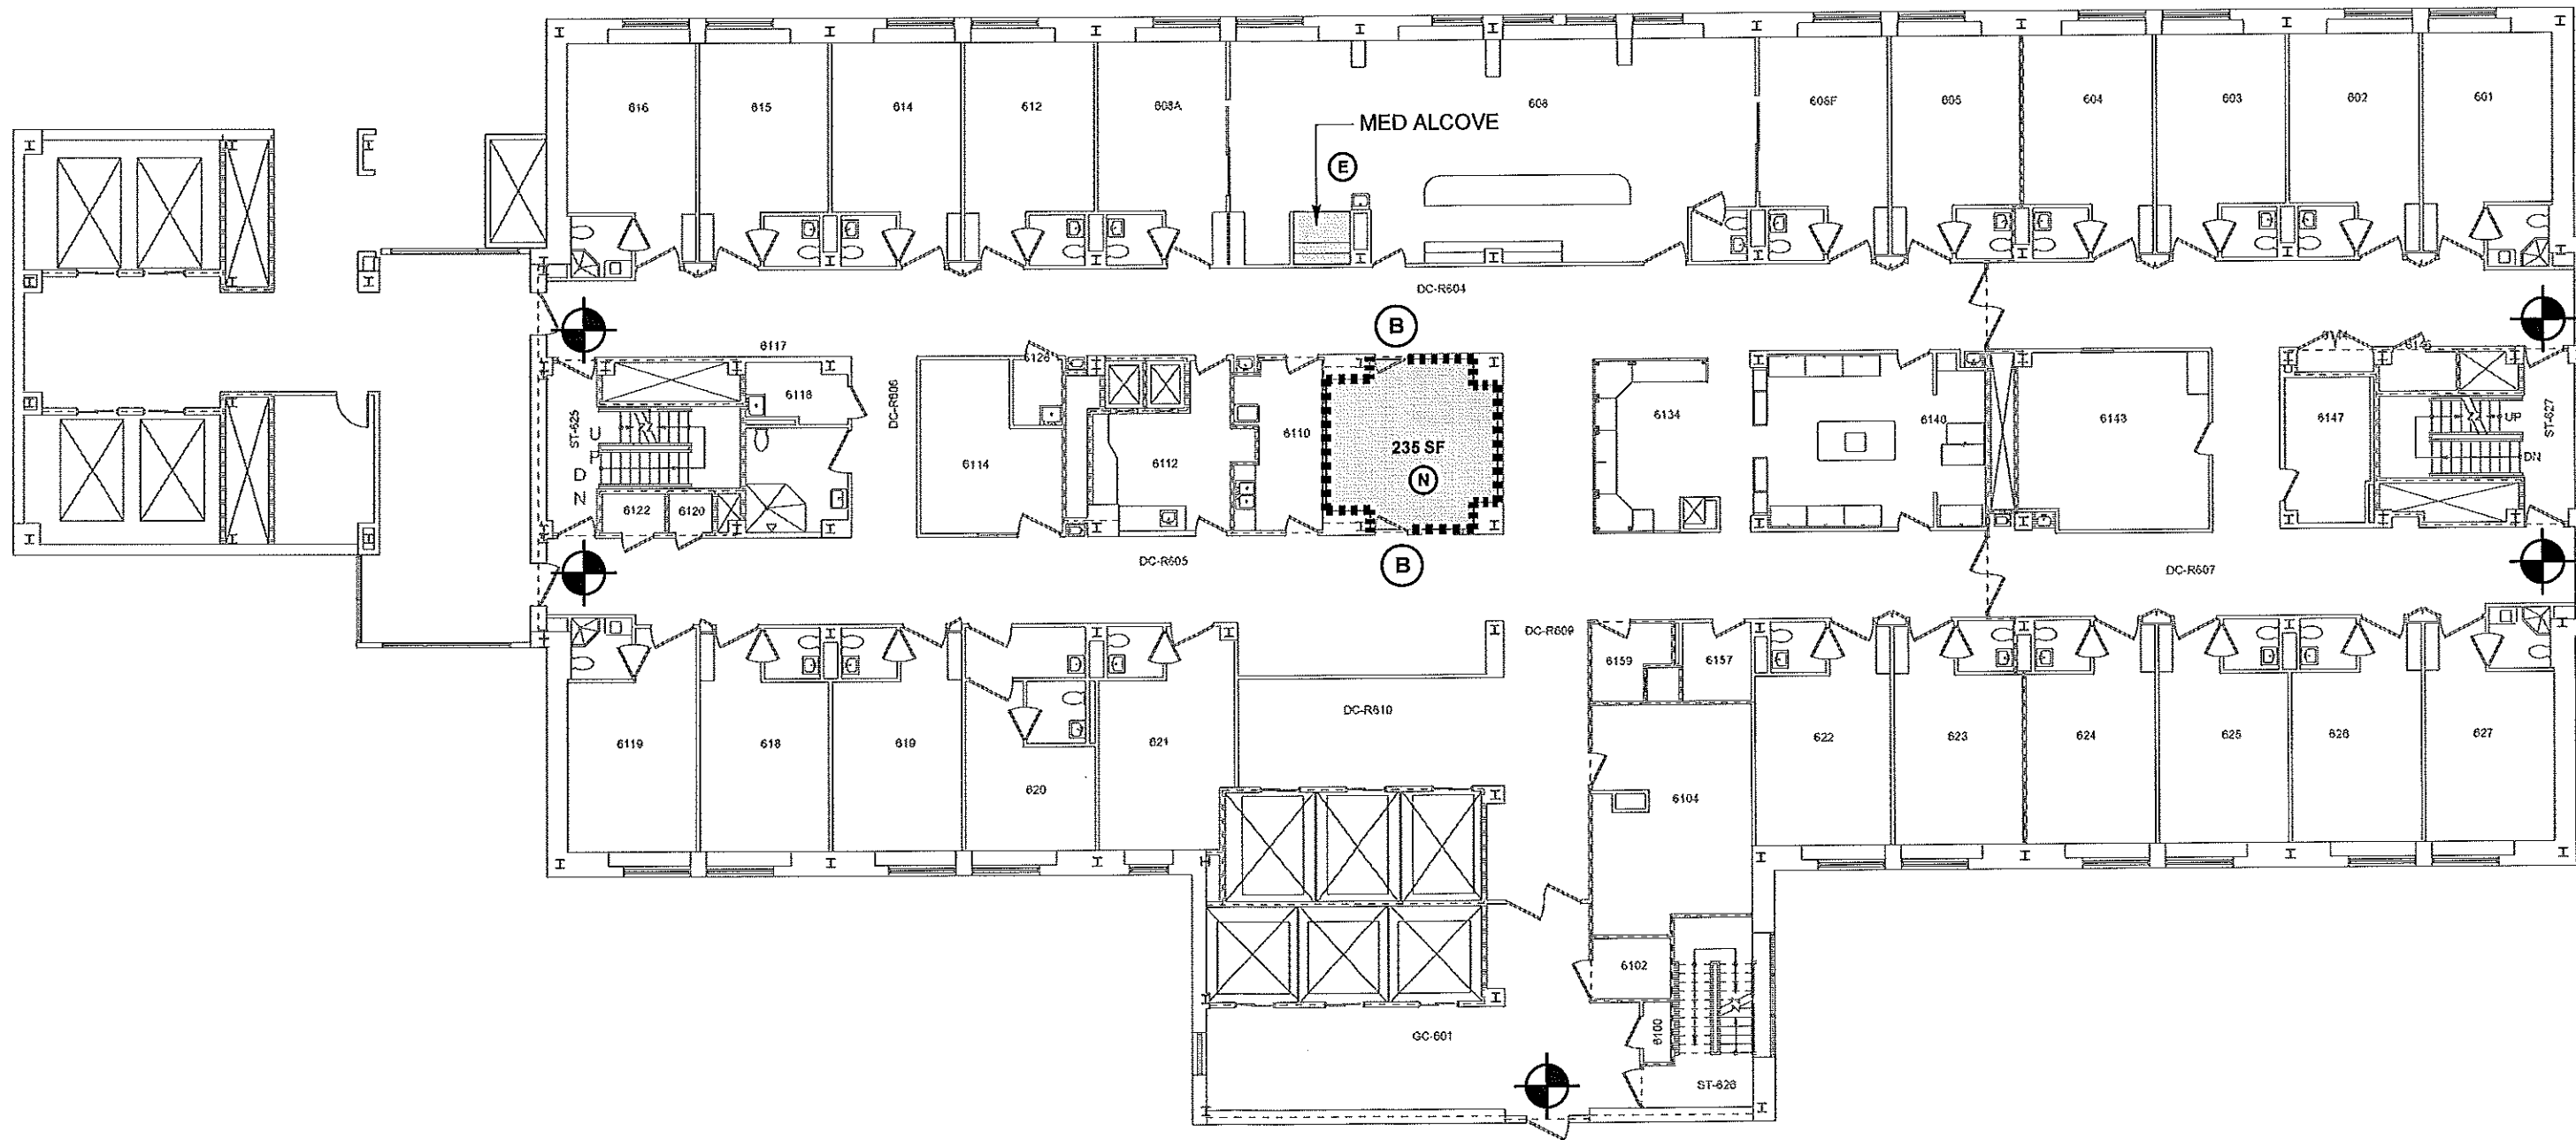


RICHARDS
SIXTH LEVEL

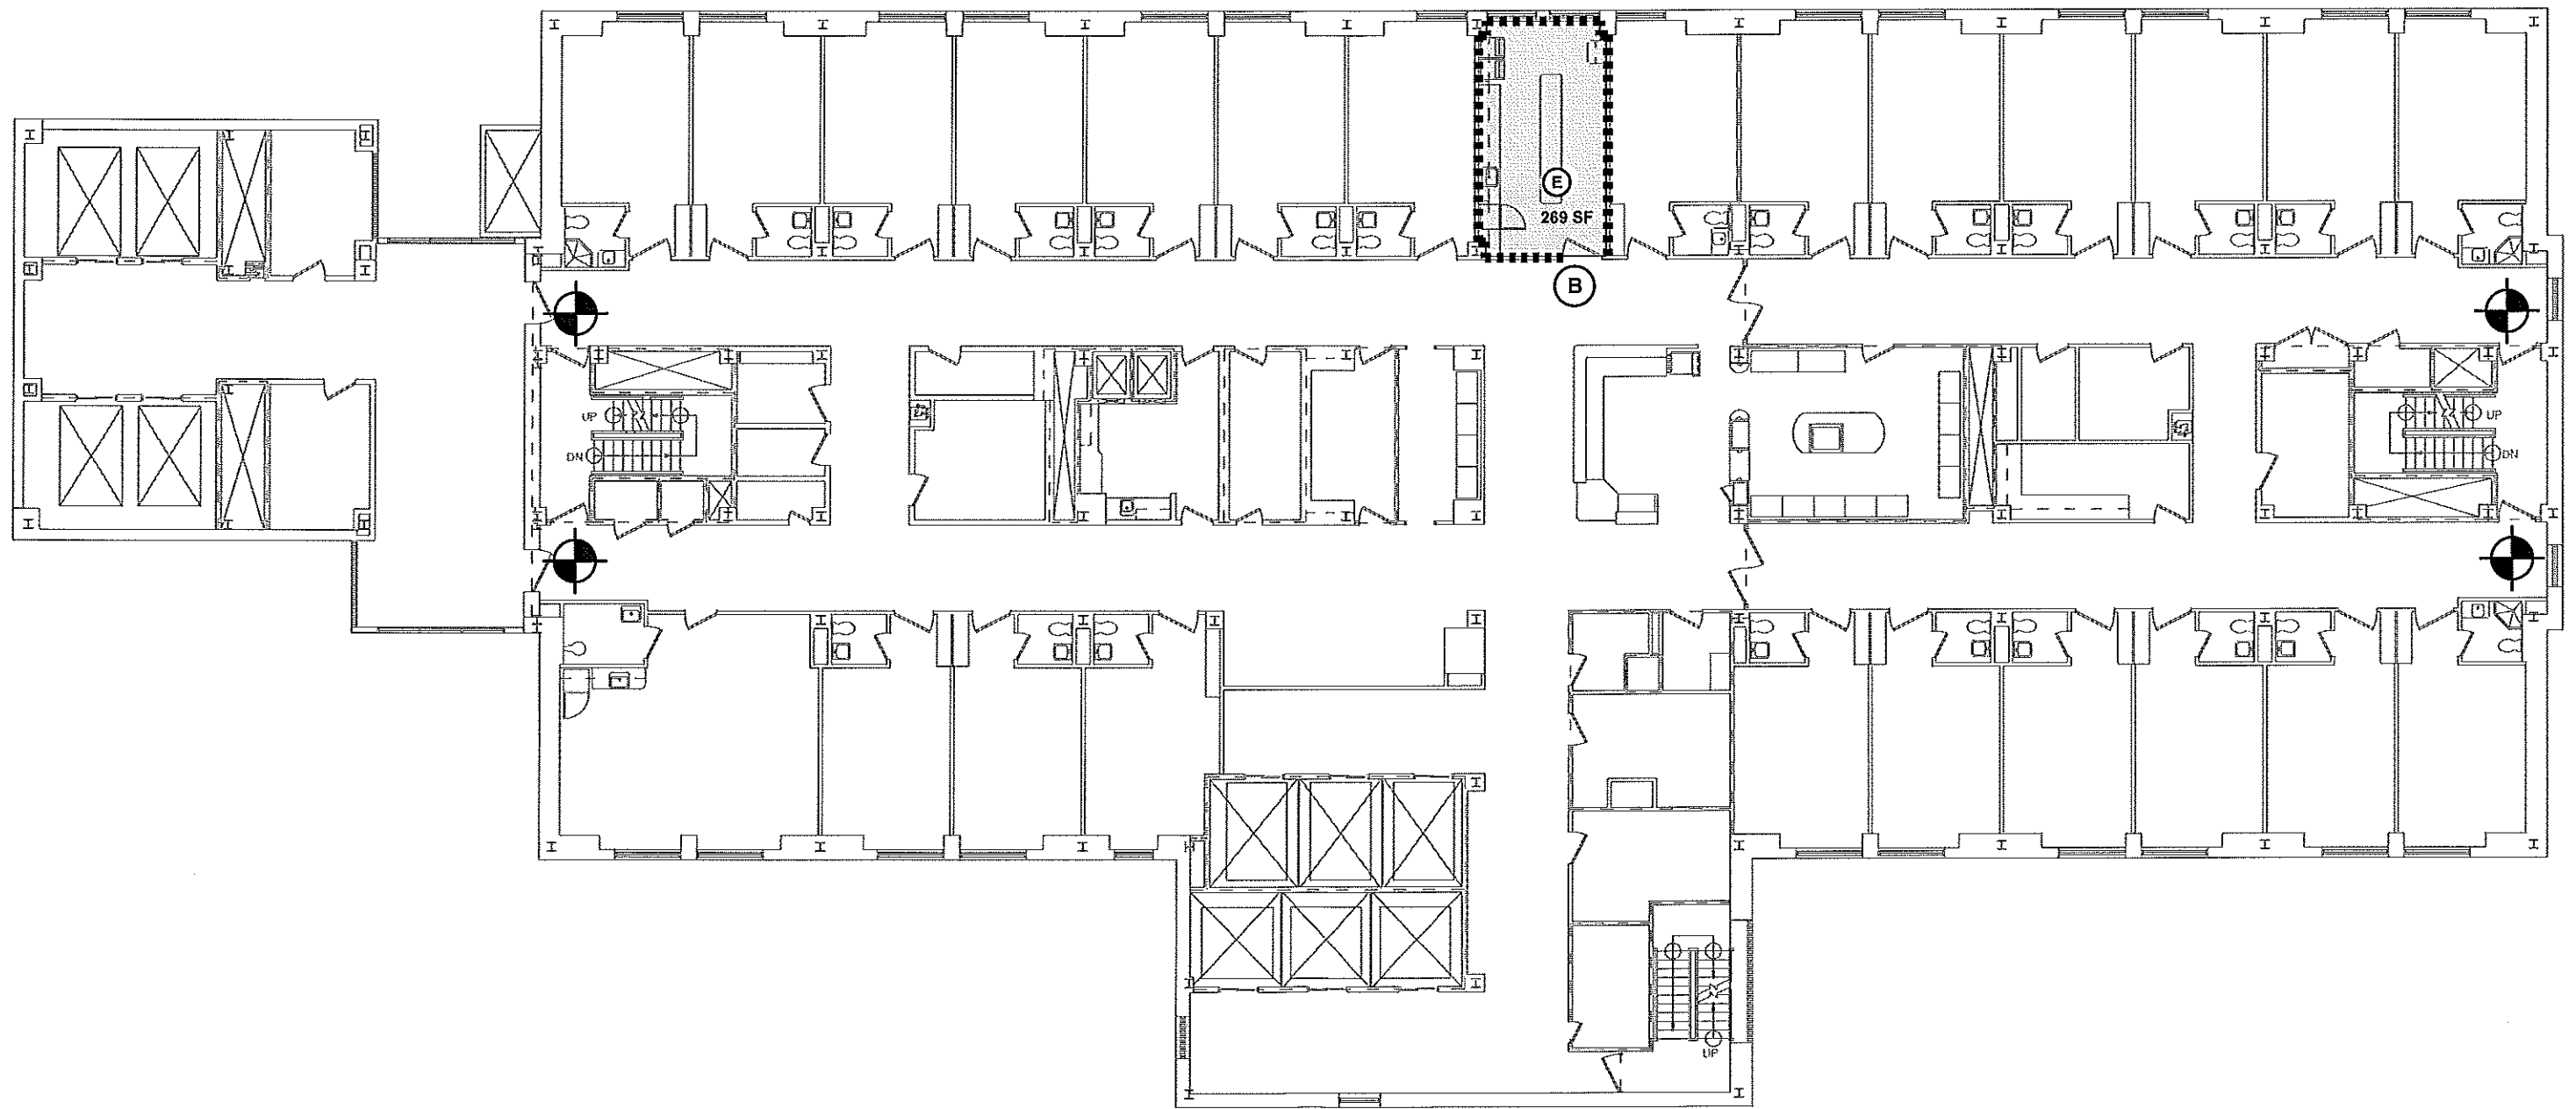

RICHARDS
SEVENTH LEVEL




**RICHARDS
NINTH LEVEL**

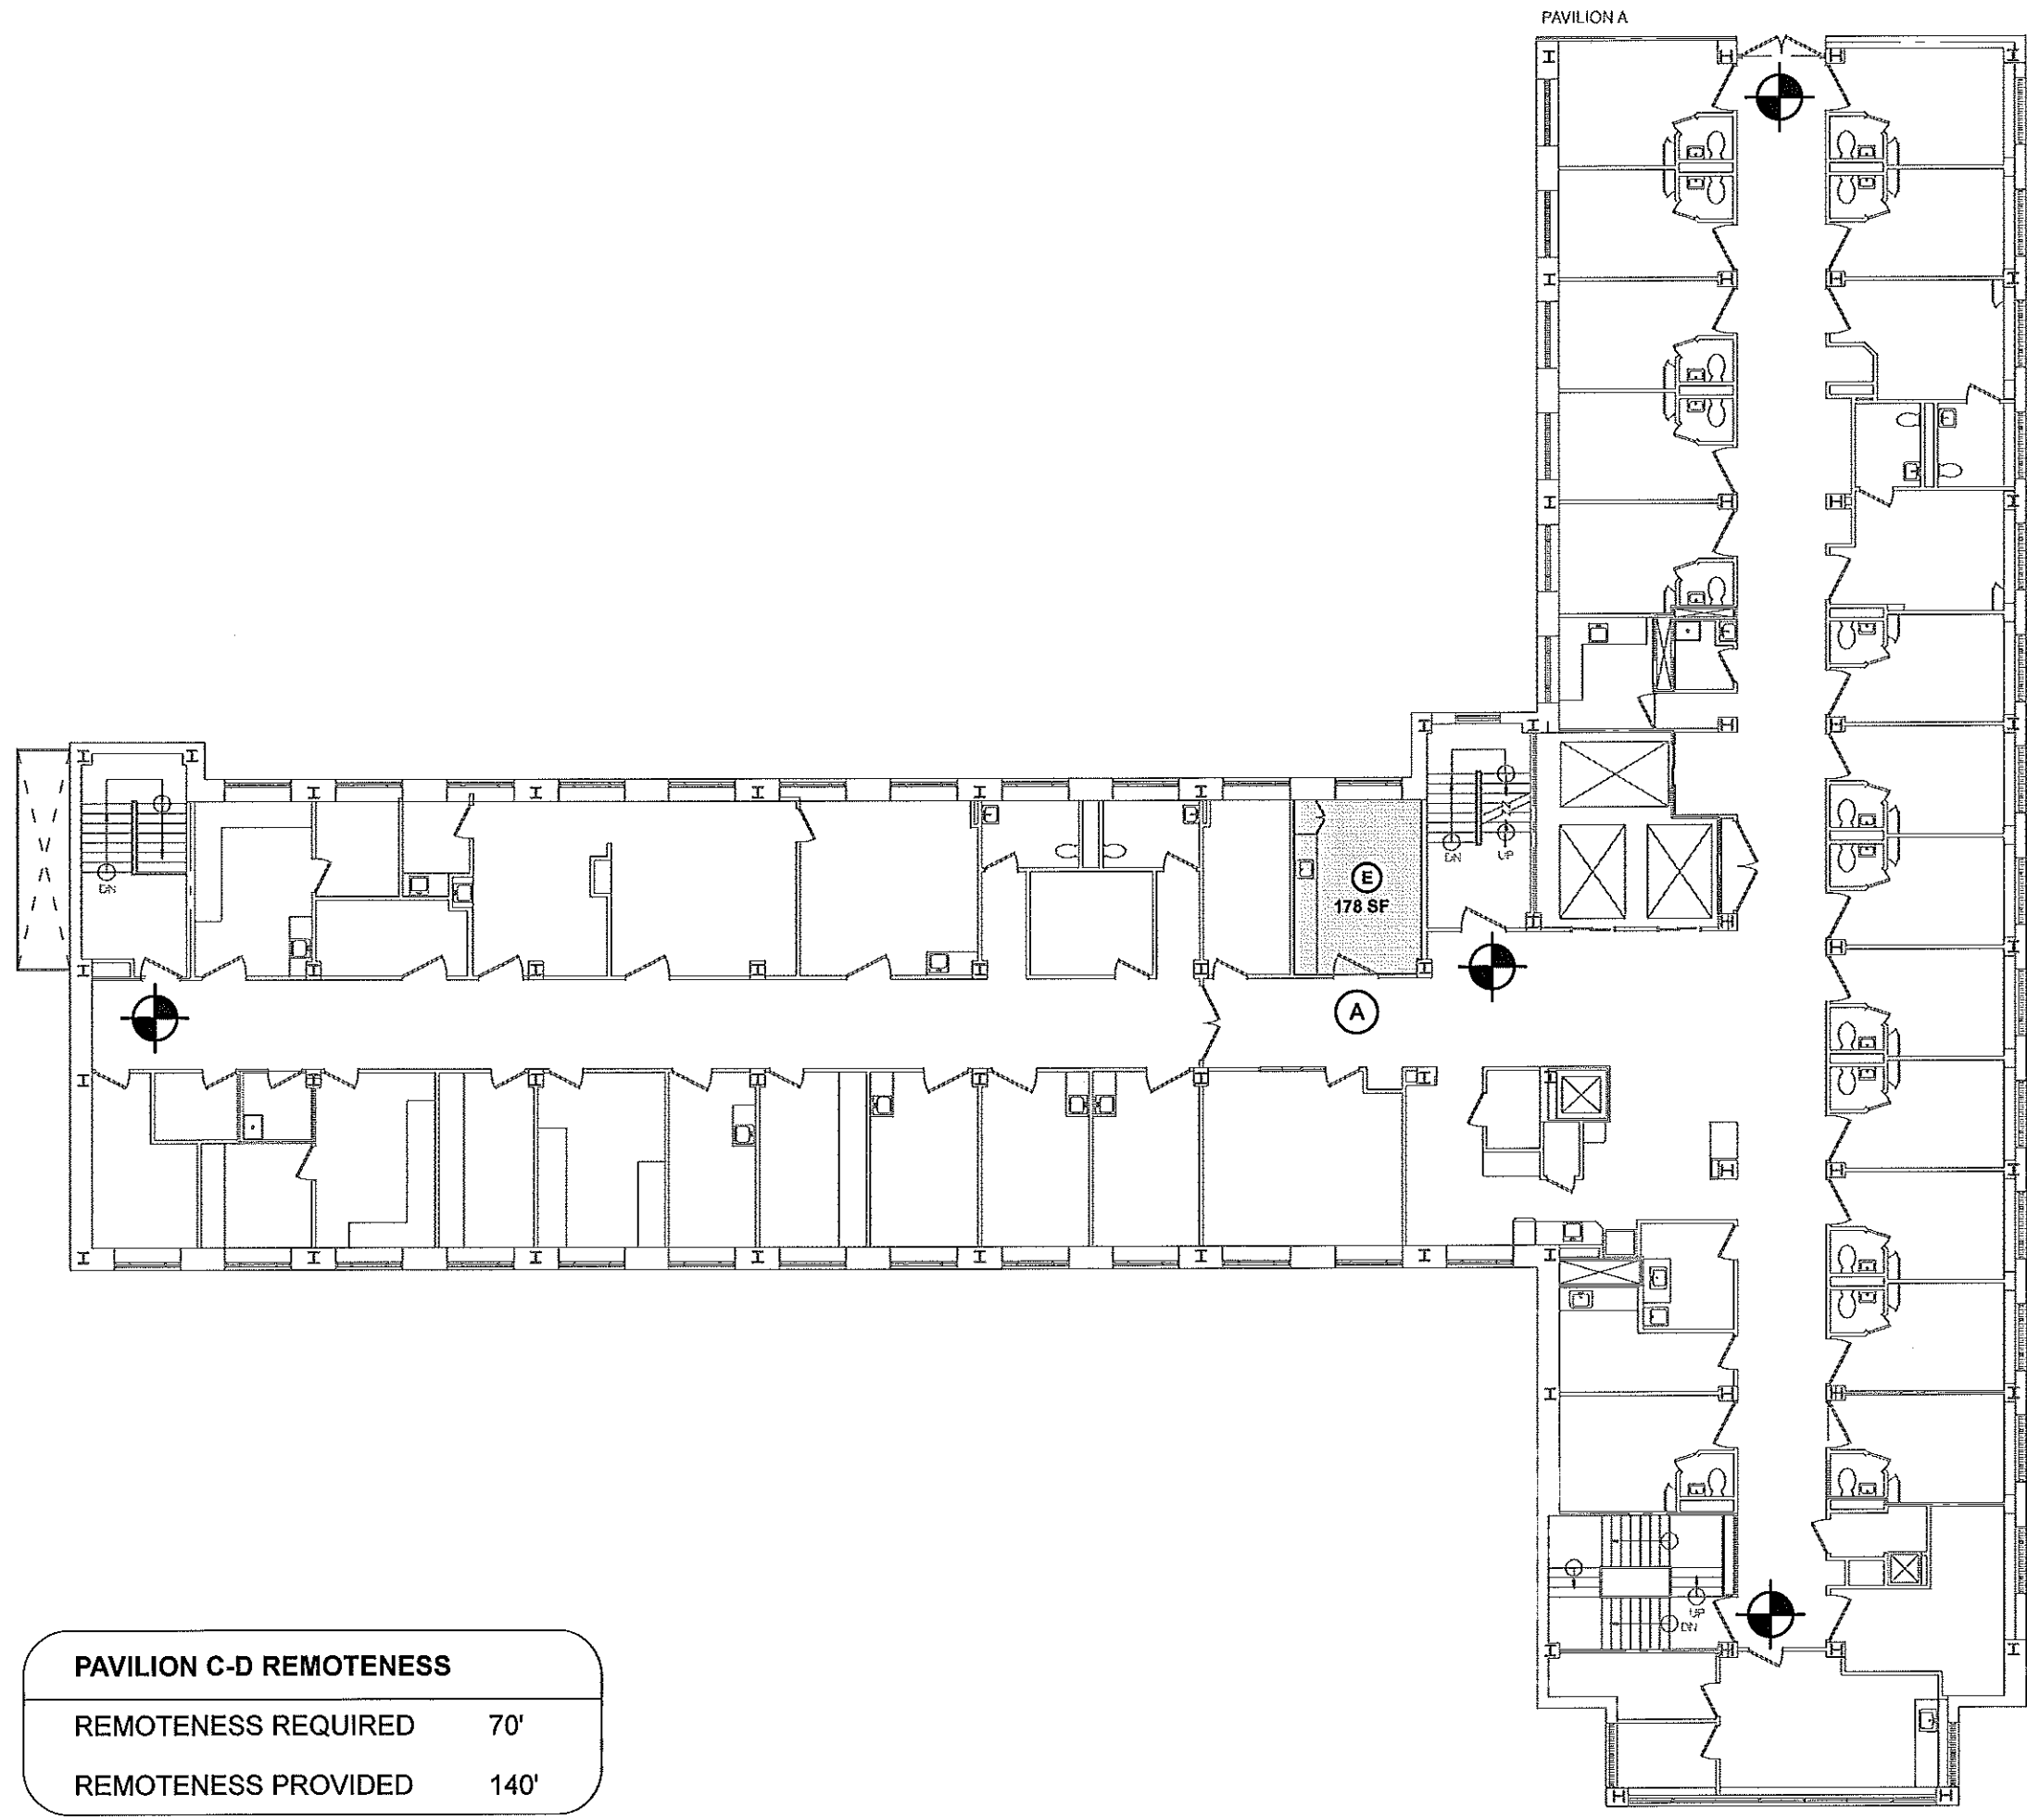


PAVILION C-D REMOTENESS	
RE MOTENESS REQUIRED	70'
RE MOTENESS PROVIDED	140'

PAVILION C & D
SECOND LEVEL

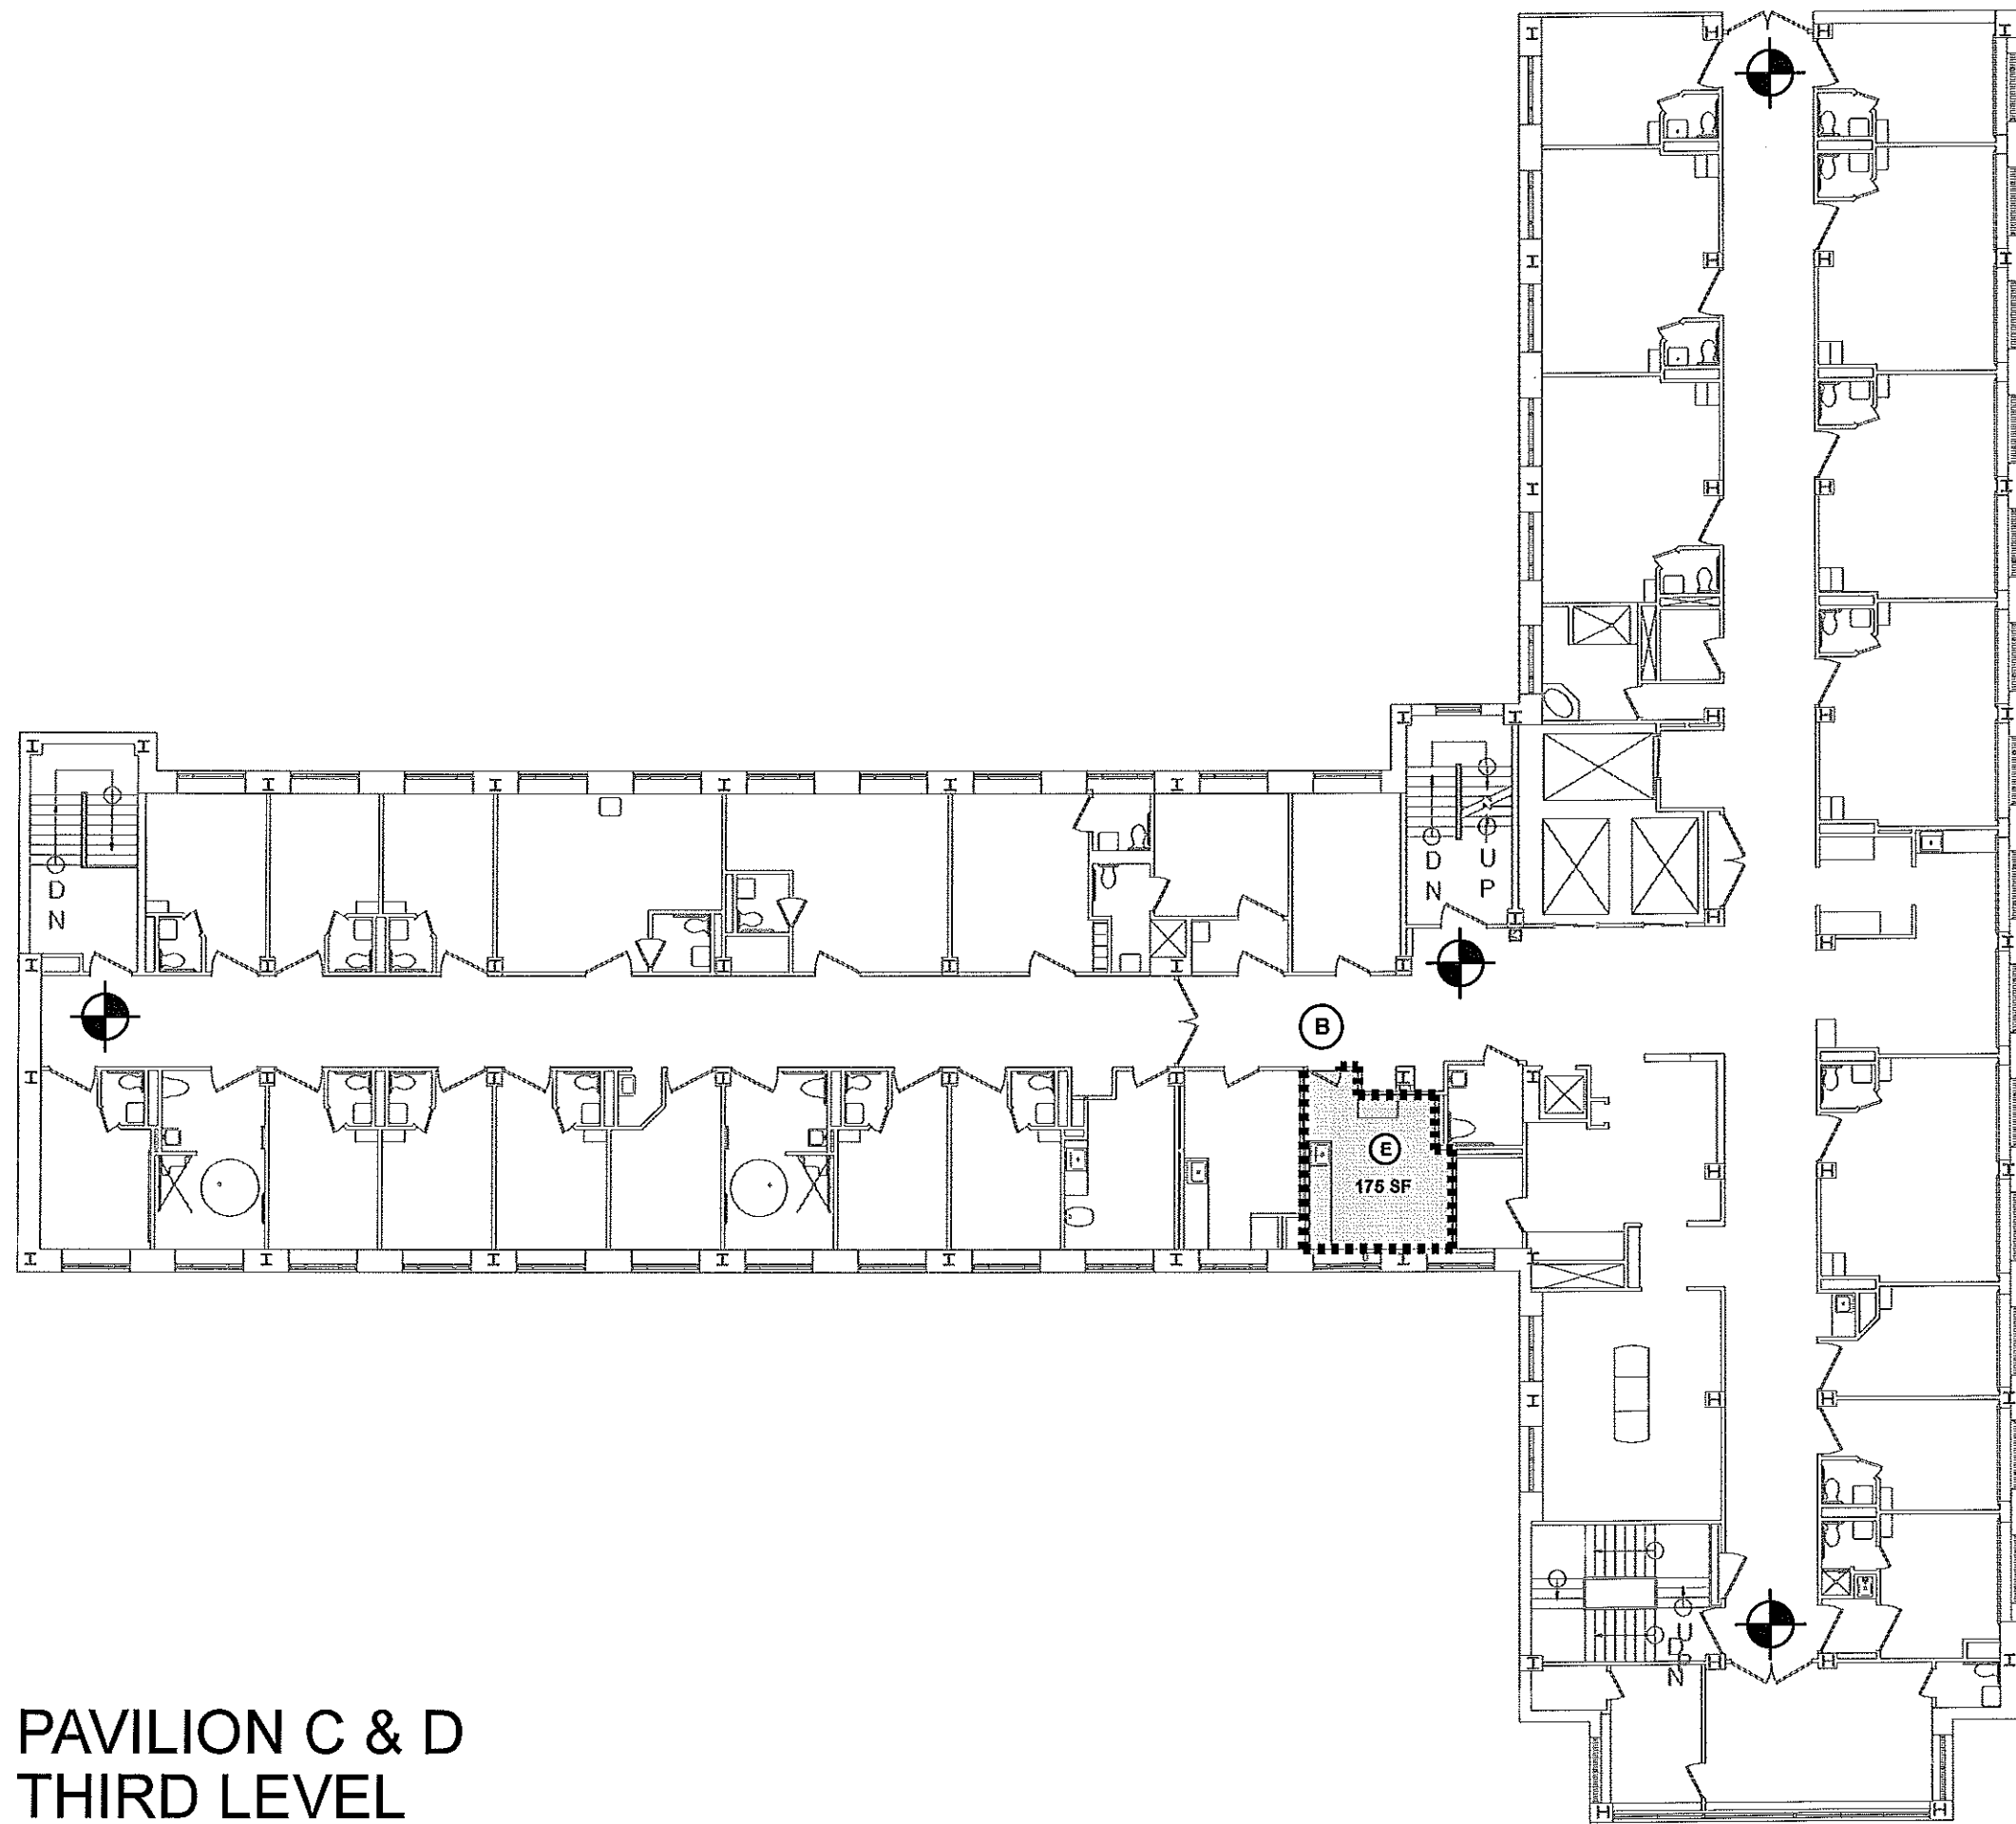



PAVILION C & D
THIRD LEVEL

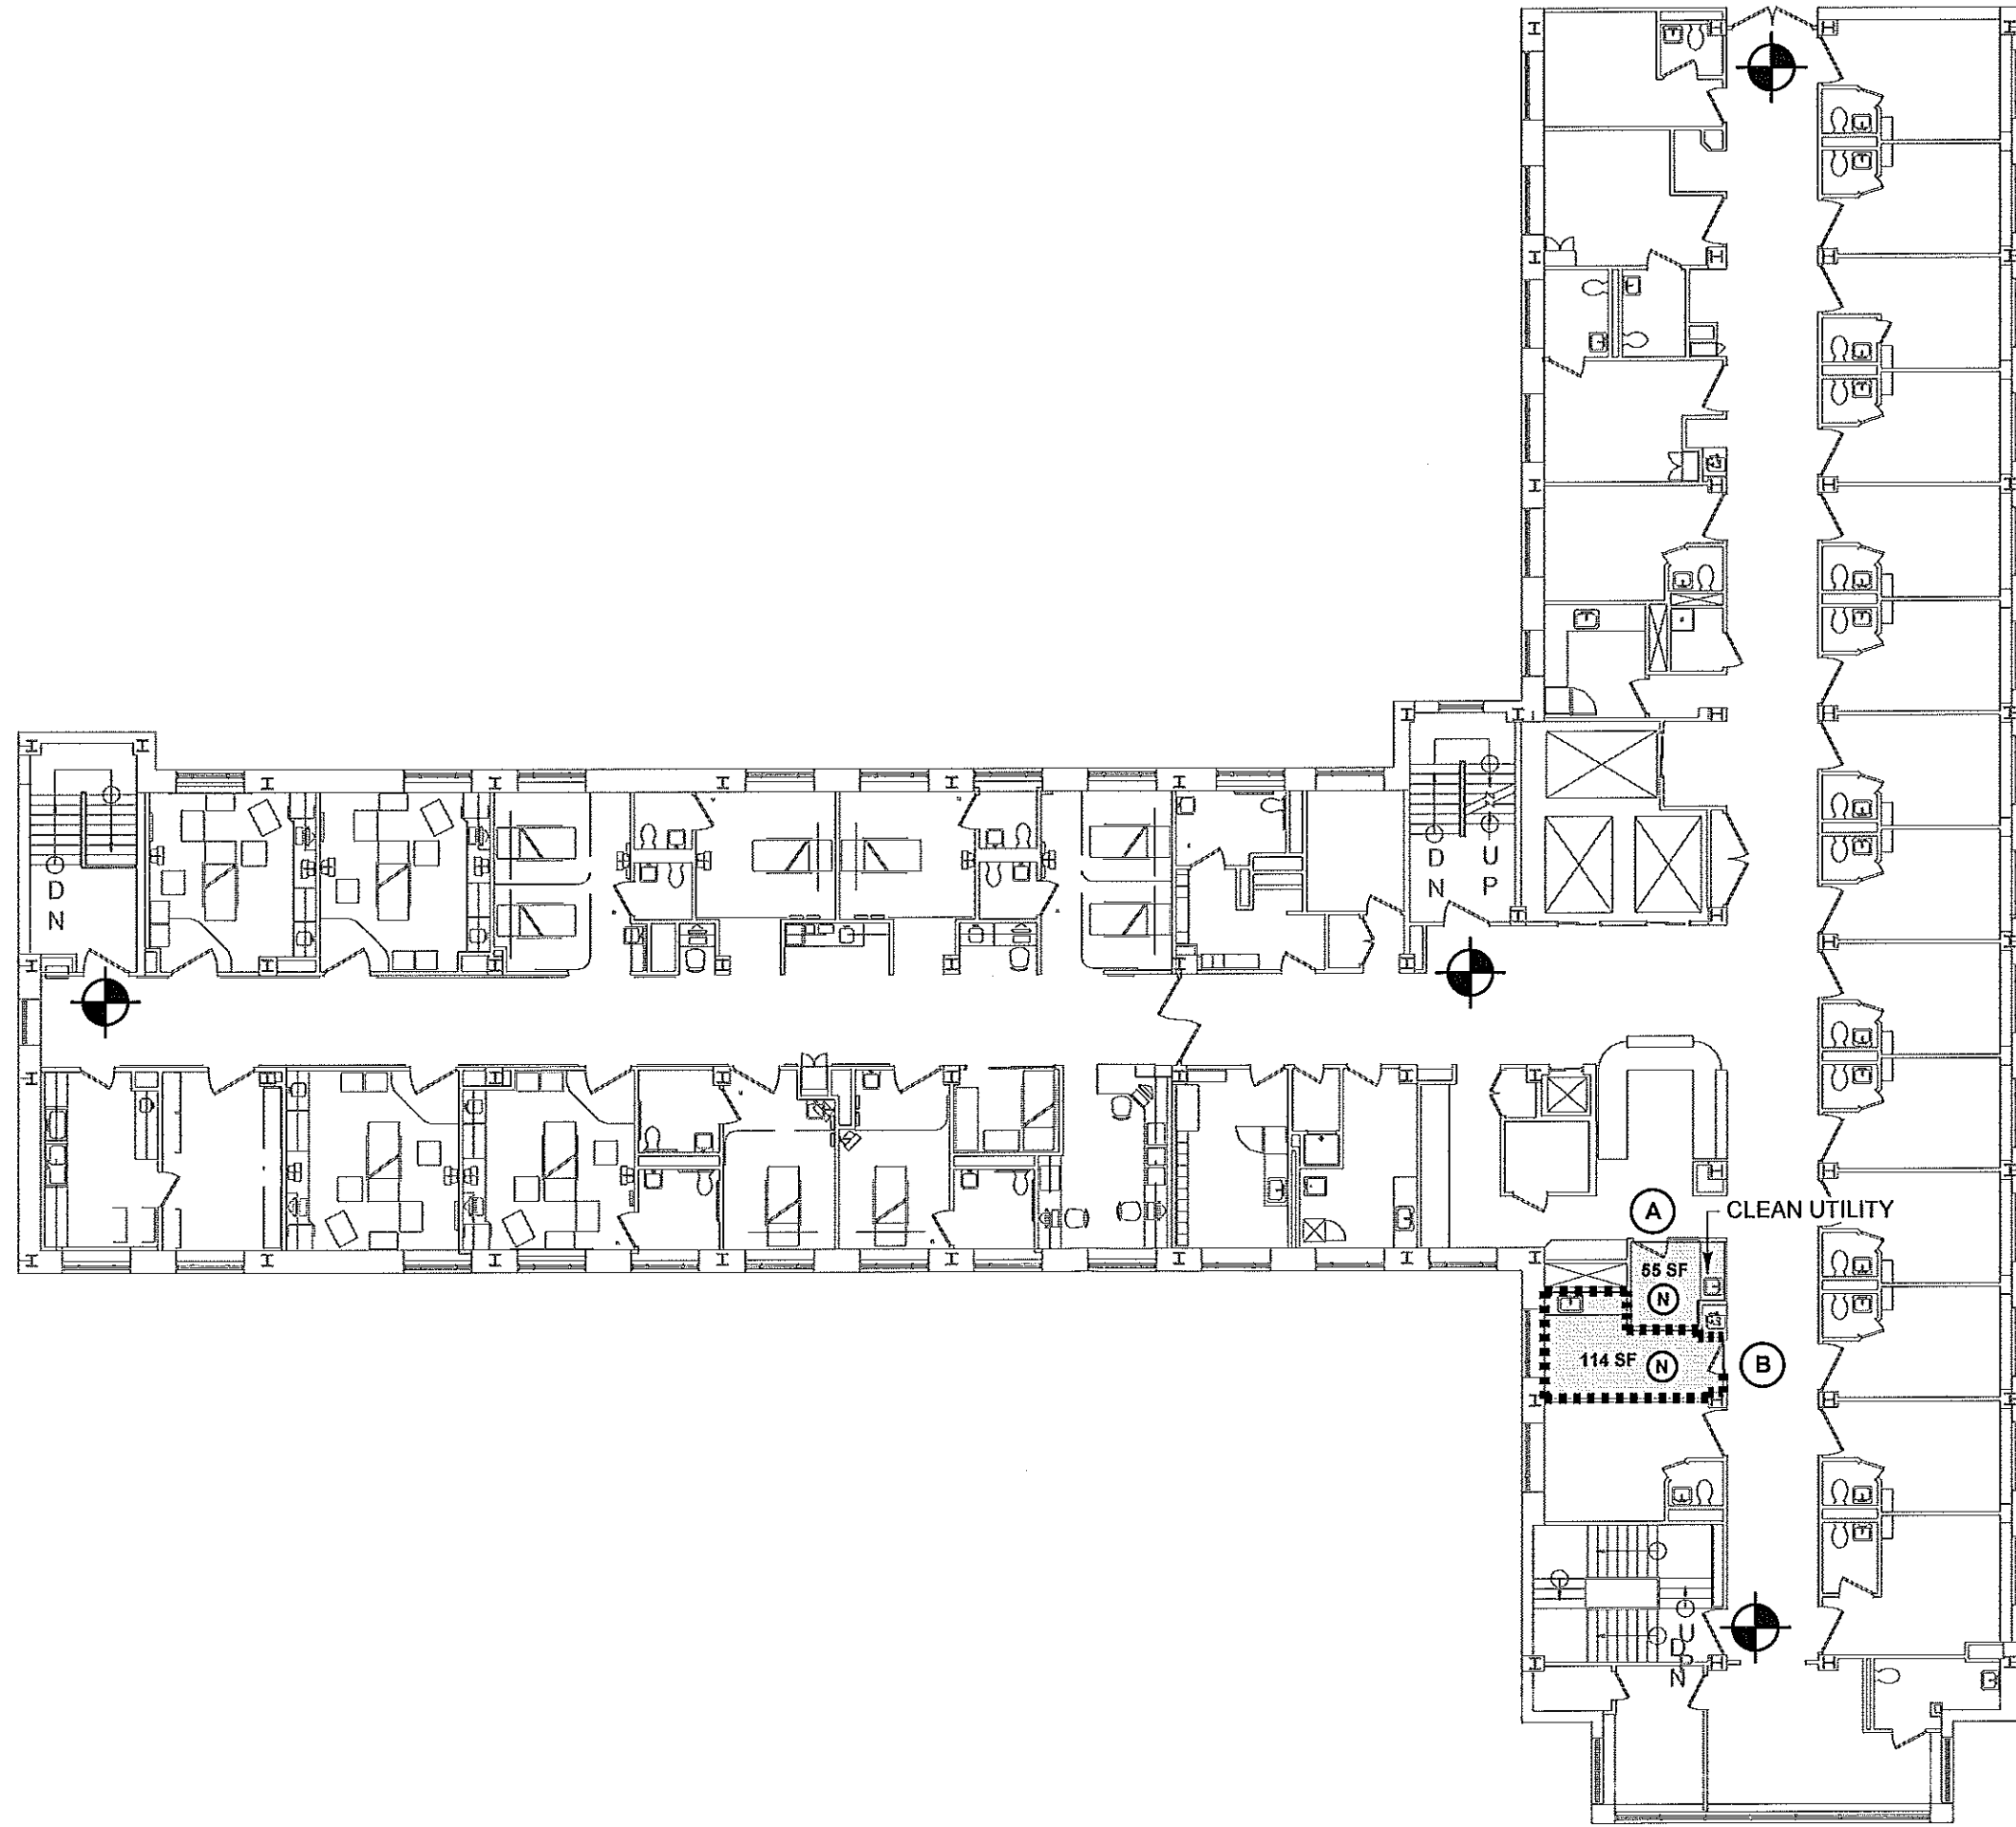

PAVILION C & D
FOURTH LEVEL


PAVILION C
SIXTH LEVEL

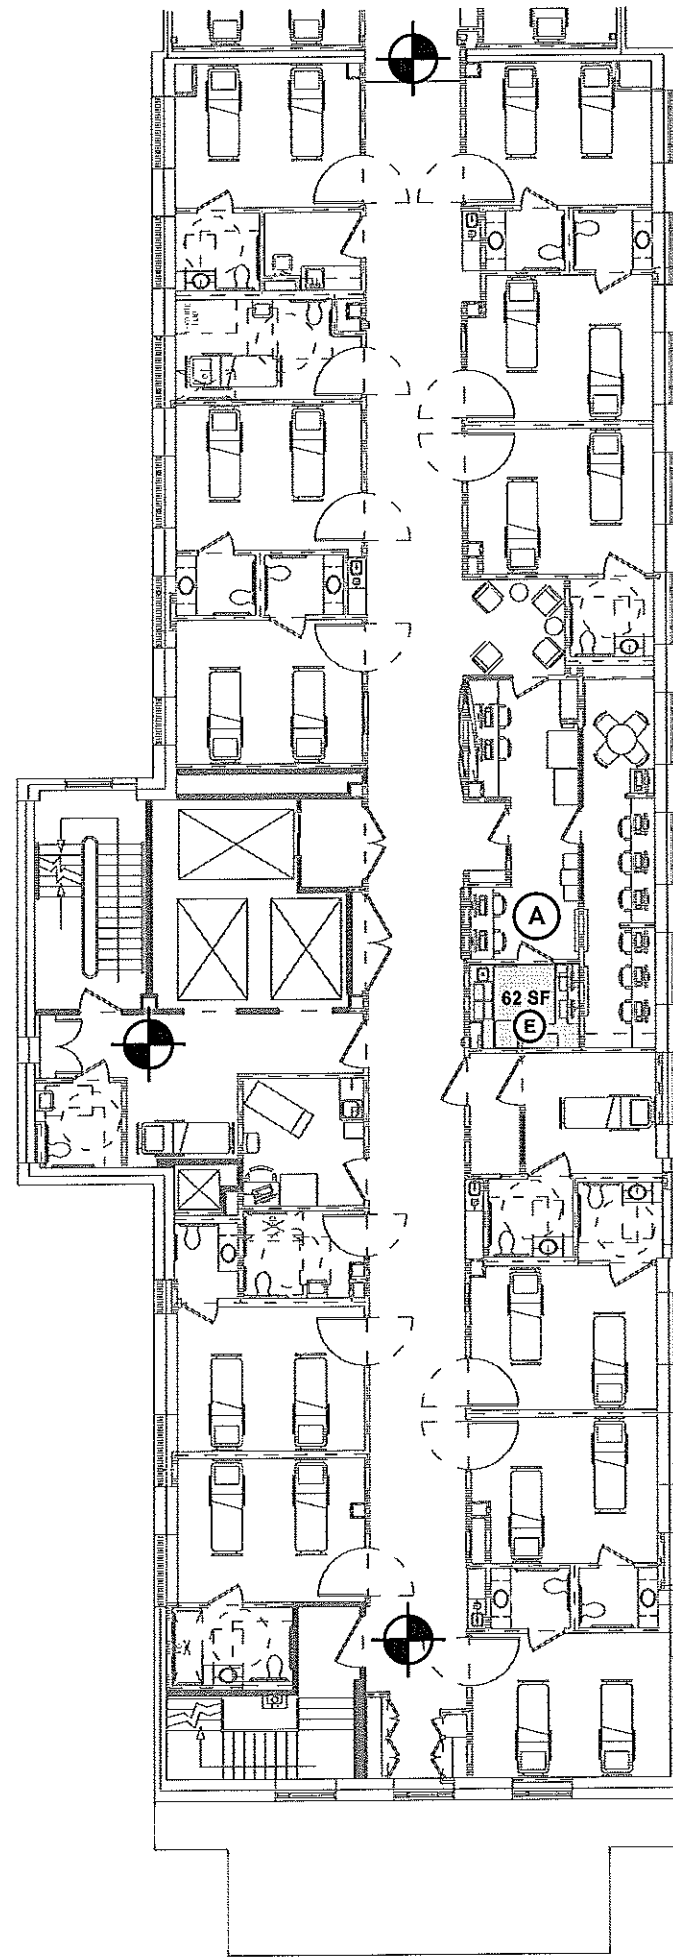

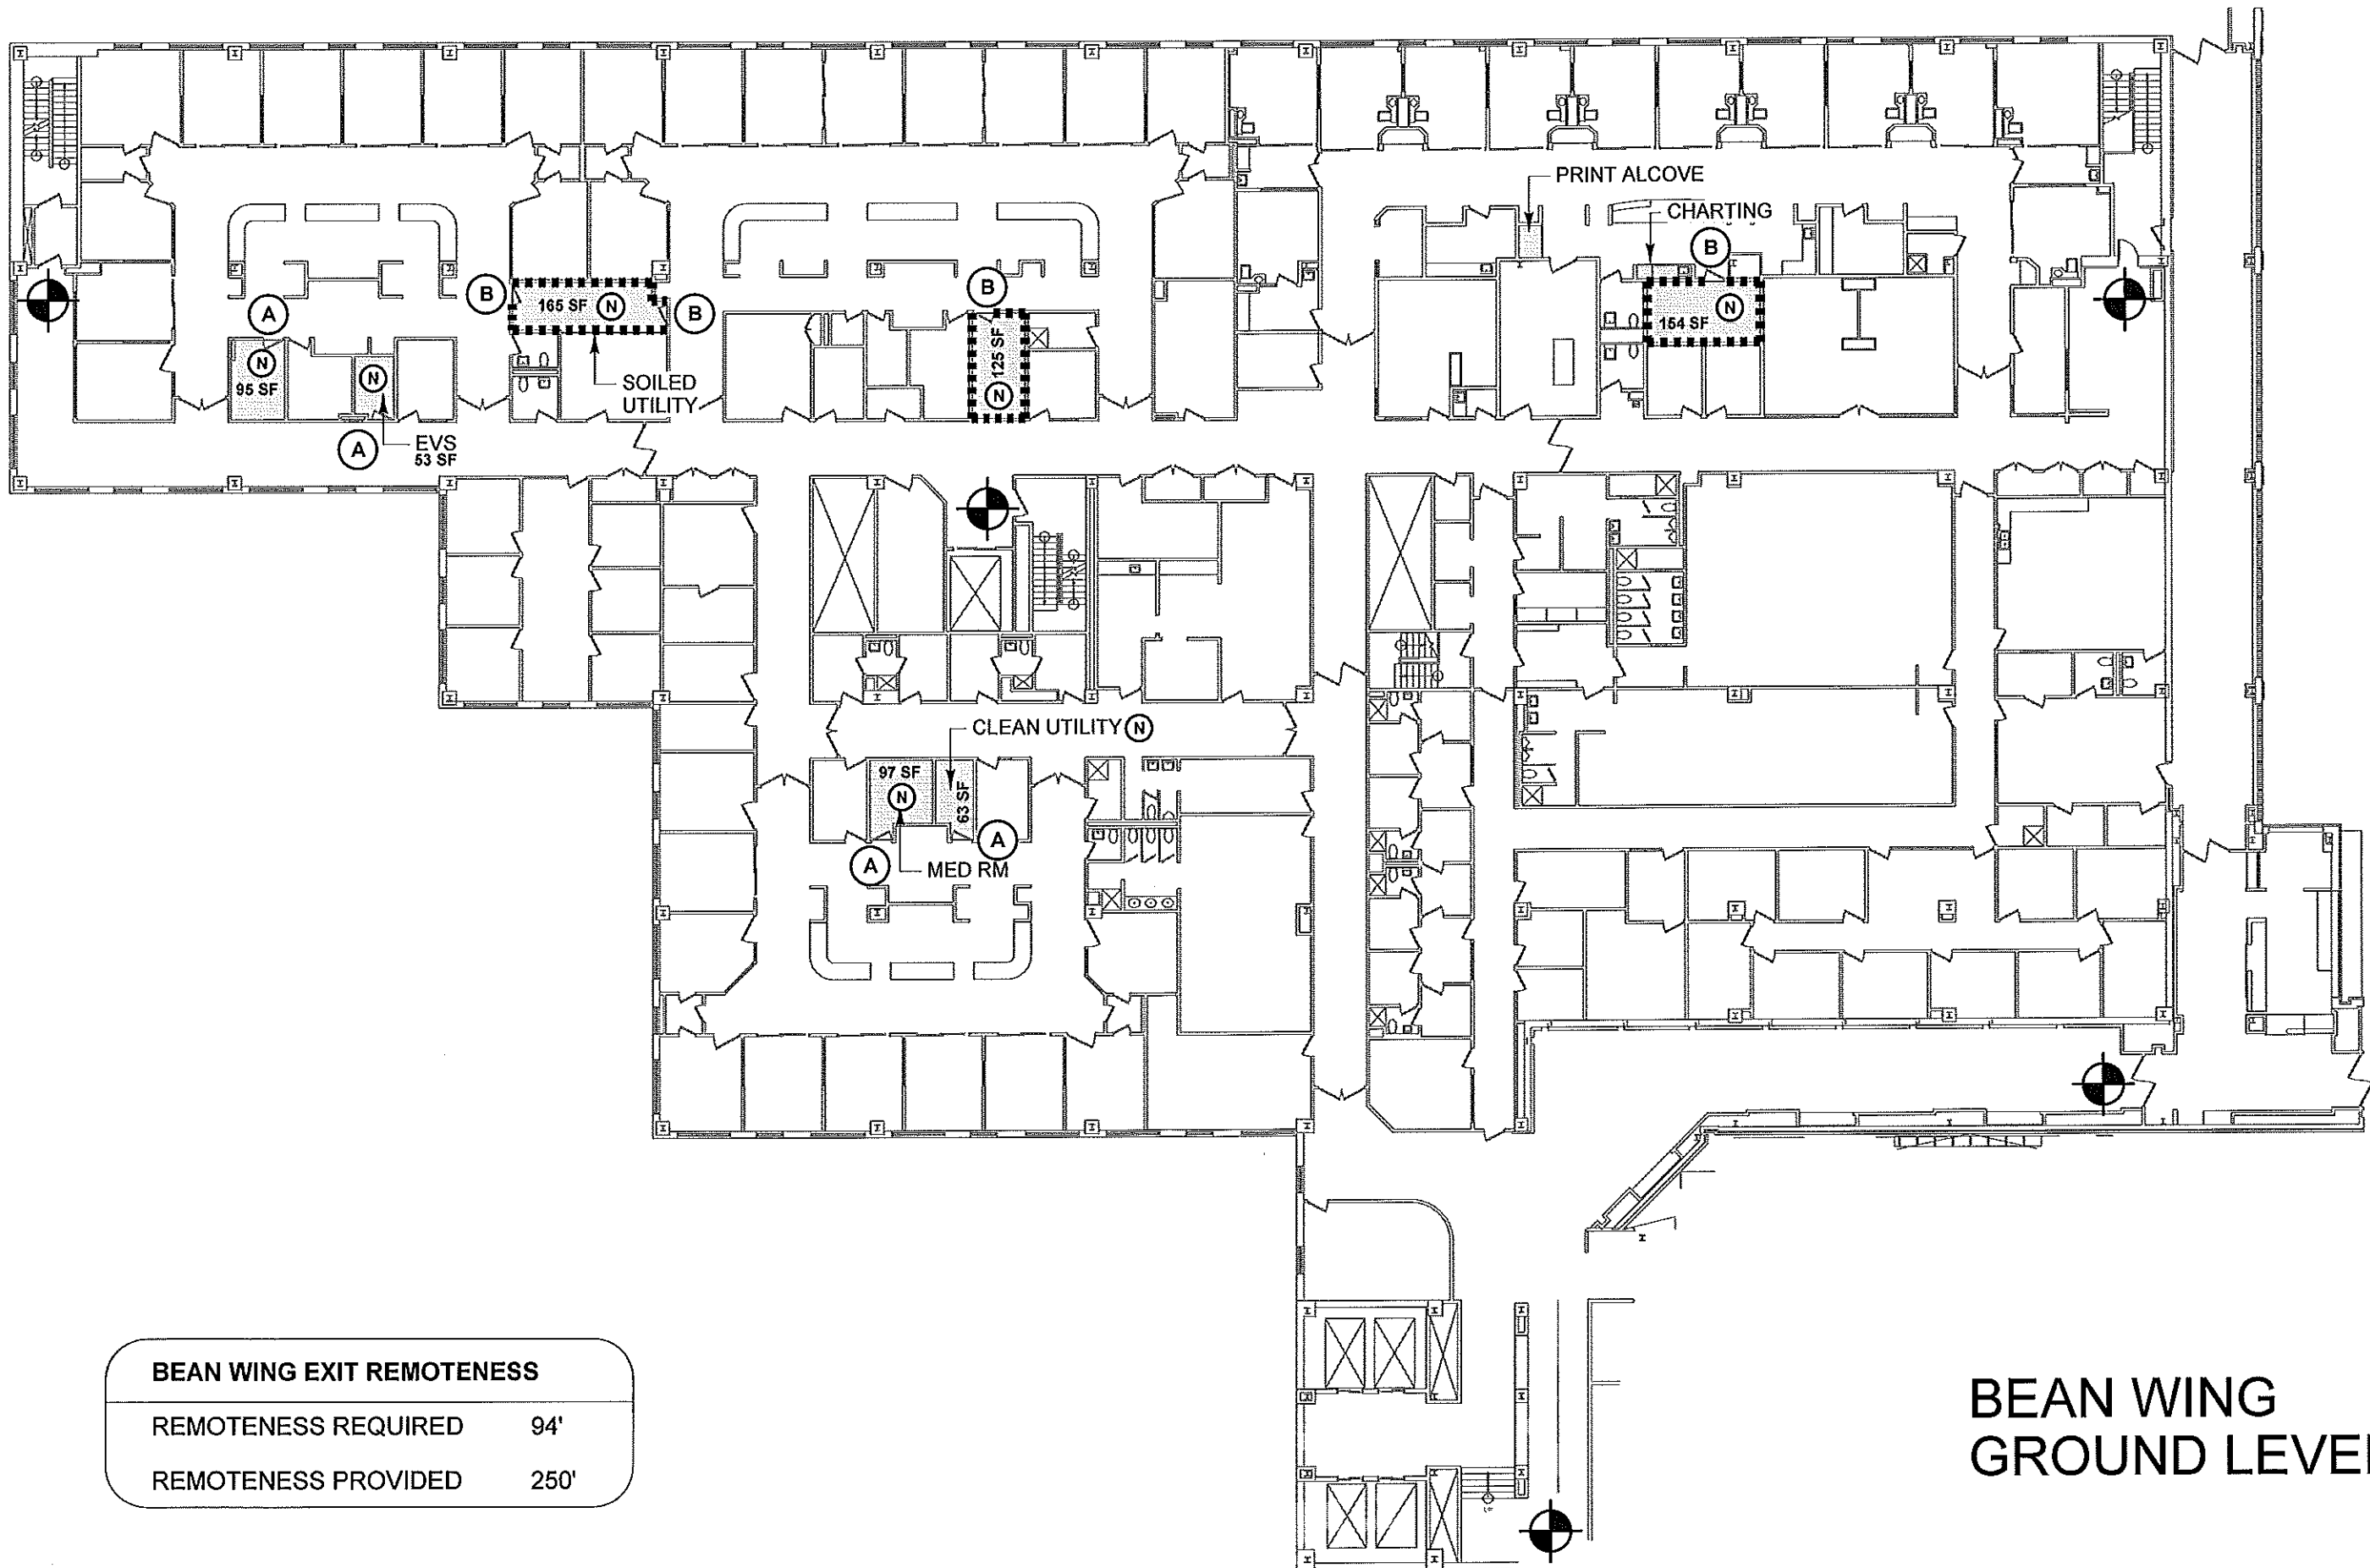


BEAN WING EXIT REMOTENESS	
REMTENESS REQUIRED	94'
REMTENESS PROVIDED	250'


BEAN WING
GROUND LEVEL

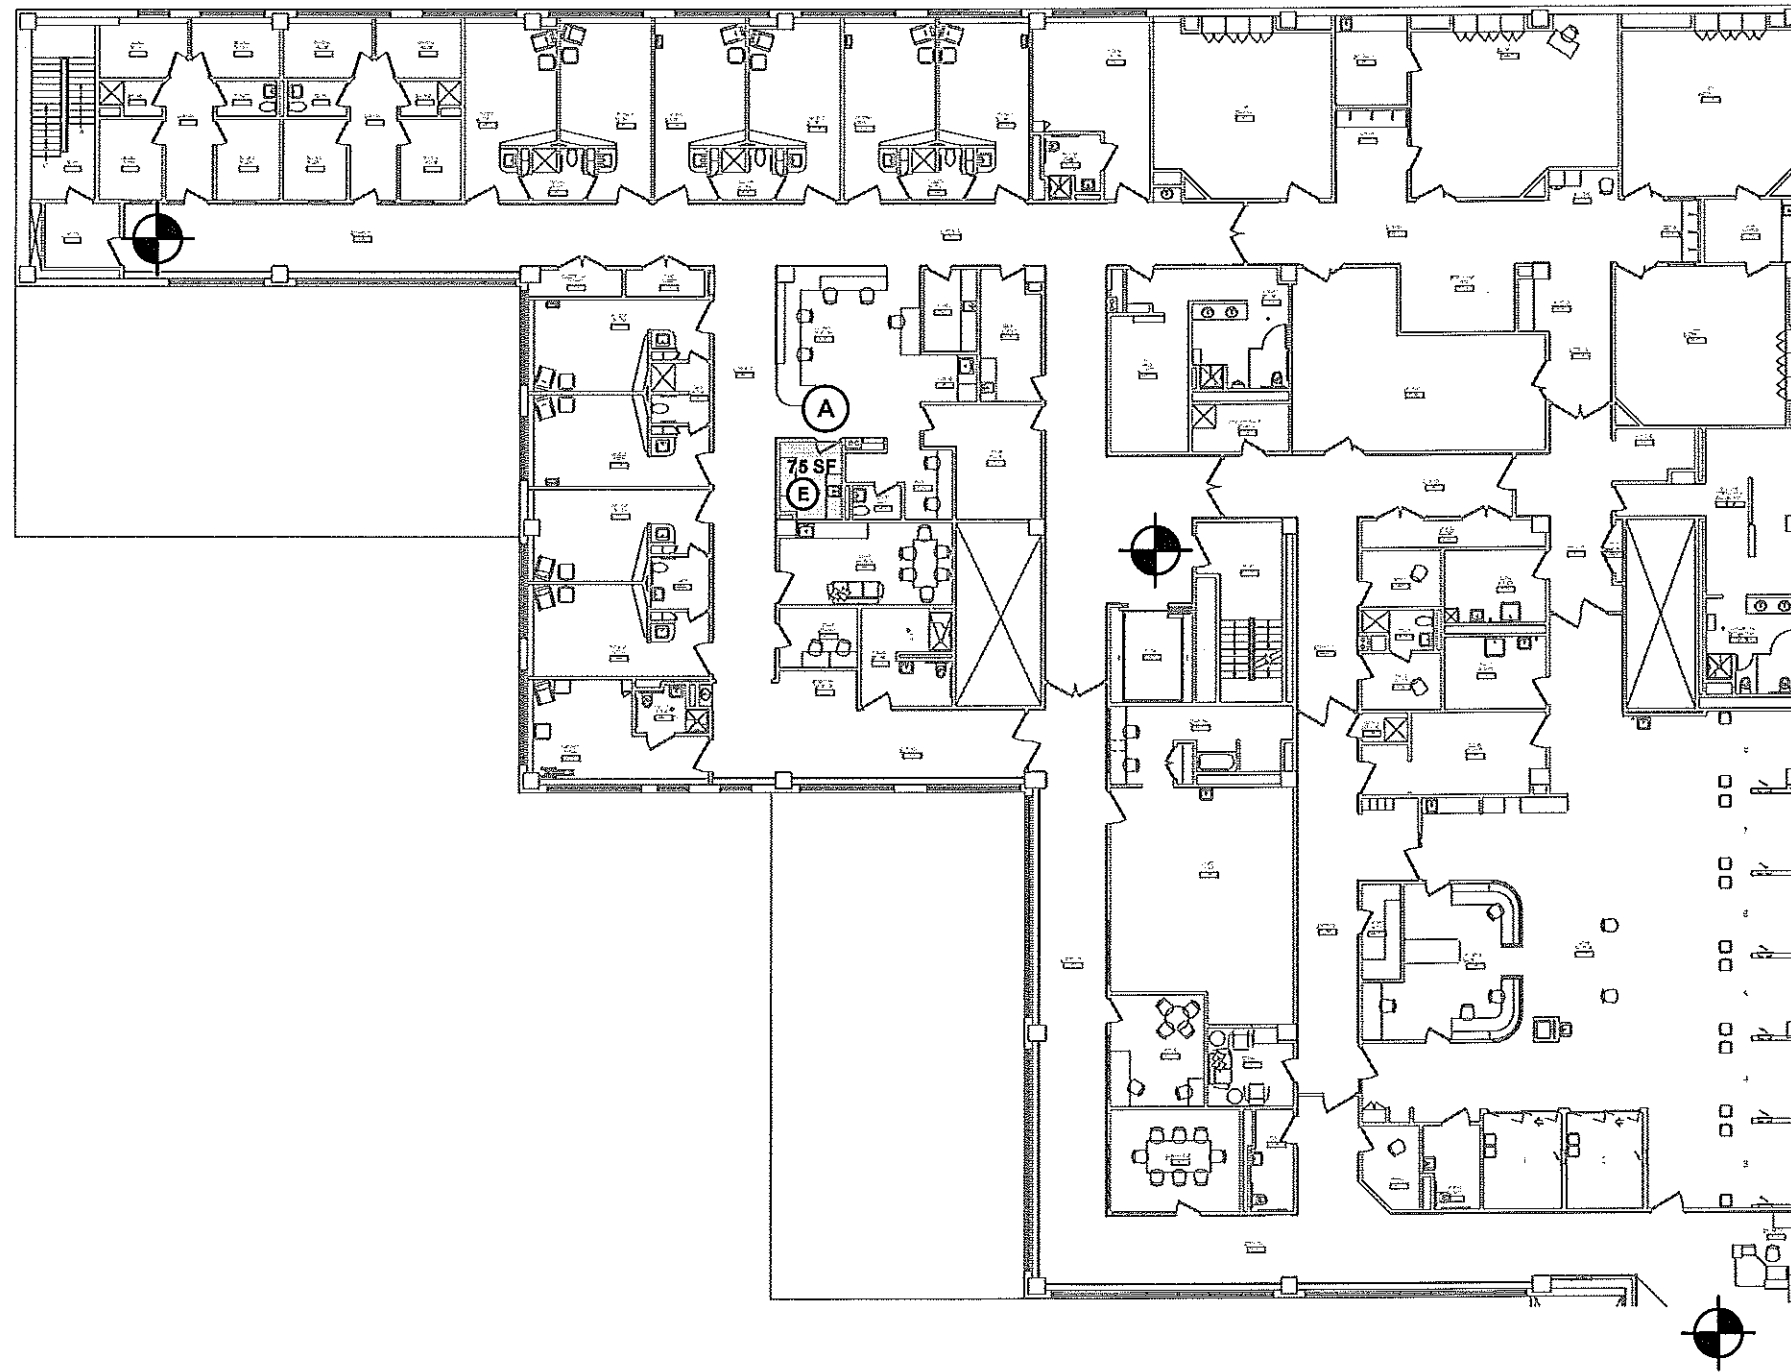


BEAN WING
SECOND LEVEL

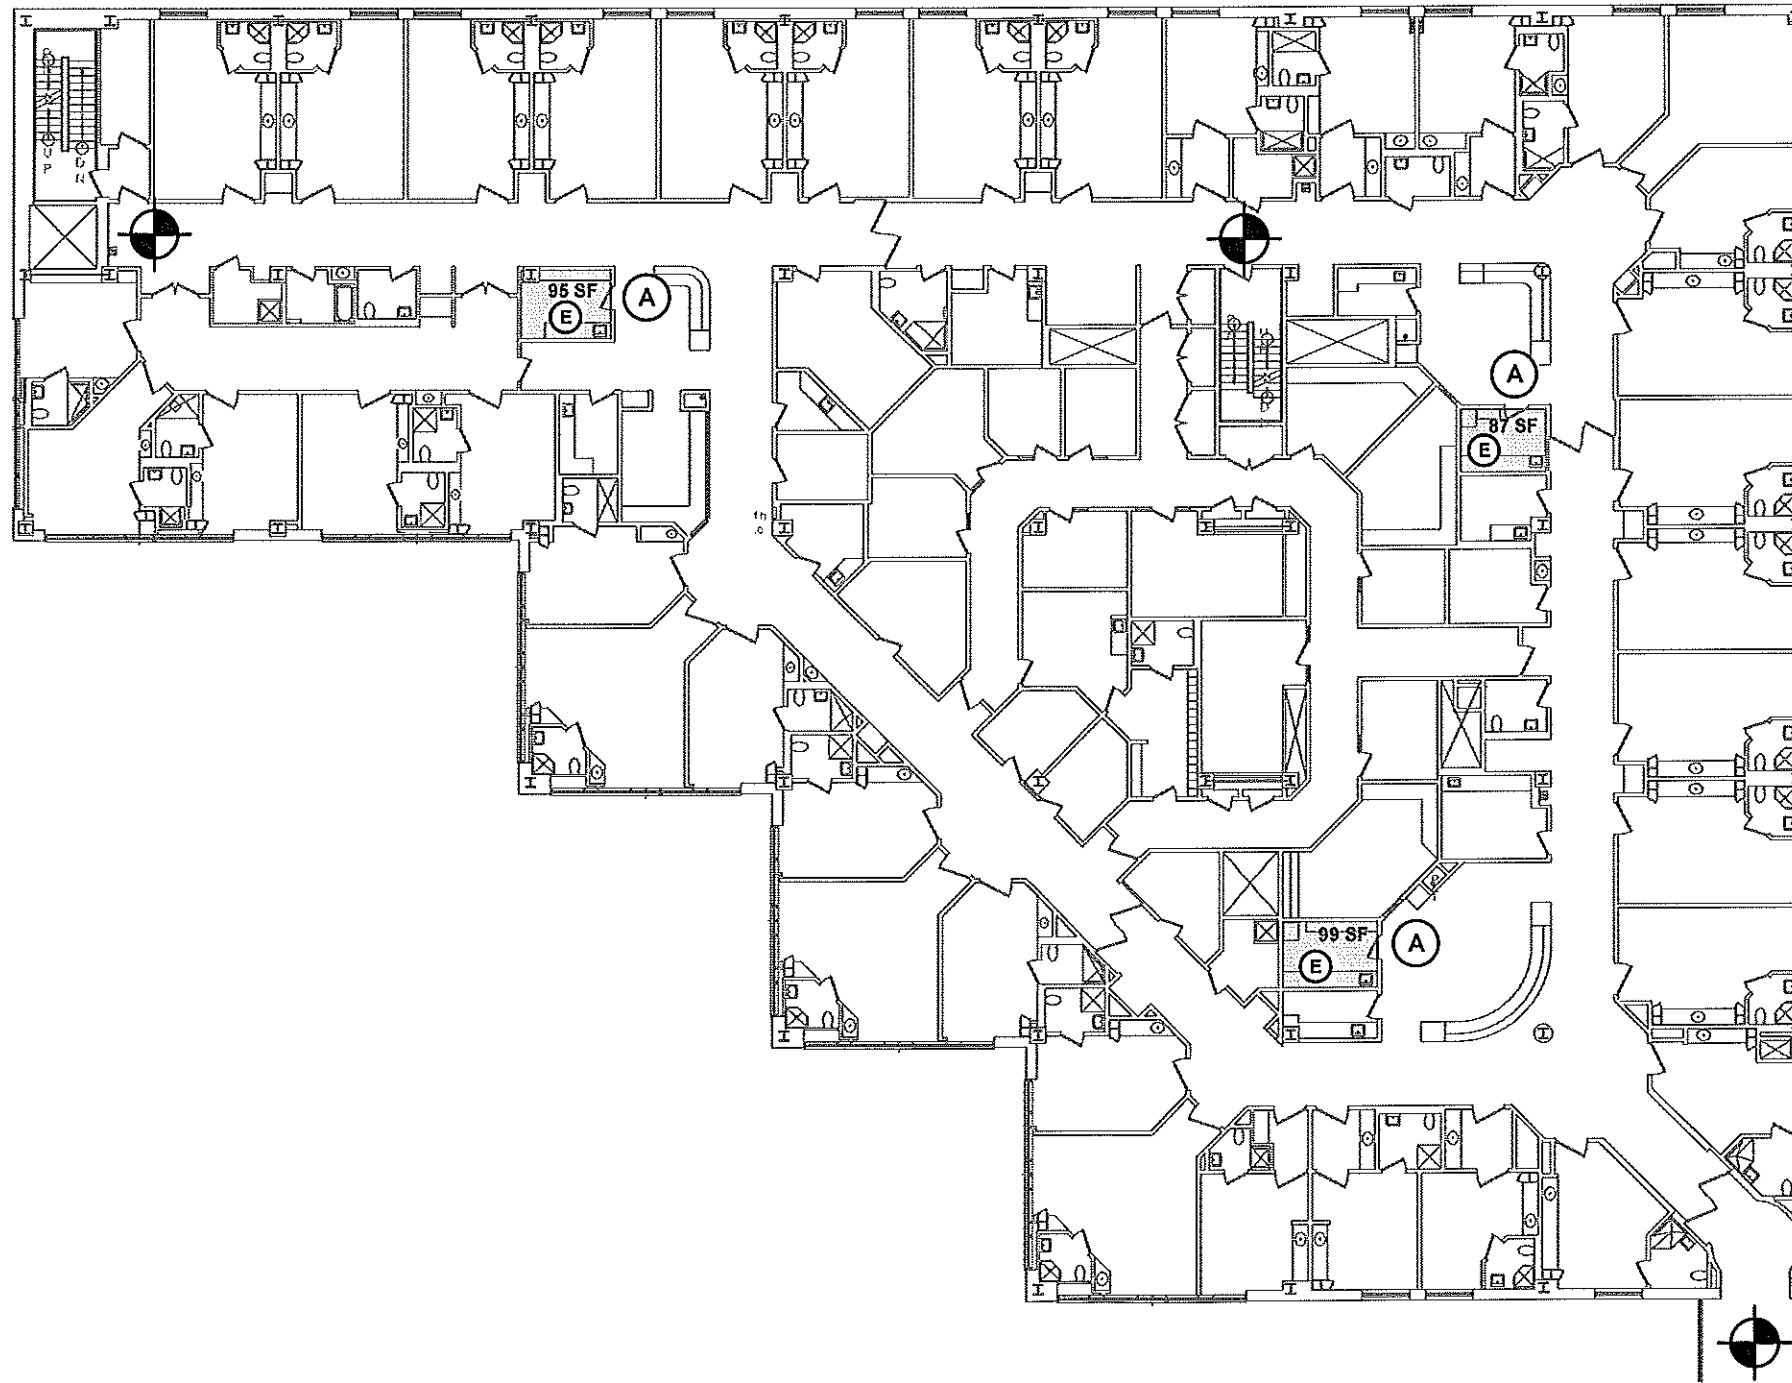

BEAN WING
FIFTH LEVEL

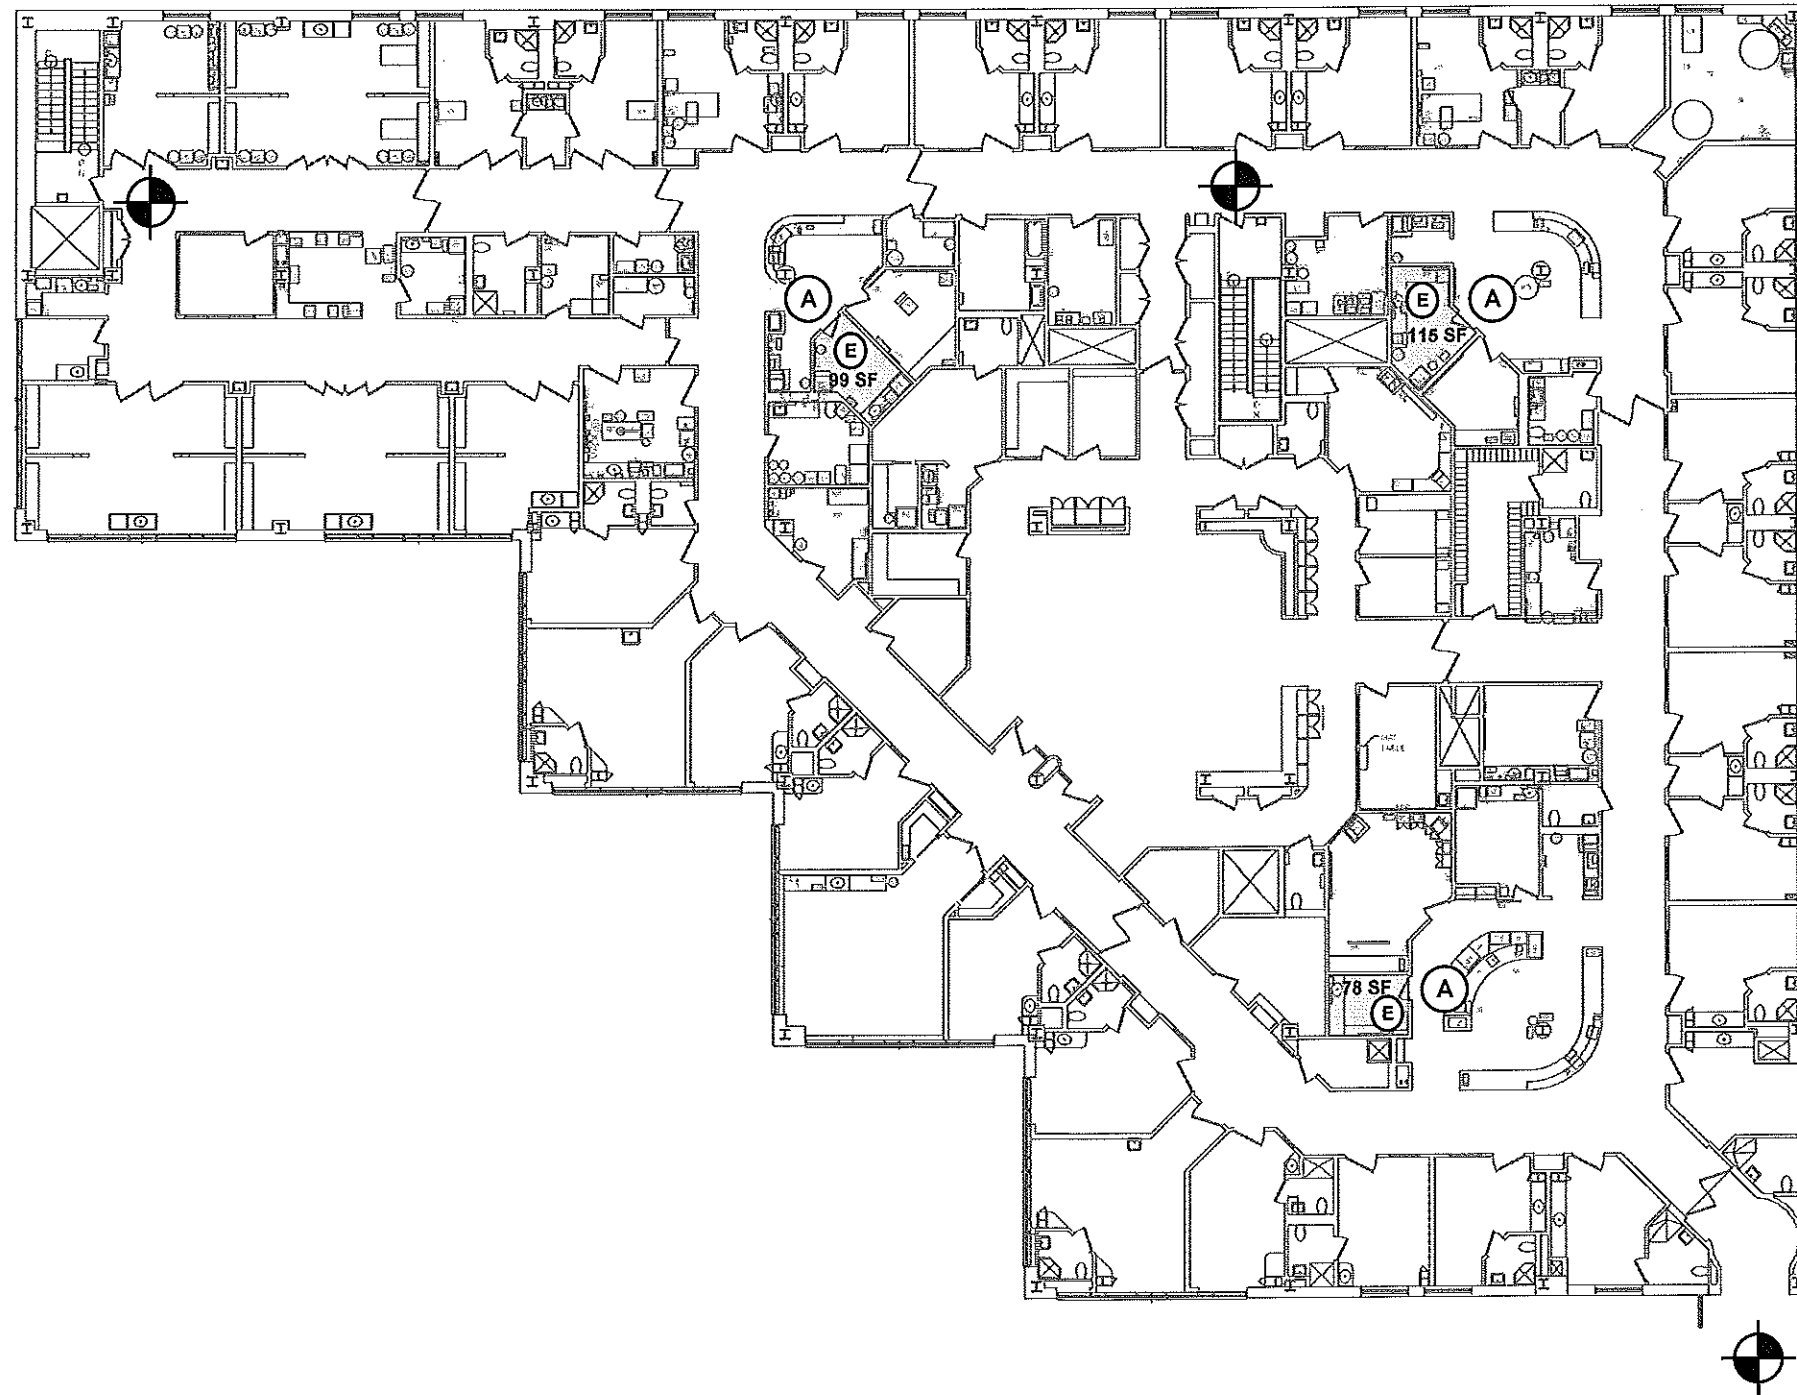


BEAN WING
SIXTH LEVEL

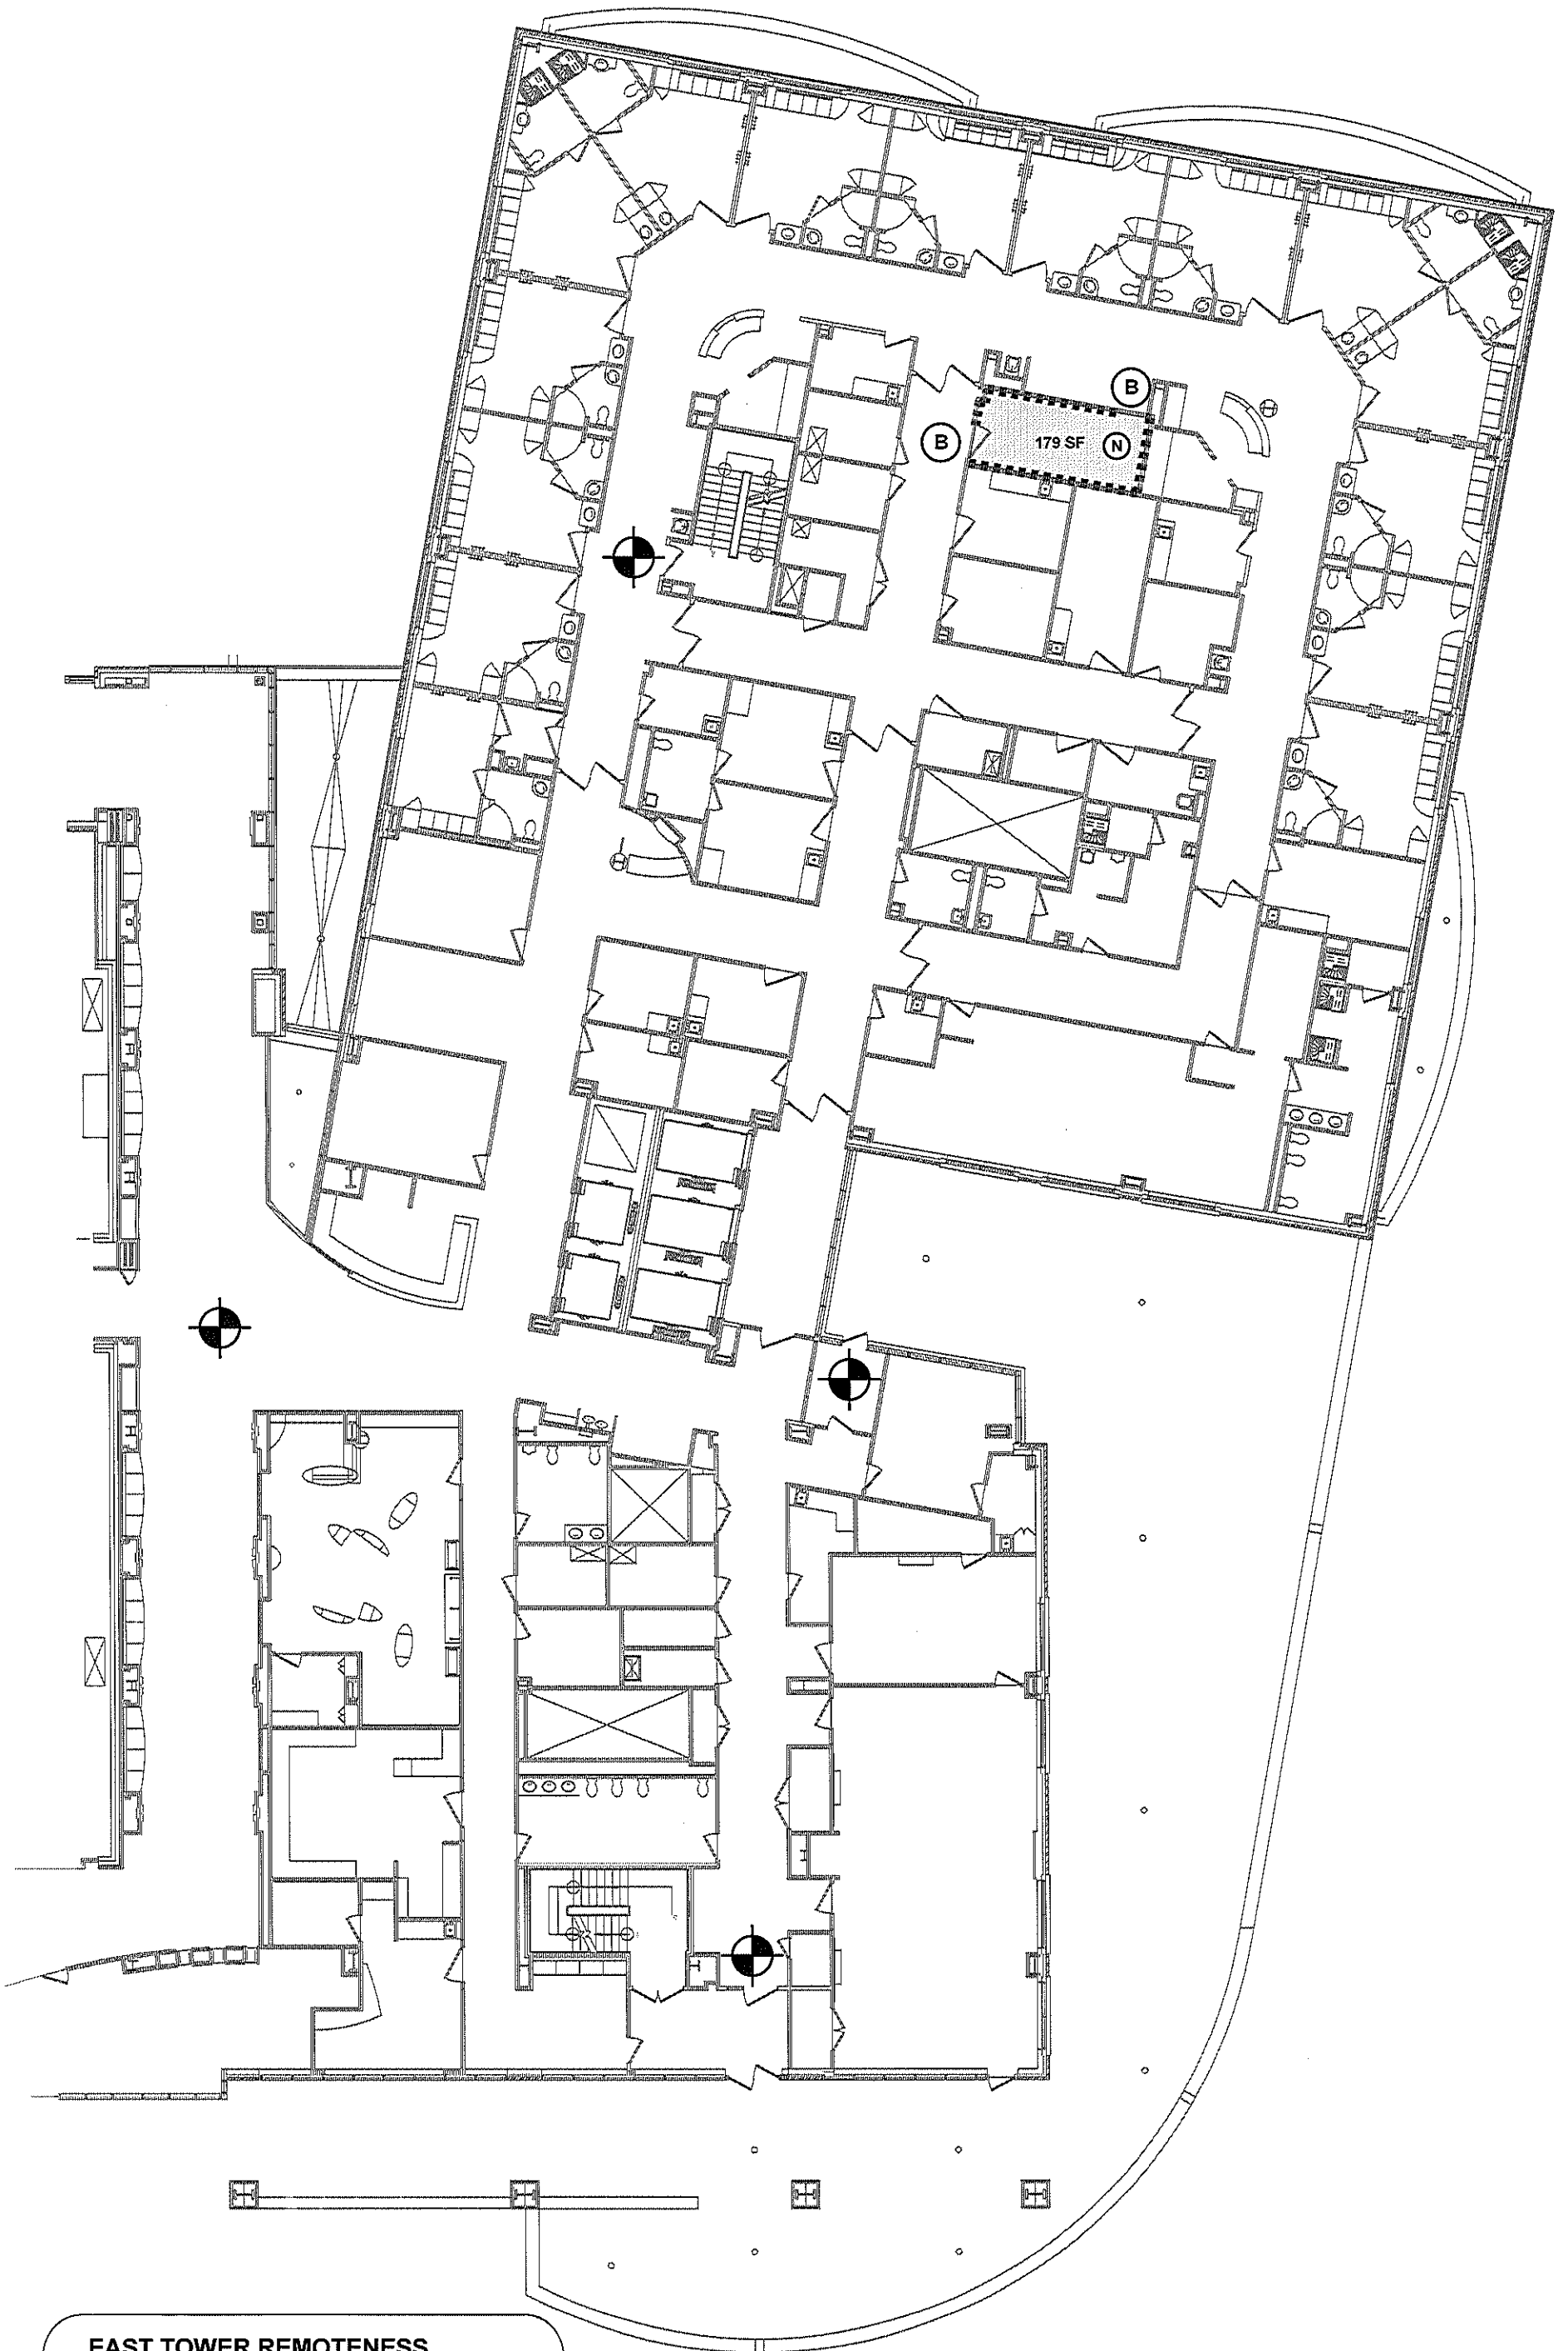


EAST TOWER REMOTENESS	
REMOENESS REQUIRED	101'
REMOENESS PROVIDED	161'

**EAST TOWER
GROUND LEVEL**

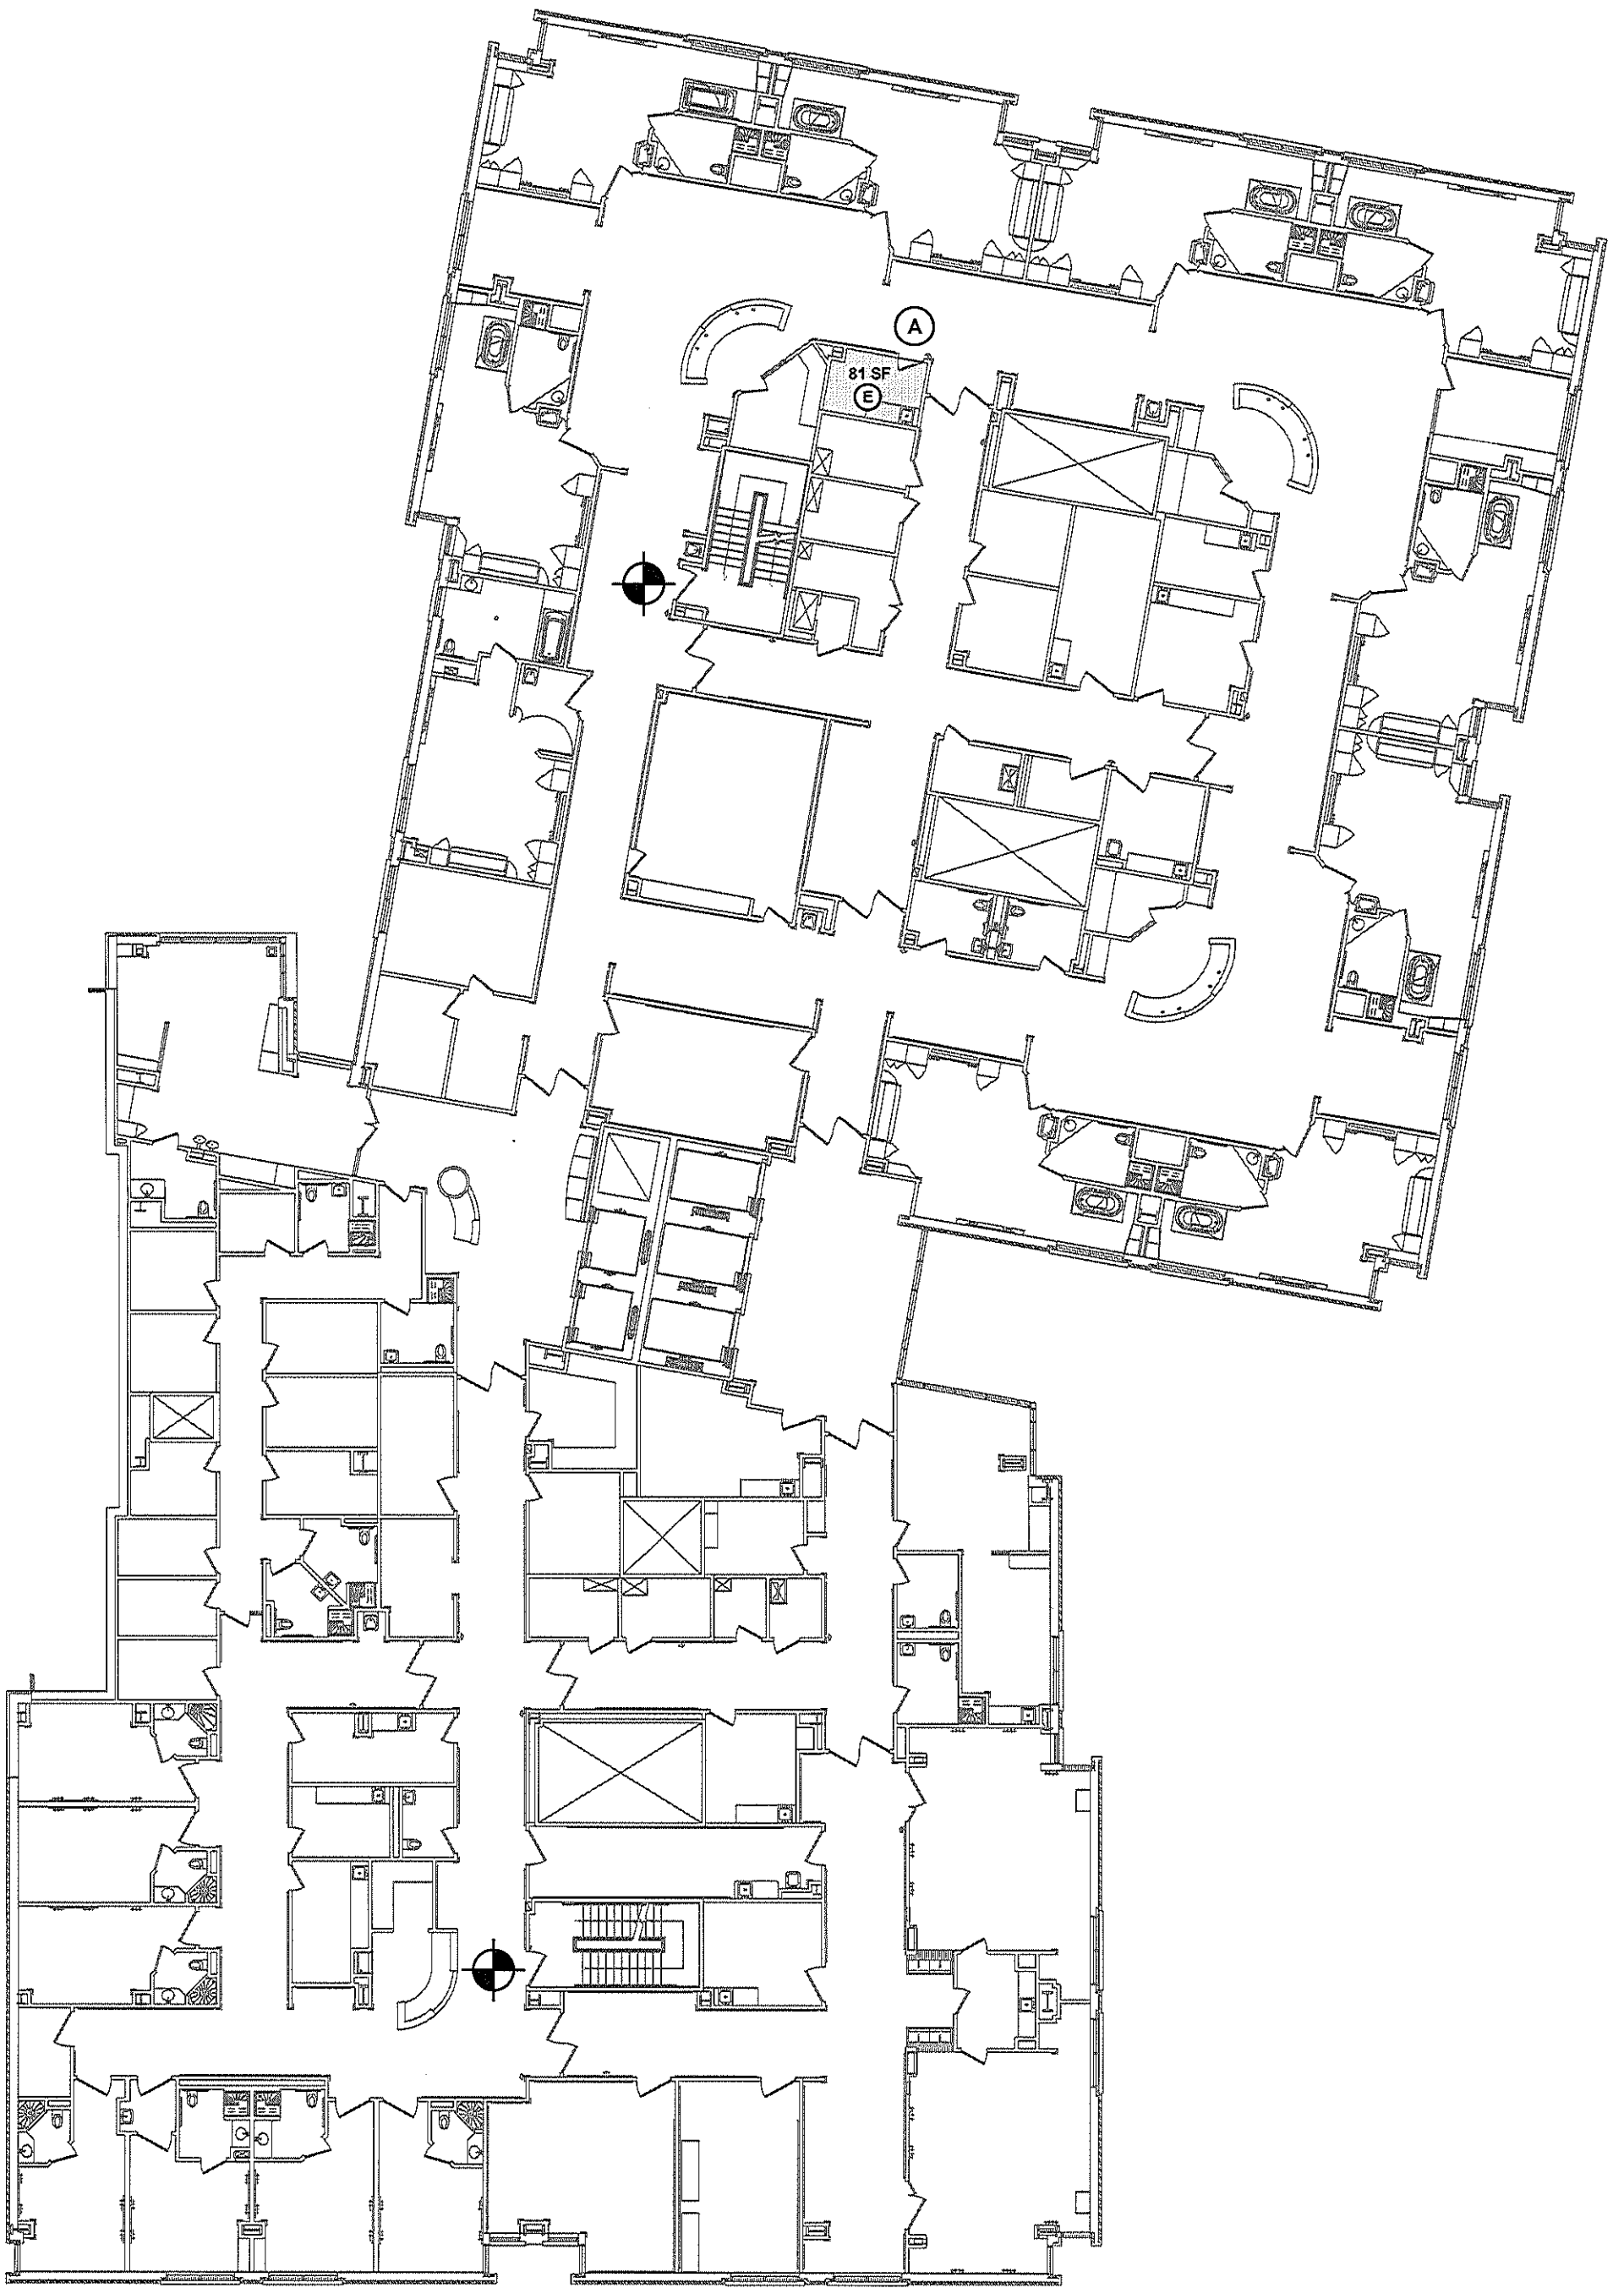

EAST TOWER
SECOND LEVEL

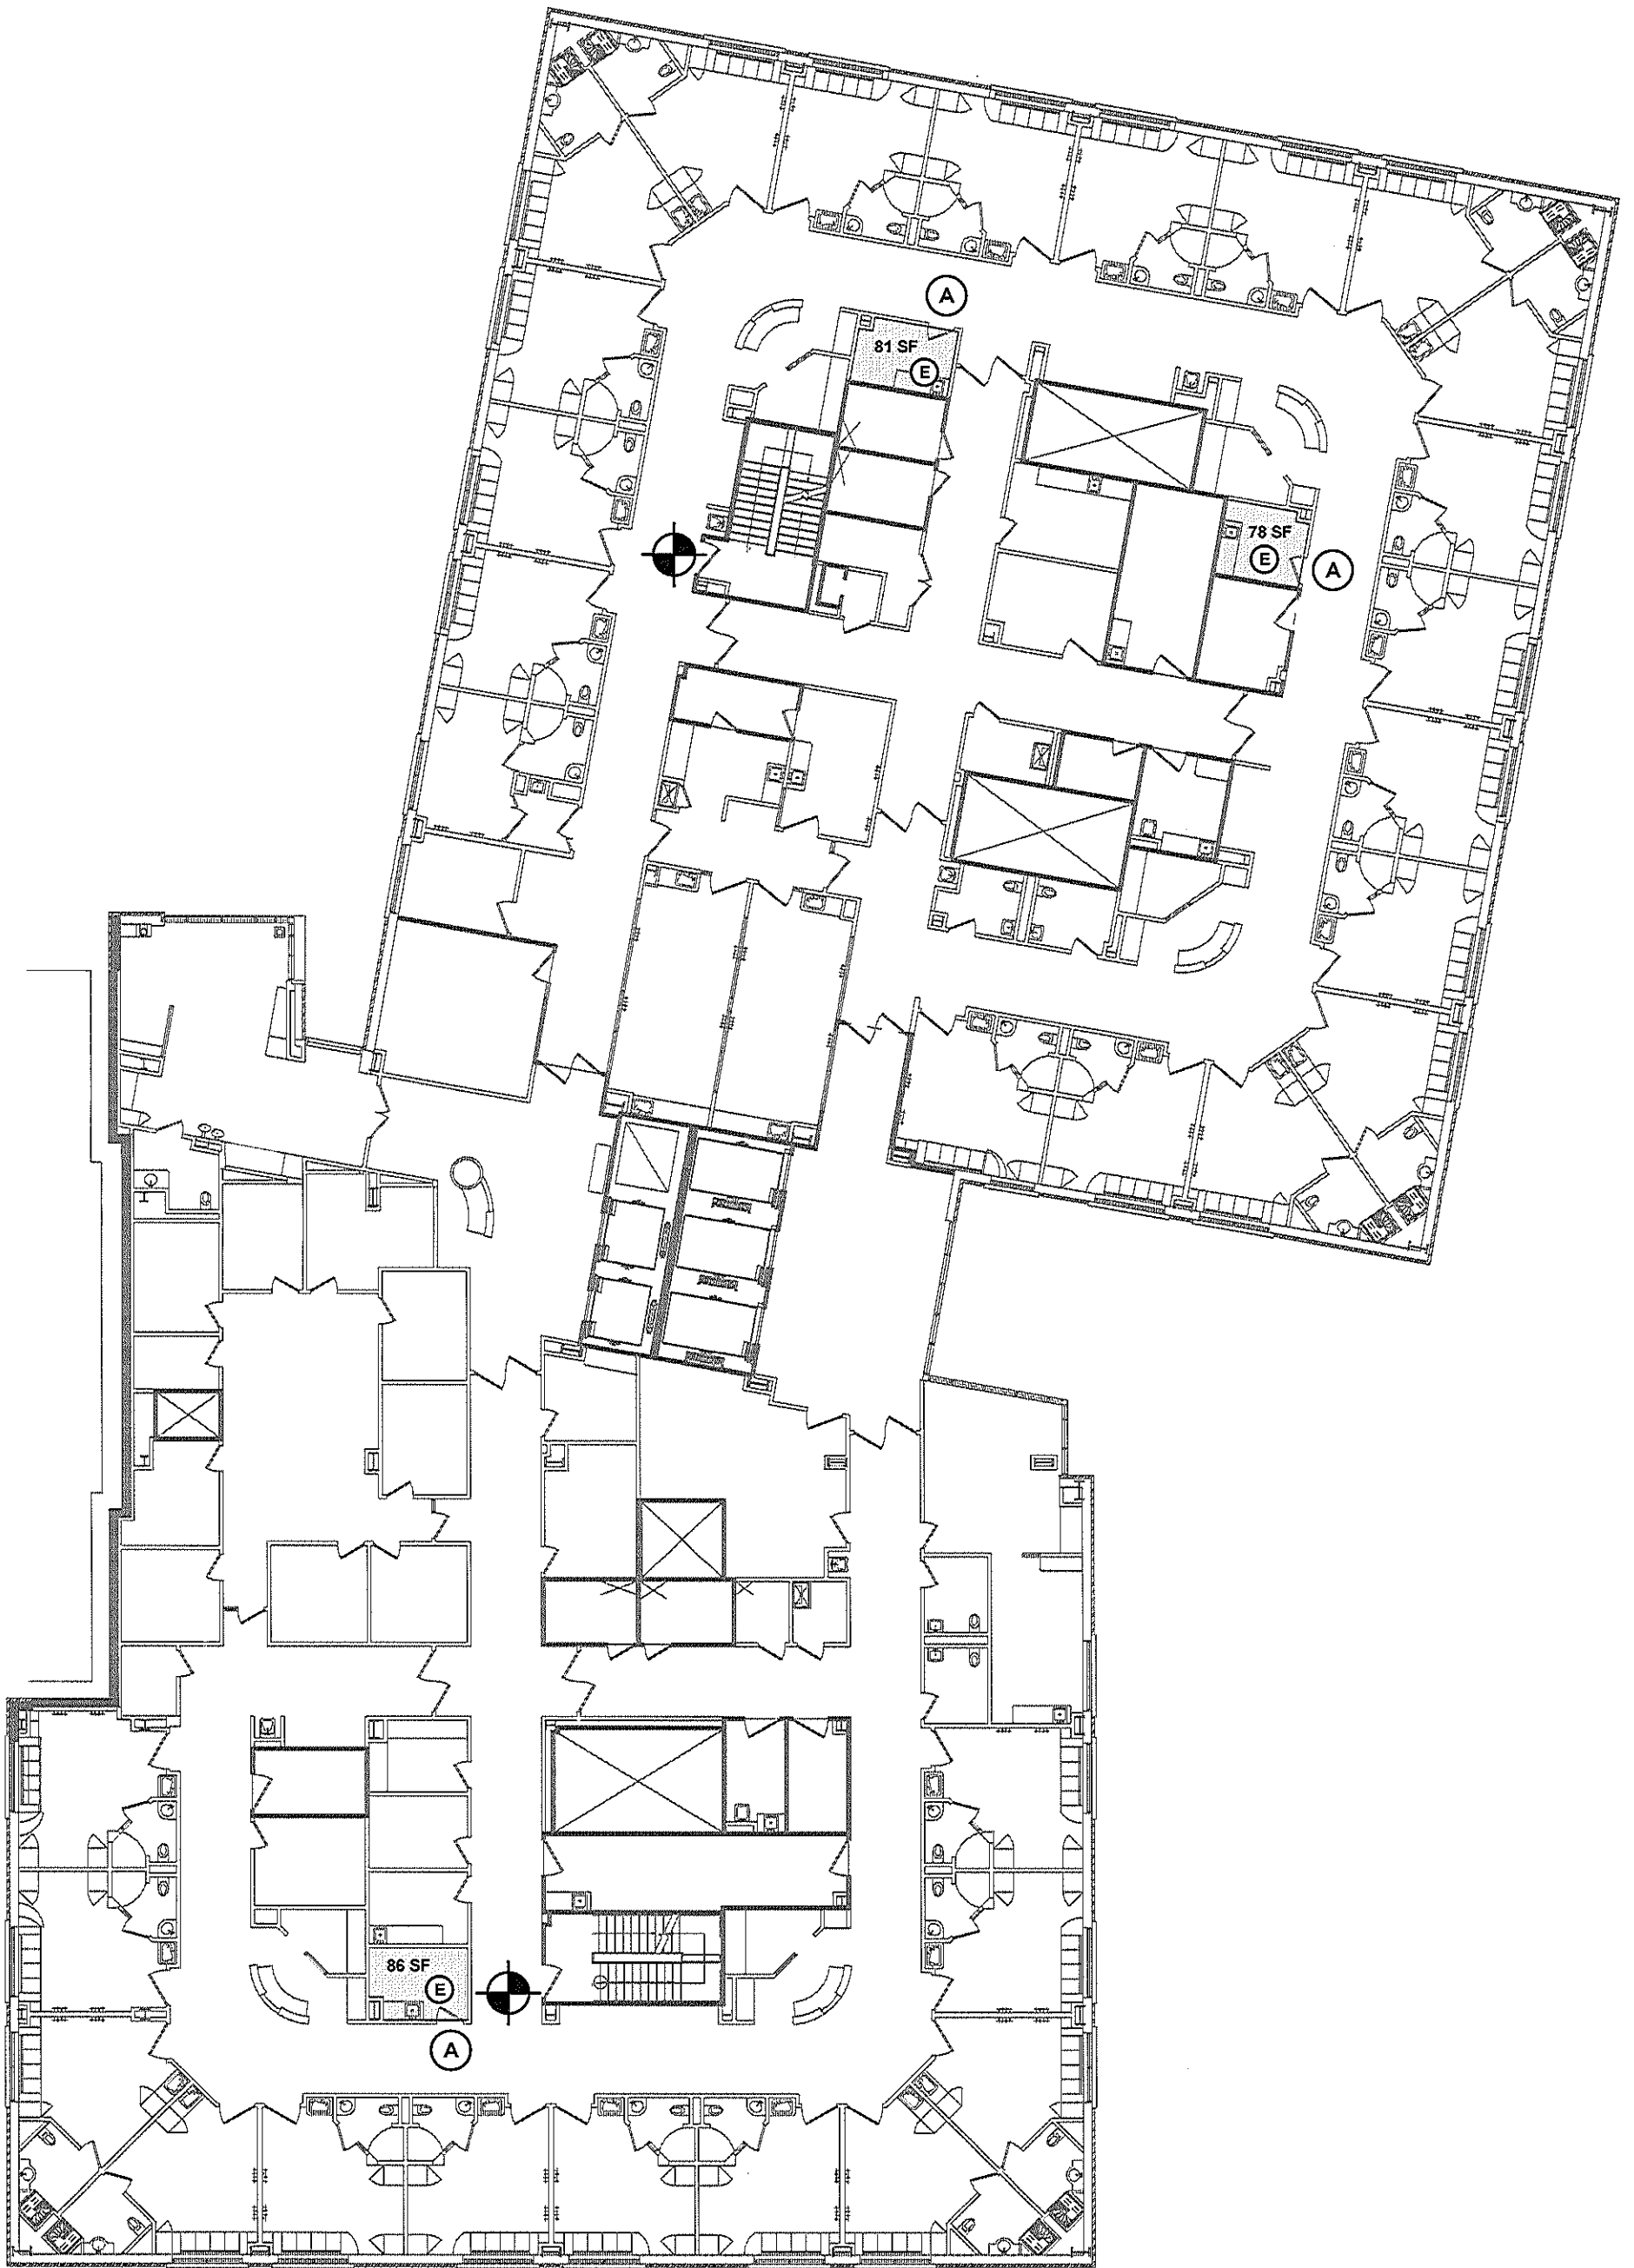

EAST TOWER
FOURTH LEVEL