

MECHANICAL SPECIFICATIONS:

GENERAL

- CONTRACTOR SHALL VISIT THE SITE TO DETERMINE PRE-EXISTING CONDITIONS AND ALL WORK NECESSARY. PRIOR TO BIDDING, VERIFY ALL MEASUREMENTS AND EXISTING CONDITIONS IN THE FIELD. GENERAL SCHEMATIC LAYOUT IS INDICATED; ALL OFFSETS, OBSTRUCTIONS, AND EXISTING CONFIGURATIONS AND CONSTRAINTS MUST BE FIELD VERIFIED.
- OBTAIN NECESSARY PERMITS AND PAY ASSOCIATED FEES.
- COORDINATE ANY SERVICE DISRUPTIONS WITH THE OWNER.
- INSTALL ALL COMPONENTS IN ACCORDANCE WITH MANUFACTURER'S RECOMMENDATIONS AND ALL LOCAL CODES AND STANDARDS.
- DRAWINGS ARE DIAGRAMMATIC ONLY; FIELD-VERIFY ALL EXISTING CONDITIONS. COORDINATE INSTALLATIONS WITH OTHER TRADES. COORDINATE ELECTRICAL POWER REQUIREMENTS FOR ALL MOTORS.
- THE INTENTION OF THESE CONTRACT DOCUMENTS IS TO CALL FOR FINISHED WORK, FULLY TESTED AND READY FOR OPERATION. ANY COMPONENTS OR LABOR NOT MENTIONED IN THE CONTRACT DOCUMENTS BUT REQUIRED FOR FUNCTIONING SYSTEMS SHALL BE PROVIDED. SHOULD THERE APPEAR TO BE ANY DISCREPANCIES OR QUESTIONS OF INTENT, THE CONTRACTOR SHALL REFER THE MATTER TO THE ARCHITECT FOR DECISION BEFORE START OF ANY RELATED WORK.
- PERFORM WORK IN ACCORDANCE WITH LOCAL CODES.
- SEAL ALL DUCT AND PIPE PENETRATIONS WITH FIRE SEALANT.
- OBSERVE THE OWNER'S CLEANLINESS PROTOCOLS.

FIRE PROTECTION

- OBTAIN ALL REQUIRED PERMITS AND APPROVALS FOR THE WORK. PERFORM ALL DESIGN, COORDINATION, INSTALLATION AND TESTING TO YIELD COMPLETE AND OPERATIONAL FIRE SPRINKLER SYSTEMS.
- GENERATE AND SUBMIT SHOP DRAWINGS, (PLANS AND DETAILS) AND HYDRAULIC CALCULATIONS FOR REVIEW BY SMRT, THE OWNER, AND AUTHORITIES HAVING JURISDICTION. SUBMIT PROPOSED PRODUCT DATA ALONG WITH SHOP DRAWINGS FOR APPROVAL PRIOR TO COMMENCING WITH THE WORK.
- DESIGNS, (DRAWINGS AND CALCULATIONS) TO BE STAMPED AND SIGNED BY A REGISTERED FIRE PROTECTION ENGINEER, (P.E. REGISTRATION).
- SUBMIT RECORD DRAWINGS, CALCULATIONS, PRODUCT DATA AND MAINTENANCE DATA FOR THE WORK ONCE COMPLETE.
- DESIGNS AND INSTALLATIONS SHALL COMPLY WITH THE 2006 INTERNATIONAL BUILDING CODE AND NFPA 13.
- PERFORM A HYDRANT FLOW TEST TO SERVE AS THE BASIS FOR HYDRAULICALLY CALCULATED SYSTEM DESIGNS.
- 2-INCH AND SMALLER PIPING TO BE SCHEDULE 40 STEEL WITH THREADED FITTINGS. 2-1/2-INCH AND LARGER PIPING TO BE SCHEDULE 10 STEEL WITH ROLLED GROOVE FITTINGS.
- PROVIDE NEW SPRINKLER COVERAGE PER NFPA 13, LIGHT HAZARD OCCUPANCY. PROVIDE PIPED AREA COVERS TO DROPS IN THE NEW CEILING.
- NEW SPRINKLER HEADS TO BE RECESSED, QUICK RESPONSE TYPE WITH WHITE FINISH.
- ALL SYSTEMS, TAMPER SWITCHES AND FLOW SWITCHES TO BE SUPERVISED BY THE EXISTING FACILITY FIRE ALARM SYSTEM. COORDINATE WITH ELECTRICAL CONTRACTOR.
- INSTALLATIONS SHALL BE SEISMICALLY BRACED PER NFPA 13 AND THE INTERNATIONAL BUILDING CODE.
- SYSTEM IMPAIRMENTS SHALL BE LIMITED TO FOUR HOURS OR LESS. BEFORE SHUTTING OFF A SECTION OF THE SPRINKLER SYSTEM TO MAKE SPRINKLER TIE-INS, NOTIFY THE LOCAL FIRE DEPARTMENT, PLAN THE WORK CAREFULLY, AND ASSEMBLE ALL MATERIALS TO ENABLE COMPLETION IN THE SHORTEST TIME POSSIBLE. WORK STARTED ON CONNECTIONS SHOULD BE COMPLETED WITHOUT INTERRUPTION AND PROTECTION RESTORED AS PROMPTLY AS POSSIBLE. DURING THE IMPAIRMENT, PROVIDE EMERGENCY HOSE EXTINGUISHERS AND MAINTAIN EXTRA WATCH SERVICE IN THE AFFECTED AREAS.
- THE EXISTING PREACTION SYSTEM VALVE AND RISER SHALL BE REMOVED. THE PIPE SERVING ANGIO BI-PLANE ROOM 8446 SHALL BE RECONNECTED TO THE WET PIPE SPRINKLER SYSTEM.

METAL DUCTWORK

- GALVANIZED STEEL DUCTWORK: ASTM A653 GALVANIZED STEEL SHEET, LOCK-FORMING QUALITY, AND G90 ZINC COATING. ALL DUCTWORK SHALL BE FURNISHED AND INSTALLED IN ACCORDANCE WITH SMACNA STANDARDS. CONSTRUCT DUCT SYSTEMS SO THAT LEAKAGE DOES NOT EXCEED ONE PERCENT OF THE TOTAL AIR QUANTITIES. SEAL ALL DUCT JOINTS WITH GASKETED CONNECTIONS, DUCTMATE, OR EQUAL.
- PROVIDE VOLUME DAMPERS AT ALL BRANCH DUCTS.

MECHANICAL INSULATION

- ALL SUPPLY DUCTS SHALL BE EXTERNALLY INSULATED WITH FIBERGLASS DUCT WRAP EQUAL TO SCHULLER MICROLITE TYPE 75, ASTM C533, NONCOMBUSTIBLE BLANKET, 1-1/2" THICK.
- ALL CHILLED WATER PIPING SHALL BE INSULATED WITH 1" THICK FIBERGLASS PIPE INSULATION WITH FSK JACKET AND VAPOR BARRIER.
- ALL COOLING COIL CONDENSATE PIPING SHALL BE INSULATED WITH 1/2" FIBERGLASS INSULATION WITH FSK JACKET.

MEDICAL GAS AND VACUUM PIPING

- PROVIDE ALL PIPING COMPLETE WITH FITTINGS, VALVES, HANGERS, SUPPORTS, GUIDES, SLEEVES, AND ACCESSORIES.
- INSTALL ALL MEDICAL GAS PIPING TO NFPA 99, LEVEL 1 REQUIREMENTS.
- PROVIDE OSS MEDICAL GAS OUTLETS AND ZONE VALVE BOX AS SHOWN ON THE DRAWINGS. ACCEPTABLE MANUFACTURERS ARE: AMCO, ALLED, BEACON MEDICALS, OR ENGINEER APPROVED EQUAL.
- MEDICAL AIR AND OXYGEN PIPING SHALL BE TYPE "L" COPPER, CLEANED AND SEALED FOR OXYGEN SERVICE. MEDICAL VACUUM PIPING SHALL BE TYPE "L" COPPER.
- ALL JOINTS SHALL BE BRAZED. BRAZING FILLER METALS SHALL BE AWS A5.8, BCUP SERIES ALLOYS. FLUX IS PROHIBITED UNLESS USED WITH BROUZE FITTINGS.
- VALVES SHALL BE FACTORY CLEANED FOR OXYGEN SERVICE, EXCEPT FOR VALVES IN VACUUM PIPING.
- ZONE VALVES: MSS SP-110, 3-PIECE-BODY, FULL-PORT COPPER-ALLOY BALL VALVE RATED FOR 300-PSIG. MINIMUM WORKING PRESSURE: WITH CHROME-PLATED BRASS BALL, FITTE OR TEE SEATS, BLOW-OUT-PROOF STEM, THREADED OR SOLDER-JOINT ENDS, AND HANDLE DESIGNED FOR QUARTER TURN BETWEEN OPENED AND CLOSED POSITIONS.
A. INCLUDE UNION-TYPE BODY WITH BOLTED SWING-AWAY CENTER SECTION.
B. INCLUDE FACTORY-INSTALLED ASTM B 819, TYPE K OR L, COPPER-TUBE EXTENSIONS WITH PRESSURE GAGE FOR PRESSURE SYSTEMS AND VACUUM GAGE FOR VACUUM SYSTEMS.
- ZONE VALVE BOXES: FORMED STEEL FOR RECESSED MOUNTING, WITH HOLES FOR MEDICAL GAS PIPING AND ANCHORS. INCLUDE BOXES FOR SINGLE- OR MULTIPLE-VALVE INSTALLATION WITH PRESSURE GAGE AND IN SIZES TO PERMIT MANUAL OPERATION OF VALVES.
A. INTERIOR FINISH: FACTORY-APPLIED WHITE ENAMEL.
B. COVER PLATE: ANODIZED ALUMINUM WITH FRANGIBLE OR REMOVABLE WINDOWS.
C. VALVE-BOX WINDOWS: CLEAR OR TINTED TRANSPARENT PLASTIC WITH LABELING THAT INCLUDES ROOMS SERVED, ACCORDING TO NFPA 99.
- INTERRUPTION OF EXISTING MEDICAL GAS SERVICE:
A. CONTRACTOR SHALL NOT INTERRUPT MEDICAL GAS SERVICE TO OCCUPIED FACILITIES. UNDER NO CONDITIONS SHALL MEDICAL GAS SERVICE VALVES (EXISTING OR NEW) BE CLOSED BY THE CONTRACTOR.
B. OWNER SHALL BE RESPONSIBLE FOR ISOLATING PORTIONS OF EXISTING SYSTEMS AND CLOSING SERVICE VALVES AS REQUIRED; INCLUDING VERIFYING PROPER SERVICE VALVE OR ZONE VALVE LABELING, AND EXACT AREAS AND ROOMS CONTROLLED.
- MEDICAL GAS SYSTEM ISOLATION:
A. TOTAL ISOLATION BETWEEN NEW SYSTEMS AND EXISTING SYSTEMS SHALL BE MAINTAINED UNTIL ALL NEW PIPING IS TESTED FOR LEAKS AND TESTED FOR CROSS CONNECTIONS PER NFPA 99 BY THE CONTRACTOR.
- ALL MEDICAL GAS AND VACUUM PIPING SHALL BE TESTED AND CERTIFIED AS REQUIRED IN NFPA 99.

HYDRONIC PIPING

- PROVIDE ALL PIPING COMPLETE WITH FITTINGS, VALVES, STRAINERS, MOTORIZED VALVE OPERATORS, STRAINERS, HANGERS, SUPPORTS, GUIDES, SLEEVES, AND ACCESSORIES.
- ALL PRESSURIZED PIPING TO BE TESTED HYDROSTATICALLY TO 150 PSI OR 150% OF OPERATING PRESSURE, WHICHEVER IS GREATER, BUT NEVER EXCEED TEST PRESSURE AND B1.6.1 BASIS. TEST DURATION TO BE 2 HOURS WITH NO PRESSURE CHANGE CORRECTED FOR TEMPERATURE CHANGE.
- REPAIR OR REPLACE LEAKS OR DEFECTS WITHOUT ADDITIONAL COST.
- PROVIDE DIELECTRIC NIPPLES WHERE DISSIMILAR METALS ARE TO BE JOINED. DIELECTRIC UNIONS ARE NOT ACCEPTABLE.
- PROVIDE ADEQUATE SUPPORT FOR PIPE AND CONTENTS TO PREVENT SAGGING, VIBRATION, OR SWAYING AND ALLOW FOR EXPANSION AND CONTRACTION. PROVIDE SUPPLEMENTAL STEEL AS REQUIRED WHERE STRUCTURE CANNOT SUPPORT POINT LOADS.
- ALL INSULATION SHALL HAVE COMPOSITE FIRE AND SMOKE HAZARD RATINGS THAT SHALL NOT EXCEED A FLAME SPREAD OF 25 AND A SMOKE DEVELOPED RATING OF 50.
- HYDRONIC PIPING SHALL BE COPPER, TYPE L, HARD DRAWN IN ACCORDANCE WITH ASTM B88, AND LEAD-FREE SOLDER JOINTS, OR THREADED STEEL.
- INSPECTIONS AND TESTS SHALL BE PERFORMED ON THE PIPING INSTALLATION AS REQUIRED BY CODE.

TESTING, ADJUSTING, AND BALANCING



- CONTRACTOR SHALL PROVIDE TESTING, ADJUSTING, AND BALANCING FOR ALL AIR SYSTEMS AND HYDRONIC SYSTEMS.
- THE HOT LAB SHALL BE ADJUSTED TO 0.02" W.C. NEGATIVE PRESSURE IN RELATION TO THE CORRIDOR OUTSIDE THE ROOM.
- ADJUST ALL AIRFLOWS TO PLUS/MINUS 5% OF VALUES SHOWN ON THE DRAWINGS.
- TAB CONTRACTOR SHALL CONFIRM THAT ALL EQUIPMENT IS INSTALLED CORRECTLY AND STARTED UP CORRECTLY PRIOR TO BALANCING.
- TAB CONTRACTOR SHALL CONFIRM THAT CONTROLS AND TERMINAL BOXES ARE CALIBRATED PRIOR TO BALANCING.
- TAB CONTRACTOR SHALL SUBMIT A TAB REPORT AT THE COMPLETION OF WORK.

MECHANICAL IDENTIFICATION

- PROVIDE PIPE LABELS ON ALL PIPING. ALL MEDICAL GAS PIPING SHALL BE LABELED AS REQUIRED BY NFPA 99.
- PROVIDE A TAG WITH "AHI-47" ON THE AIR HANDLING UNIT AND CHILL-13 ON THE CHILLER.
- PROVIDE DUCT LABELS ON ALL SUPPLY, RETURN, AND EXHAUST DUCTWORK.
- PROVIDE VALVE TAGS ON ALL VALVES. PROVIDE A VALVE TAG SCHEDULE.

1441 One Street P.O. Box 618
Portland, Maine 04104
Tel: (207) 772-3946
Fax: (207) 772-1070
www.smrtinc.com

ARCHITECTURE
ENGINEERING
PLANNING
INTERIOR DESIGN
COMMISSIONING

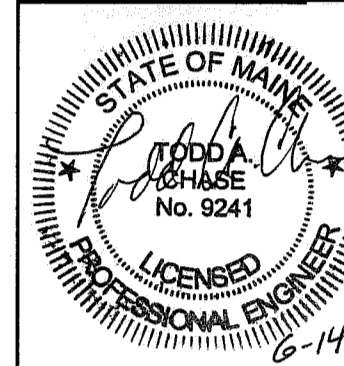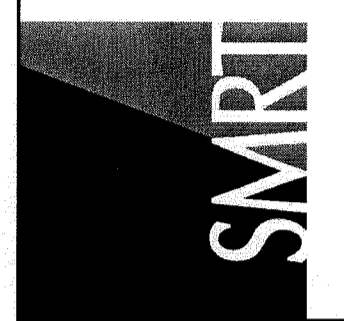

Bramhall Radiology
ANGIO BI-PLANE RENOVATIONS
PORTLAND, ME

ISSUED FOR CONSTRUCTION
06.14.11

NO.	DESCRIPTION	DATE
0	ISSUED FOR CONSTRUCTION	06-14-11
1	REV	

GRAPHIC SCALE:
0" 1"

SCALE: NOT TO SCALE
PROJECT MANAGER: DW
DRAWN BY: KFB
AGE OF RECORD: TAC
PROJECT NO: 11011
DATE: 06-14-11

SHEET TITLE:
SPECIFICATIONS

SHEET No.
M-002