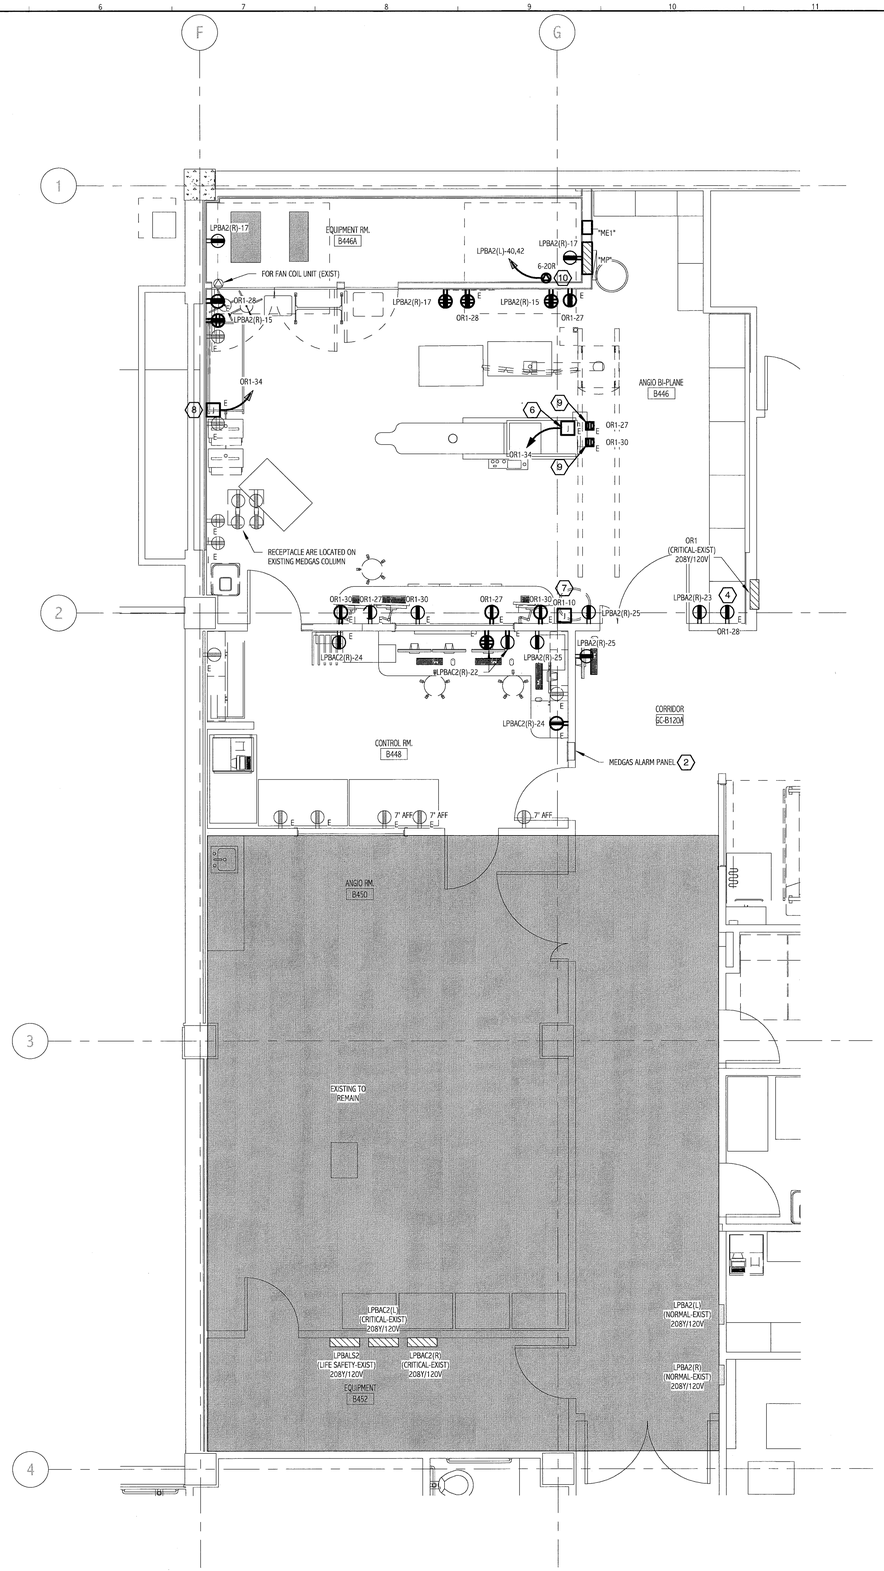

NOTE:

1. SEE SHEET E-001 FOR LEGEND AND GENERAL NOTES.

KEYED NOTES:

1. INSTALL 8" ABOVE COUNTER TO CENTER.
2. RELOCATED DEVICE. SEE ED101 FOR EXISTING LOCATION.
3. INTALL 36" AFF TO CENTER.
4. INSTALL 48" AFF TO CENTER.
5. INSTALL 60" AFF TO CENTER.
6. PROVIDE CONNECTION TO PHYSIO BOX.
7. PROVIDE CONNECTION TO PATIENT LIFT.
8. PROVIDE 5 GANG MASONARY BOX FOR SYSTEM CLOCK.
9. "TOMBSTONE" STYLE FLOOR RECEPTACLE. MOUNT TO RIGHT OF PHYSIO BOX.
10. FOR FAN COIL UNIT. COORDINATE LOCATION WITH MECHANICAL CONTRACTOR.
11. INSTALL 12" AFF TO CENTER.

144 Free Street/P.O. Box 618
Portland, Maine 04104
tel: (207) 772-3846
fax: (207) 772-1070
www.smrtinc.com

ARCHITECTURE
ENGINEERING
PLANNING
INTERIOR DESIGN
COMMISSIONING

SMRI

STATE OF MAINE — JOHN P. PERRUZZI — No. 7707 — REGISTERED PROFESSIONAL ENGINEER — 6/13/11

Rev. 0

PROJECT NORTH

Bramhall Radiology
ANGIO BI-PLANE RENOVATIONS
PORTLAND, ME

ISSUED FOR CONSTRUCTION
06.14.11

CURRENT ISSUE STATUS:

REV	DESCRIPTION	DATE
0	ISSUED FOR CONSTRUCTION	06.14.11

GRAPHIC SCALE: 0" 1"

SCALE:	1/4" = 1'-0"
PROJECT MANAGER:	DIV
IC/DRAWN BY:	CDS
A/E OF RECORD:	JPP
PROJECT NO:	11011
DATE:	06.14.11

SHEET TITLE:
BASEMENT
POWER PLANS

SHEET No.
EP101

©COPYRIGHT 2008 SMRT INC.