



NOTE:




1. SEE SHEET E-001 FOR LEGEND AND GENERAL NOTES.

KEYED NOTES:

- ① IN EXISTING PANELBOARD HPA REMOVE A 225A, 3P SPARE CIRCUIT BREAKER AND REPLACE WITH A NEW 300A, 3P CIRCUIT BREAKER TO FEED NEW GE UPS. NEW CIRCUIT BREAKER TO HAVE SAME SHORT CIRCUIT RATING AS OTHER BREAKERS CURRENTLY INSTALLED IN PANELBOARD.
- ② IN EXISTING PANELBOARD EQ21 FURNISH & INSTALL A NEW 30 AMP, TWO POLE CIRCUIT BREAKER (CIRCUITS 28 & 30) TO FEED NEW SPLIT SYSTEM AND UTILIZE AN EXISTING 20 AMP, SINGLE POLE SPARE CIRCUIT BREAKER (CIRCUIT 3) TO FEED NEW CONDENSATE PUMP RECEPTACLES. NEW CIRCUIT BREAKER TO HAVE SAME SHORT CIRCUIT RATING AS OTHER BREAKERS CURRENTLY INSTALLED IN PANELBOARD.
- ③ IN EXISTING PANELBOARD EQ41 REMOVE A 20A, 3P SPARE CIRCUIT BREAKER (CIRCUITS 19, 21 & 23) AND REPLACE WITH A NEW 15A, THREE POLE CIRCUIT BREAKER TO FEED NEW DIMPLEX HEAT EXCHANGER EC-1 AT LOCATION SHOWN ON EP120. NEW CIRCUIT BREAKER TO HAVE SAME SHORT CIRCUIT RATING AS OTHER BREAKERS CURRENTLY INSTALLED IN PANELBOARD.
- ④ IN EXISTING PANELBOARD LP41 UTILIZE AN EXISTING 20 AMP, SINGLE POLE SPARE CIRCUIT BREAKER (CIRCUIT 9) TO FEED NEW LIGHTS SHOWN ON EL100. NEW CIRCUIT BREAKER TO HAVE SAME SHORT CIRCUIT RATING AS OTHER BREAKERS CURRENTLY INSTALLED IN PANELBOARD.
- ⑤ IN EXISTING PANELBOARD LS21 FURNISH & INSTALL TWO NEW 20, SINGLE POLE CIRCUIT BREAKERS TO FEED NEW MRI ROOM LIGHTS SHOWN ON EL100. NEW CIRCUIT BREAKER TO HAVE SAME SHORT CIRCUIT RATING AS OTHER BREAKERS CURRENTLY INSTALLED IN PANELBOARD.

144 Fore Street/P.O. Box 618
 Portland, Maine 04104
 Tel. (207) 772-3846
 Fax. (207) 772-1070
 www.smartinc.com

ARCHITECTURE
 ENGINEERING
 PLANNING
 INTERIOR DESIGN
 COMMISSIONING

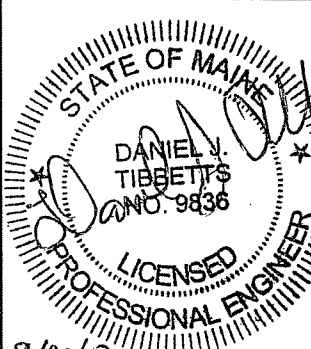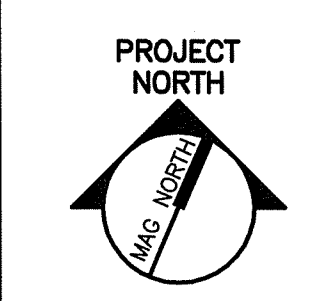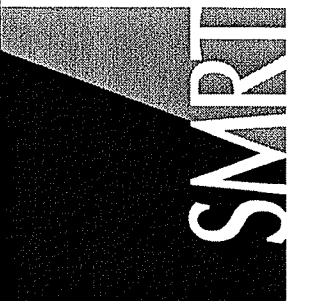

MAINE MEDICAL CENTER
 MRI #1 AND READING ROOM RENOVATION
 PORTLAND, MAINE
 ISSUED FOR CONSTRUCTION
 9-20-13
 CURRENT ISSUE STATUS:

REV	DESCRIPTION	DATE
0	ISSUED FOR CONSTRUCTION	9-20-13

GRAPHIC SCALE:
 0" 1"

SCALE: 1/8"=1'-0"
 PROJECT MANAGER: DJV
 JC/DRAWN BY: CDS
 A/E OF RECORD: DJT
 CAD FILE: E-100-12118
 PROJECT NO: 12118
 DATE: 9-20-13

SHEET TITLE:
 STANDARD
 POWER PLAN

SHEET No.
E-100
 © COPYRIGHT 2013 SMART INC.

A1 PLAN
 1/8"=1'-0"