





**NOTE:**  
 1. SEE SHEET E-001 FOR LEGEND AND GENERAL NOTES.

- KEYED NOTES:**
- ① REMOVE MODULAR FURNITURE FEED AND ALL ASSOCIATED CONDUIT AND WIRING BACK TO SOURCE.
  - ② REMOVE ALL EXISTING TELECOMMUNICATIONS EQUIPMENT AND OUTLETS CURRENTLY LOCATED IN TELECOMMUNICATIONS CLOSET.
  - ③ REMOVE ALL CONDUIT AND WIRING ASSOCIATED WITH X-RAY VIEW BOX.
  - ④ REMOVE ALL MRI ROOM CEILING MOUNTED LIGHTS, DC LIGHTING CONTROLLER IN THE EQUIPMENT ROOM AND CONTROL SWITCHES IN CONTROL ROOM. REMOVE ALL ASSOCIATED CONDUIT & WIRING BACK TO SOURCE.
  - ⑤ RELOCATE SMOKE DETECTOR AT LOCATION SHOWN ON EY100. EXTEND EXISTING WIRING AS REQUIRED TO ACCOMMODATE NEW DEVICE LOCATION.
  - ⑥ REMOVE VOICE/DATA OUTLET COVER PLATE TO ALLOW INSTALLATION OF INSULATION AND NEW GYBOARD WALL. REINSTALL COVER PLATE AFTER NEW WALL IS COMPLETED.
  - ⑦ REMOVE VOICE/DATA OUTLET AND COVER PLATE AND INSTALL BOX EXTENSIONS OR RELOCATE OUTLET BOX TO ALLOW NEW WALL TO BE INSTALLED OVER EXISTING WALL. REINSTALL VOICE/DATA OUTLET AND COVER PLATE AFTER NEW WALL IS COMPLETED.
  - ⑧ REMOVE RECEPTACLE AND COVER PLATE TO ALLOW INSTALLATION OF INSULATION AND NEW GYBOARD WALL. REINSTALL DEVICE AND COVER PLATE AFTER NEW WALL IS COMPLETED.
  - ⑨ REMOVE RECEPTACLE AND COVER PLATE AND INSTALL BOX EXTENSIONS OR RELOCATE OUTLET BOX TO ALLOW NEW WALL TO BE INSTALLED OVER EXISTING WALL. REINSTALL DEVICE AND COVER PLATE AFTER NEW WALL IS COMPLETED.
  - ⑩ REMOVE MRI MAIN DISCONNECT, EMO BUTTON, RF FILTERS AND ALL CONDUIT, RACEWAYS AND WIRING ASSOCIATED WITH THE CURRENT MRI SYSTEM THAT IS BEING REPLACED.
  - ⑪ EXISTING PANELBOARD P2 TO BE REMOVED AND REPLACED WITH A NEW 42 CIRCUIT PANELBOARD. RECONNECT EXISTING PANELBOARD FEEDER AND ALL REMAINING BRANCH CIRCUITS TO NEW PANELBOARD. EXISTING PANELBOARD ENCLOSURE MAY BE REUSED IF NEW 42 CIRCUIT INTERIOR WILL FIT IN EXISTING ENCLOSURE.
  - ⑫ EXISTING RECEPTACLE AND VOICE/DATA OUTLET TO BE REMOVED TO ALLOW DEMOLITION OF EXISTING WALL AND REINSTALL IN NEW WALL.
  - ⑬ EXISTING LIGHTS AND EXIT SIGN TO BE RELOCATED AT LOCATIONS SHOWN ON EL100 TO ALLOW CONSTRUCTION OF NEW WALL. EXTEND EXISTING WIRING AS REQUIRED TO ACCOMMODATE NEW LOCATIONS.

144 Fore Street/P.O. Box 618  
 Portland, Maine 04104  
 tel. (207) 772-3846  
 fax. (207) 772-1070  
 www.smrinc.com

ARCHITECTURE  
 ENGINEERING  
 PLANNING  
 INTERIOR DESIGN  
 COMMISSIONING

**SMRT**

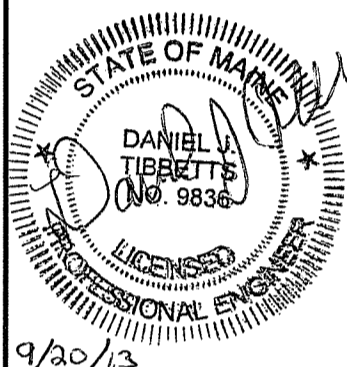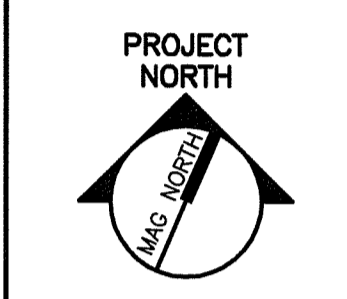

9/20/13

MAINE MEDICAL CENTER  
 MRI #1 AND READING ROOM RENOVATION  
 PORTLAND, MAINE

ISSUED FOR CONSTRUCTION  
 9-20-13

CURRENT ISSUE STATUS:

REV	DESCRIPTION	DATE
0	ISSUED FOR CONSTRUCTION	9-20-13

GRAPHIC SCALE:  
 0" 1"

SCALE: 1/4"=1'-0"  
 PROJECT MANAGER: DJV  
 JC/DRAWN BY: CDS  
 A/E OF RECORD: DJT  
 CAD FILE: ED100-1211B  
 PROJECT NO: 1211B  
 DATE: 9-20-13

SHEET TITLE:  
**ELECTRICAL DEMOLITION PLAN**

SHEET No.  
**ED100**  
 © COPYRIGHT 2013 SMRT INC.

A1 PLAN  
 1/4"=1'-0"