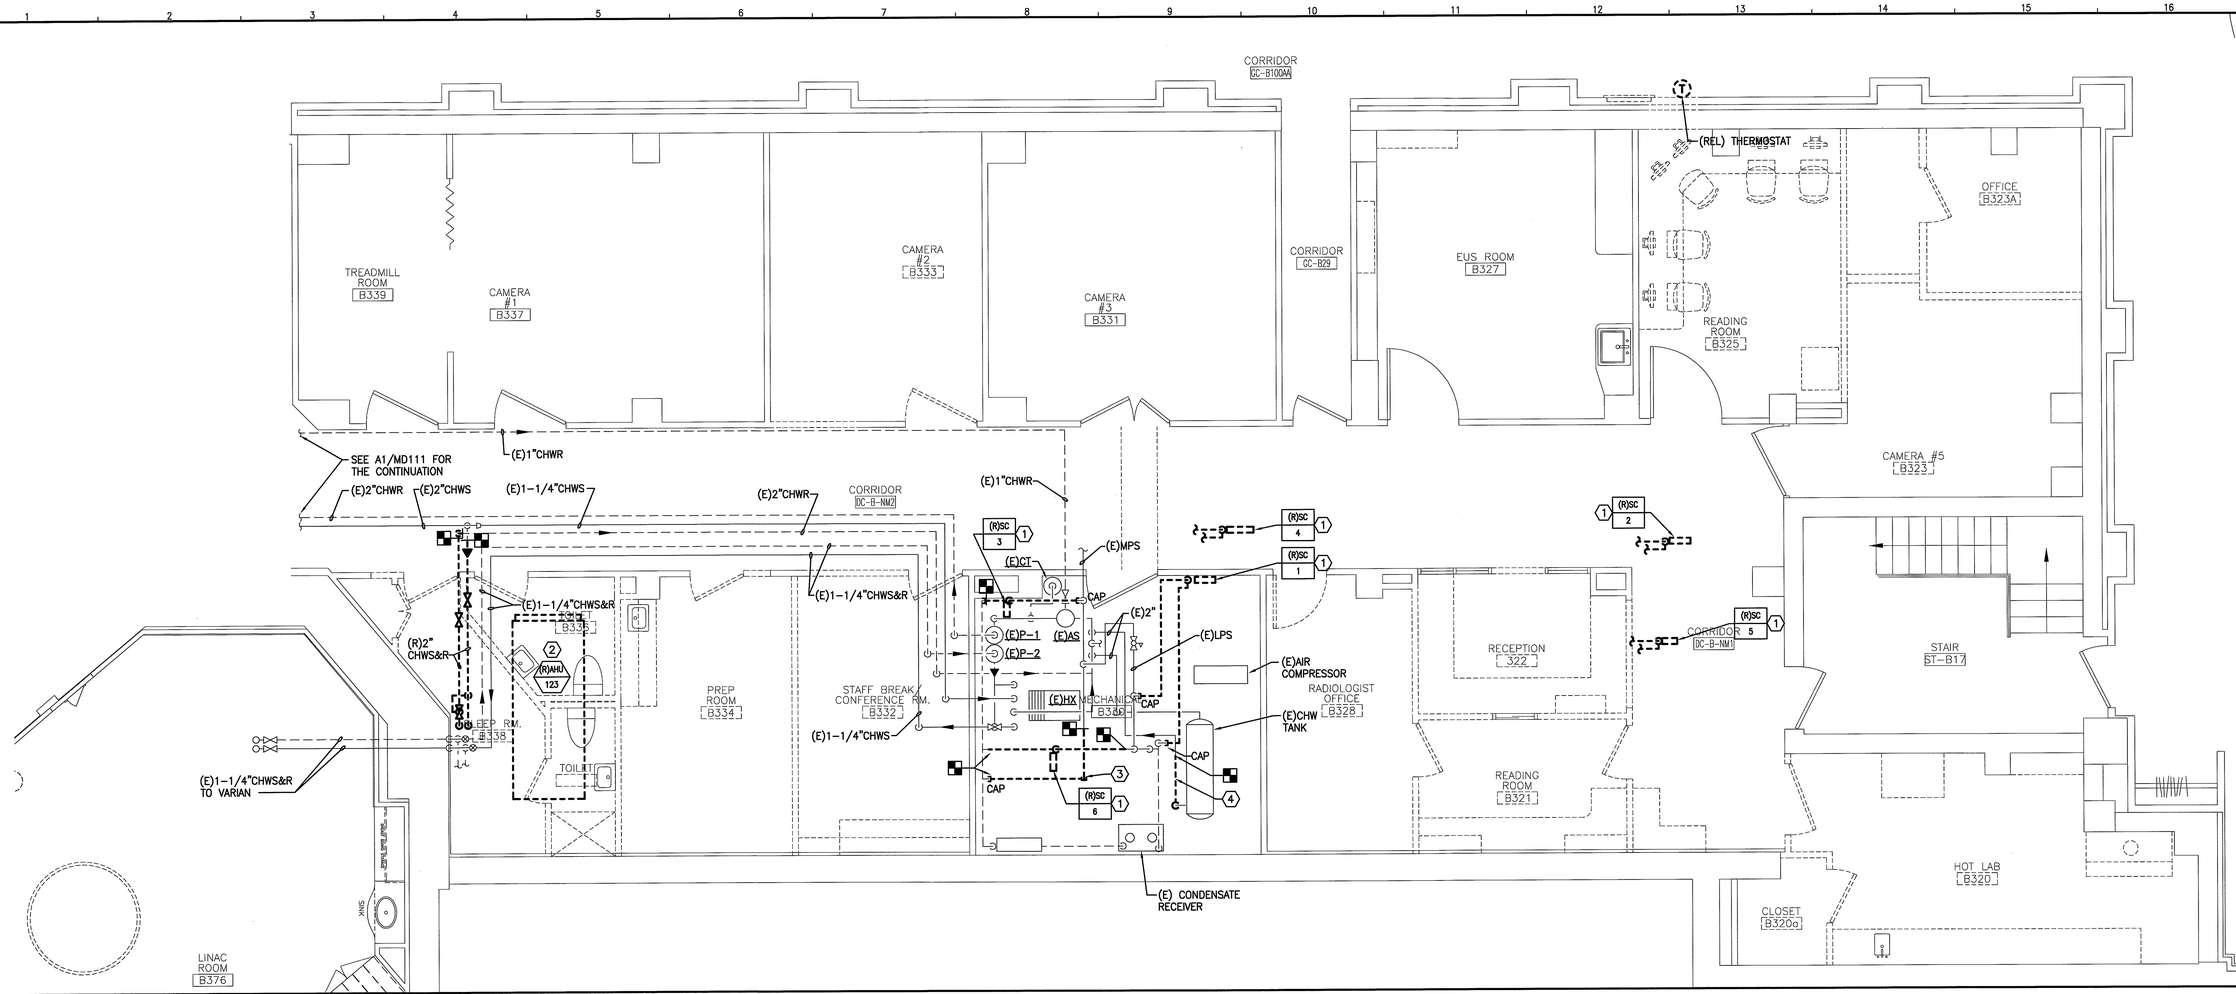

F1 HVAC PIPING DEMOLITION PLAN

1/4"=1'-0" *

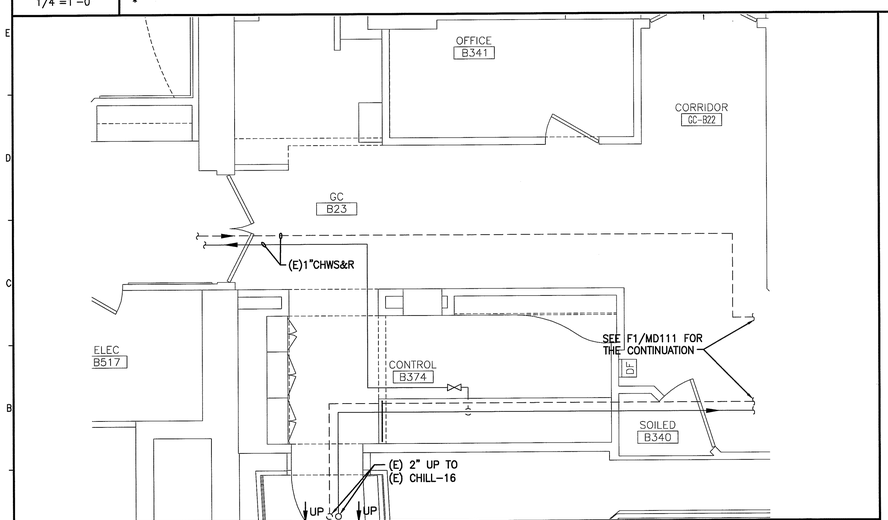

A1 HVAC PIPING DEMOLITION PART PLAN

1/4"=1'-0" *

DEMOLITION KEY NOTES:

1. REMOVE STEAM COILS AND ALL ASSOCIATED STEAM AND CONDENSATE PIPING. REMOVE PIPING BACK TO MAINS AND CAP. REMOVE ALL ASSOCIATED THERMOSTATS.
2. REMOVE AHU-123 IN ITS ENTIRETY. REMOVE CHILLED WATER PIPING BACK TO MAINS AND CAP. REMOVE ALL ASSOCIATED HANGERS.
3. REMOVE PORTION OF STEAM MAIN AND ASSOCIATED END OF MAIN DRIP
4. REMOVE PORTION OF CHILLED WATER PIPING TO ALLOW FOR INSTALL OF NEW EXHAUST FAN ABOVE CHILLER BARREL.

144 Fore Street/P.O. Box 618
Portland, Maine 04104
tel. (207) 772-3846
fax. (207) 772-1070
www.smrtinc.com

ARCHITECTURE
ENGINEERING
PLANNING
INTERIOR DESIGN
COMMISSIONING

SMRT

PROJECT NORTH
MAG. NORTH

STATE OF MAINE
KATHERINE M. EVERETT
No. 7658
REGISTERED
PROFESSIONAL ENGINEER
3/13/14

MAINE MEDICAL CENTER
NUCLEAR MEDICINE RENOVATIONS
PORTLAND, MAINE

ISSUED FOR CONSTRUCTION
3-13-14

CURRENT ISSUE STATUS:

REV	DESCRIPTION	DATE
0	ISSUED FOR CONSTRUCTION	3-13-14

GRAPHIC SCALE: 0" 1"

SCALE:	1/4=1'-0"
PROJECT MANAGER:	DJV
JC/DRAWN BY:	FV
A/E OF RECORD:	KME
CAD FILE:	MD111-13128
PROJECT NO:	13128
DATE:	3-13-14

SHEET TITLE:
HVAC PIPING DEMOLITION PLAN

SHEET No.
MD111

© COPYRIGHT 2013 SMRT INC.