BOOM SCHEDULE		
ROOM NO.	TAG	BOOM CONFIGURATION
HYBRID OR	1	Tandom Mount Plate with (2) Boom Arms: Equipment Boom Arm with (4) Shelves. Boom Arm with (4) monitors, stacked (2) over (2)
HYBRID OR	2	Spindle Mount with (3) Arms: (1) Surgical Light, (1) Arm with (2) monitors for integration by BDV, and (1) Arm with Lead Shield.
HYBRID OR	3	Add Alternate #2: Equipment Boom: (1) Motor Driven Perfusion Power Boom with all required medical gases, electrical, and data
HYBRID OR	4	Spindle Mount with (3) Arms: (1) Surgical Light, (1) Arm with (2) monitors for GE Live & Reference, and (1) Arm with Lead Shield.
OR06	5	Spindle Mount with (3) Arms:(2) Surgical Lights and (1) Arm with (2) monitors
OR06	6	Spindle Mount with (3) Arms:(2) Surgical Lights and (1) Arm with (2) monitors


NOTE: SCHEDULE PROVIDED FOR COORDINATION ONLY. ALL BOOMS ARE TO BE OFOI

REFLECTED CEILING PLAN LEGEND

- L13 LINEAR SURFACE MOUNTED T8, UNDERCABINET TASK LIGHT
- R11 RECESSED CEILING FLOURESCENT T8, ANTI-MICROBIAL
- R12 RECESSED CEILING FLOURESCENT 2 X 2, ANTI-MICROBIAL
- R13 RECESSED CEILING FLOURESCENT 2 X 2
- E EXISTING 2 X 2 TO BE RELOCATED
- ACT-1 2x2 SUSPENDED ACOUSTICAL CEILING
- ACT-2 2x2 SUSPENDED ACOUSTICAL CEILING, WASHABLE, CLIP-DOWN
- EXISTING
- GWB CEILING
- EXPANSION JOINT
- ACCESS PANEL
- ANESTHESIOLOGY PANEL
- SERVICE PANEL
- 2x2 SUPPLY
- 2x4 SUPPLY
- 2x2 RETURN
- FIRE ALARM SPEAKER
- SMOKE DETECTOR
- SPRINKLER
- EXIT SIGN
- NURSE CALL/CODE BLUE - CEILING
- NURSE CALL/CODE BLUE - WALL
- SECURITY CAMERA (NIC)
- BOOM
- OCCUPANCY SENSOR
- PUBLIC ADDRESS SPEAKER
- NURSE CALL LAMP
- PHOTO CELL
- WIRELESS OUTLET
- IV TRACK

RCP GENERAL NOTES

1. COORDINATE TEES AND HANGER LOCATIONS WITH LINEAR DIFFUSER/GRILLE BOOTS.
2. SPRINKLER HEAD AND COVER TO BE CUSTOM COLORED BY MANUFACTURER TO MATCH ADJ. CEILING FINISH - COLOR TO BE DETERMINED BY ARCHITECT.
3. DIFFUSER GRILLE TO BE CUSTOM COLORED TO MATCH ADJACENT CEILING FINISH. COLOR TO BE DETERMINED BY ARCHITECT.
4. UNLESS OTHERWISE NOTED, CENTER ALL SUSPENDED CEILING GRIDS WITHIN ROOM.
5. CENTER ALL LIGHT FIXTURES, SPRINKLER HEADS, ETC. IN CEILING TILE UNLESS OTHERWISE NOTED.
6. SEE ENGINEERING DRAWINGS FOR ADDITIONAL INFORMATION, I.E. LIGHT FIXTURES, DIFFUSERS AND OTHER CEILING MOUNTED DEVICES.
7. COORDINATE CEILING MOUNTED EQUIPMENT FINAL LAYOUT WITH OWNER AND VENDOR INSTALLATION DRAWINGS.

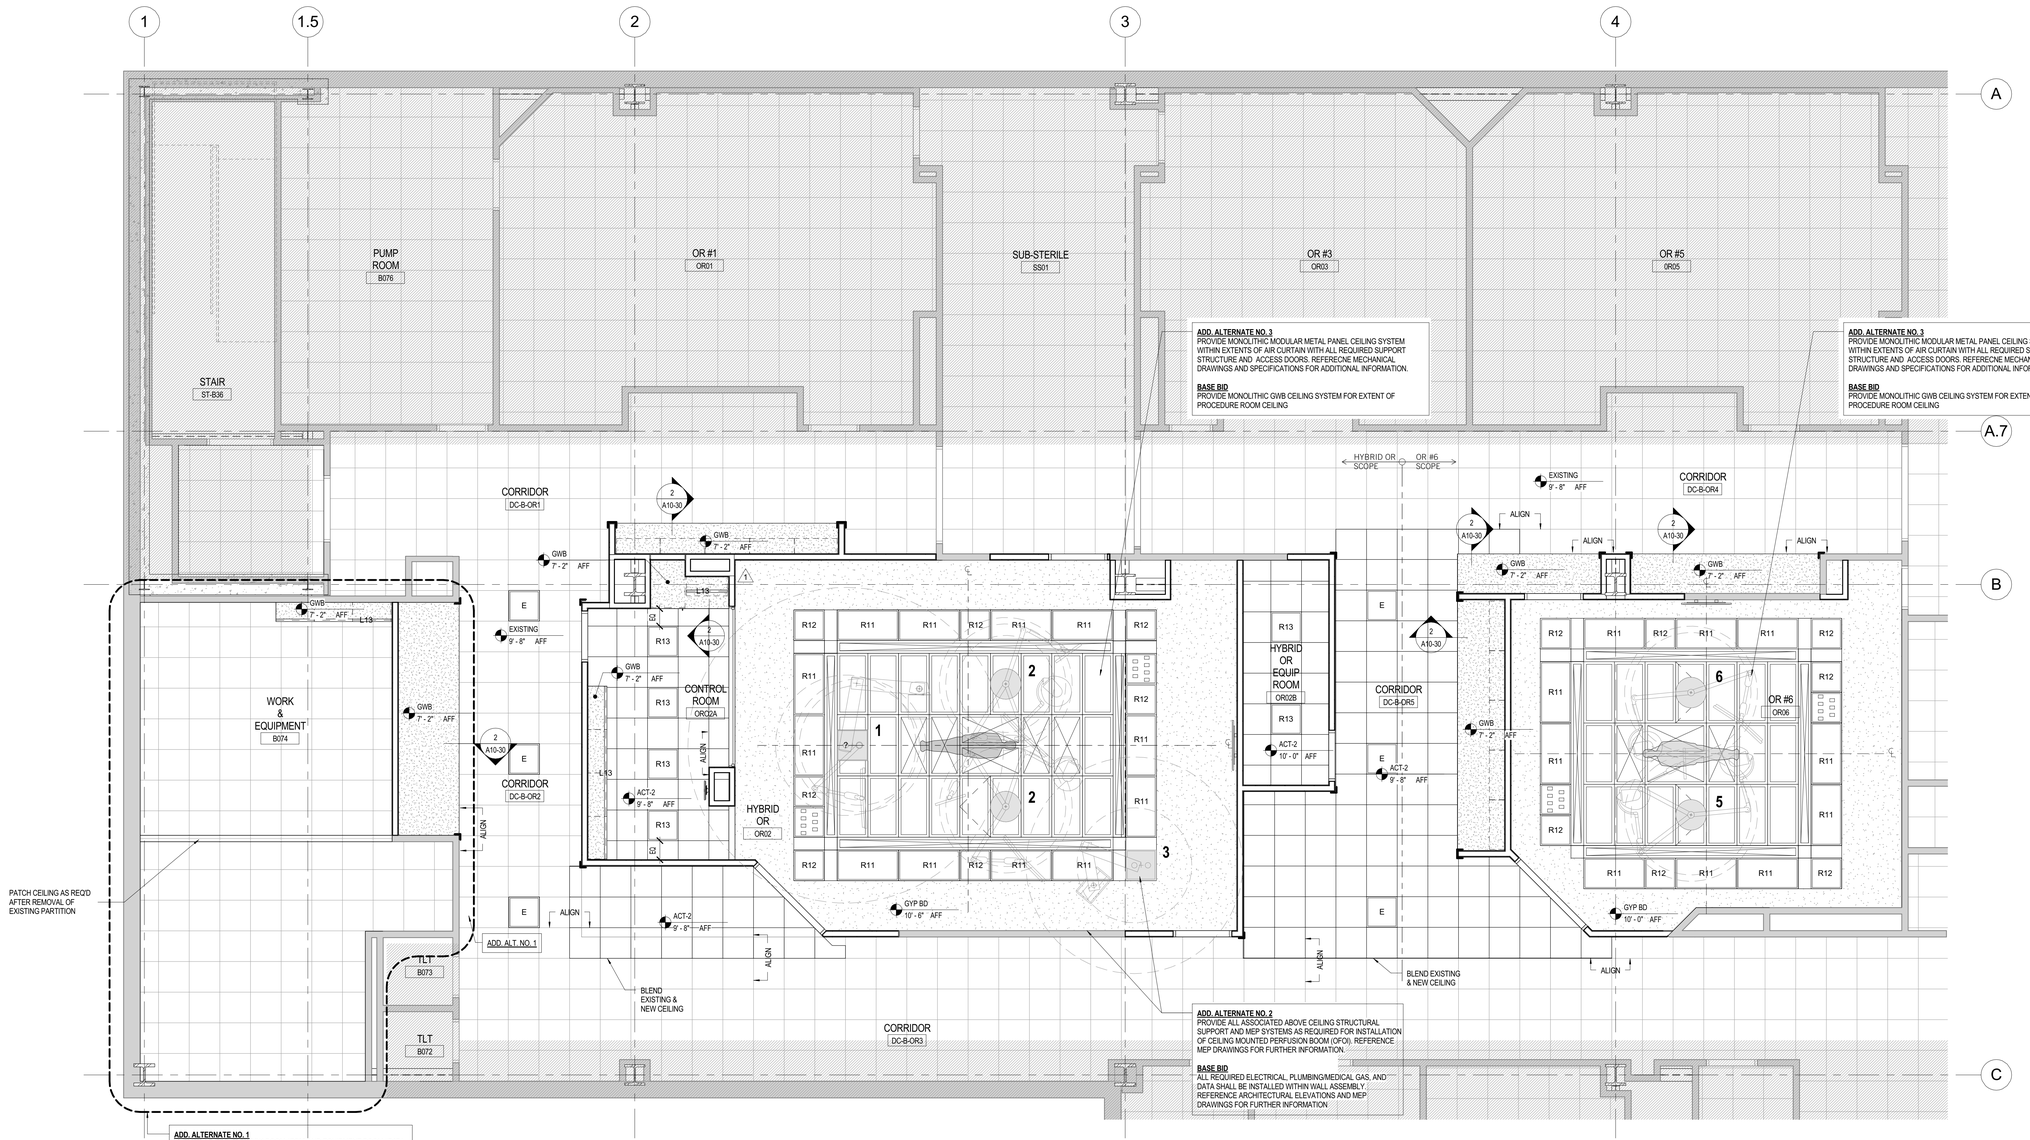

1 BASEMENT REFLECTED CEILING PLAN
1/4" = 1'-0"

Reviewed for Code Compliance
Portland Fire Prevention Division
Approved with Conditions
Date: 10/16/15

Perkins+Will
225 Franklin St., Suite 1100
Boston, MA 02110
t 617.478.0300
f 617.478.0321
www.perkinswill.com

Maine Medical Center
MaineHealth

HYBRID OR & OR #6

22 Bramhall Street, Portland, Maine 04102

MEP ENGINEER
AKF ENGINEERS
41 Farnsworth Street, 3rd Floor
Boston, MA 02210
t 617.737.1111
f 617.737.4311

STRUCTURAL ENGINEER
SIMPSON GUMPERTZ & HEGER
41 Seyon Street, Building 1, Suite 500
Waltham, MA 02453
t 781.907.9000
f 781.907.9009

D C A B

LICENSED ARCHITECT DENNIS L. KAISER No. 2734 STATE OF MAINE

Revisions

	ISSUED FOR PERMIT	08.21.2015
1	Addendum 1	08.21.2015
	ISSUED FOR BID	07.31.2015
NO	ISSUE	DATE

Sheet Information

Date	AUGUST 21, 2015
Job #	152168.023
Drawn	Author
Checked	Checker
Approved	Approver

Title

BASEMENT REFLECTED CEILING PLAN - HYBRID OR & OR 6

Sheet

A05-0B

Copyright © 2015 Perkins+Will

8/24/2015 1:39:19 PM
c:\temp\MMC_NEW_HYBRID OR_allesan.esteves@perkinswill.com.rvt