

FIRE ALARM GENERAL NOTES


- 1. ALL DEVICES SHALL BE INSTALLED AT MOUNTING HEIGHTS AND LOCATIONS AS INDICATED ON THE ARCHITECTURAL ELEVATIONS, PART PLANS AND DETAILS. CONTRACTOR SHALL REFER TO THE ARCHITECTURAL DRAWINGS FOR
- INFORMATION. 2. REFER TO DRAWING E000 FOR LEGEND & GENERAL NOTES.
- 3. COORDINATE EXACT LOCATION OF ALL MECHANICAL EQUIPMENT WITH HVAC, PLUMBING AND FIRE PROTECTION
- CONNECT NEW FIRE ALARM SYSTEM DEVICES TO THE EXISTING SYSTEM (FIELD VERIFY EXACT LOCATION OF FIRE ALARM TERMINAL CABINET). REPROGRAM SYSTEM AND ADD POWER SUPPLIES, SIGNAL MODULES, ETC. AS REQUIRED TO ACCOMMODATE ADDITIONS. INSTALLATION SHALL CONFORM TO BUILDING STANDARDS. THE CONTRACTOR SHALL PROVIDE
- ALL NECESSARY EQUIPMENT AND FINAL CONNECTIONS, PROGRAMMING AND PERFORM ALL TESTING. REFER TO THE FIRE ALARM RISER DIAGRAM ON DRAWING <u>E***</u> <u>FOR ADDITIONAL INFORMATION.</u>

FIRE ALARM KEYED NOTES




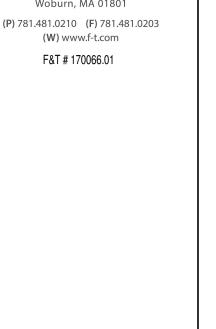


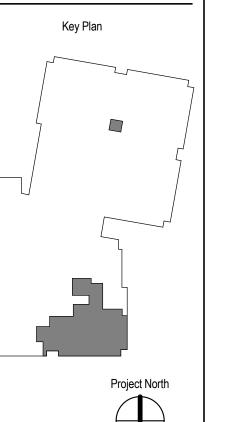






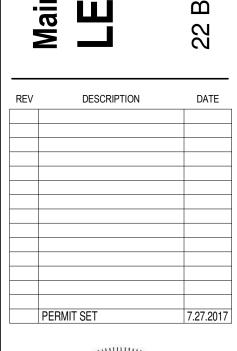





GRAPHIC SCALE

SCALE: 1/4" = 1' - 0"

