


NO.	ISSUE	DATE
1	ADDENDUM 1	03.22.18
IND		
Job Number	152181.000	
Drawn	REE	
Checked	BMT	
Approved	JHT	

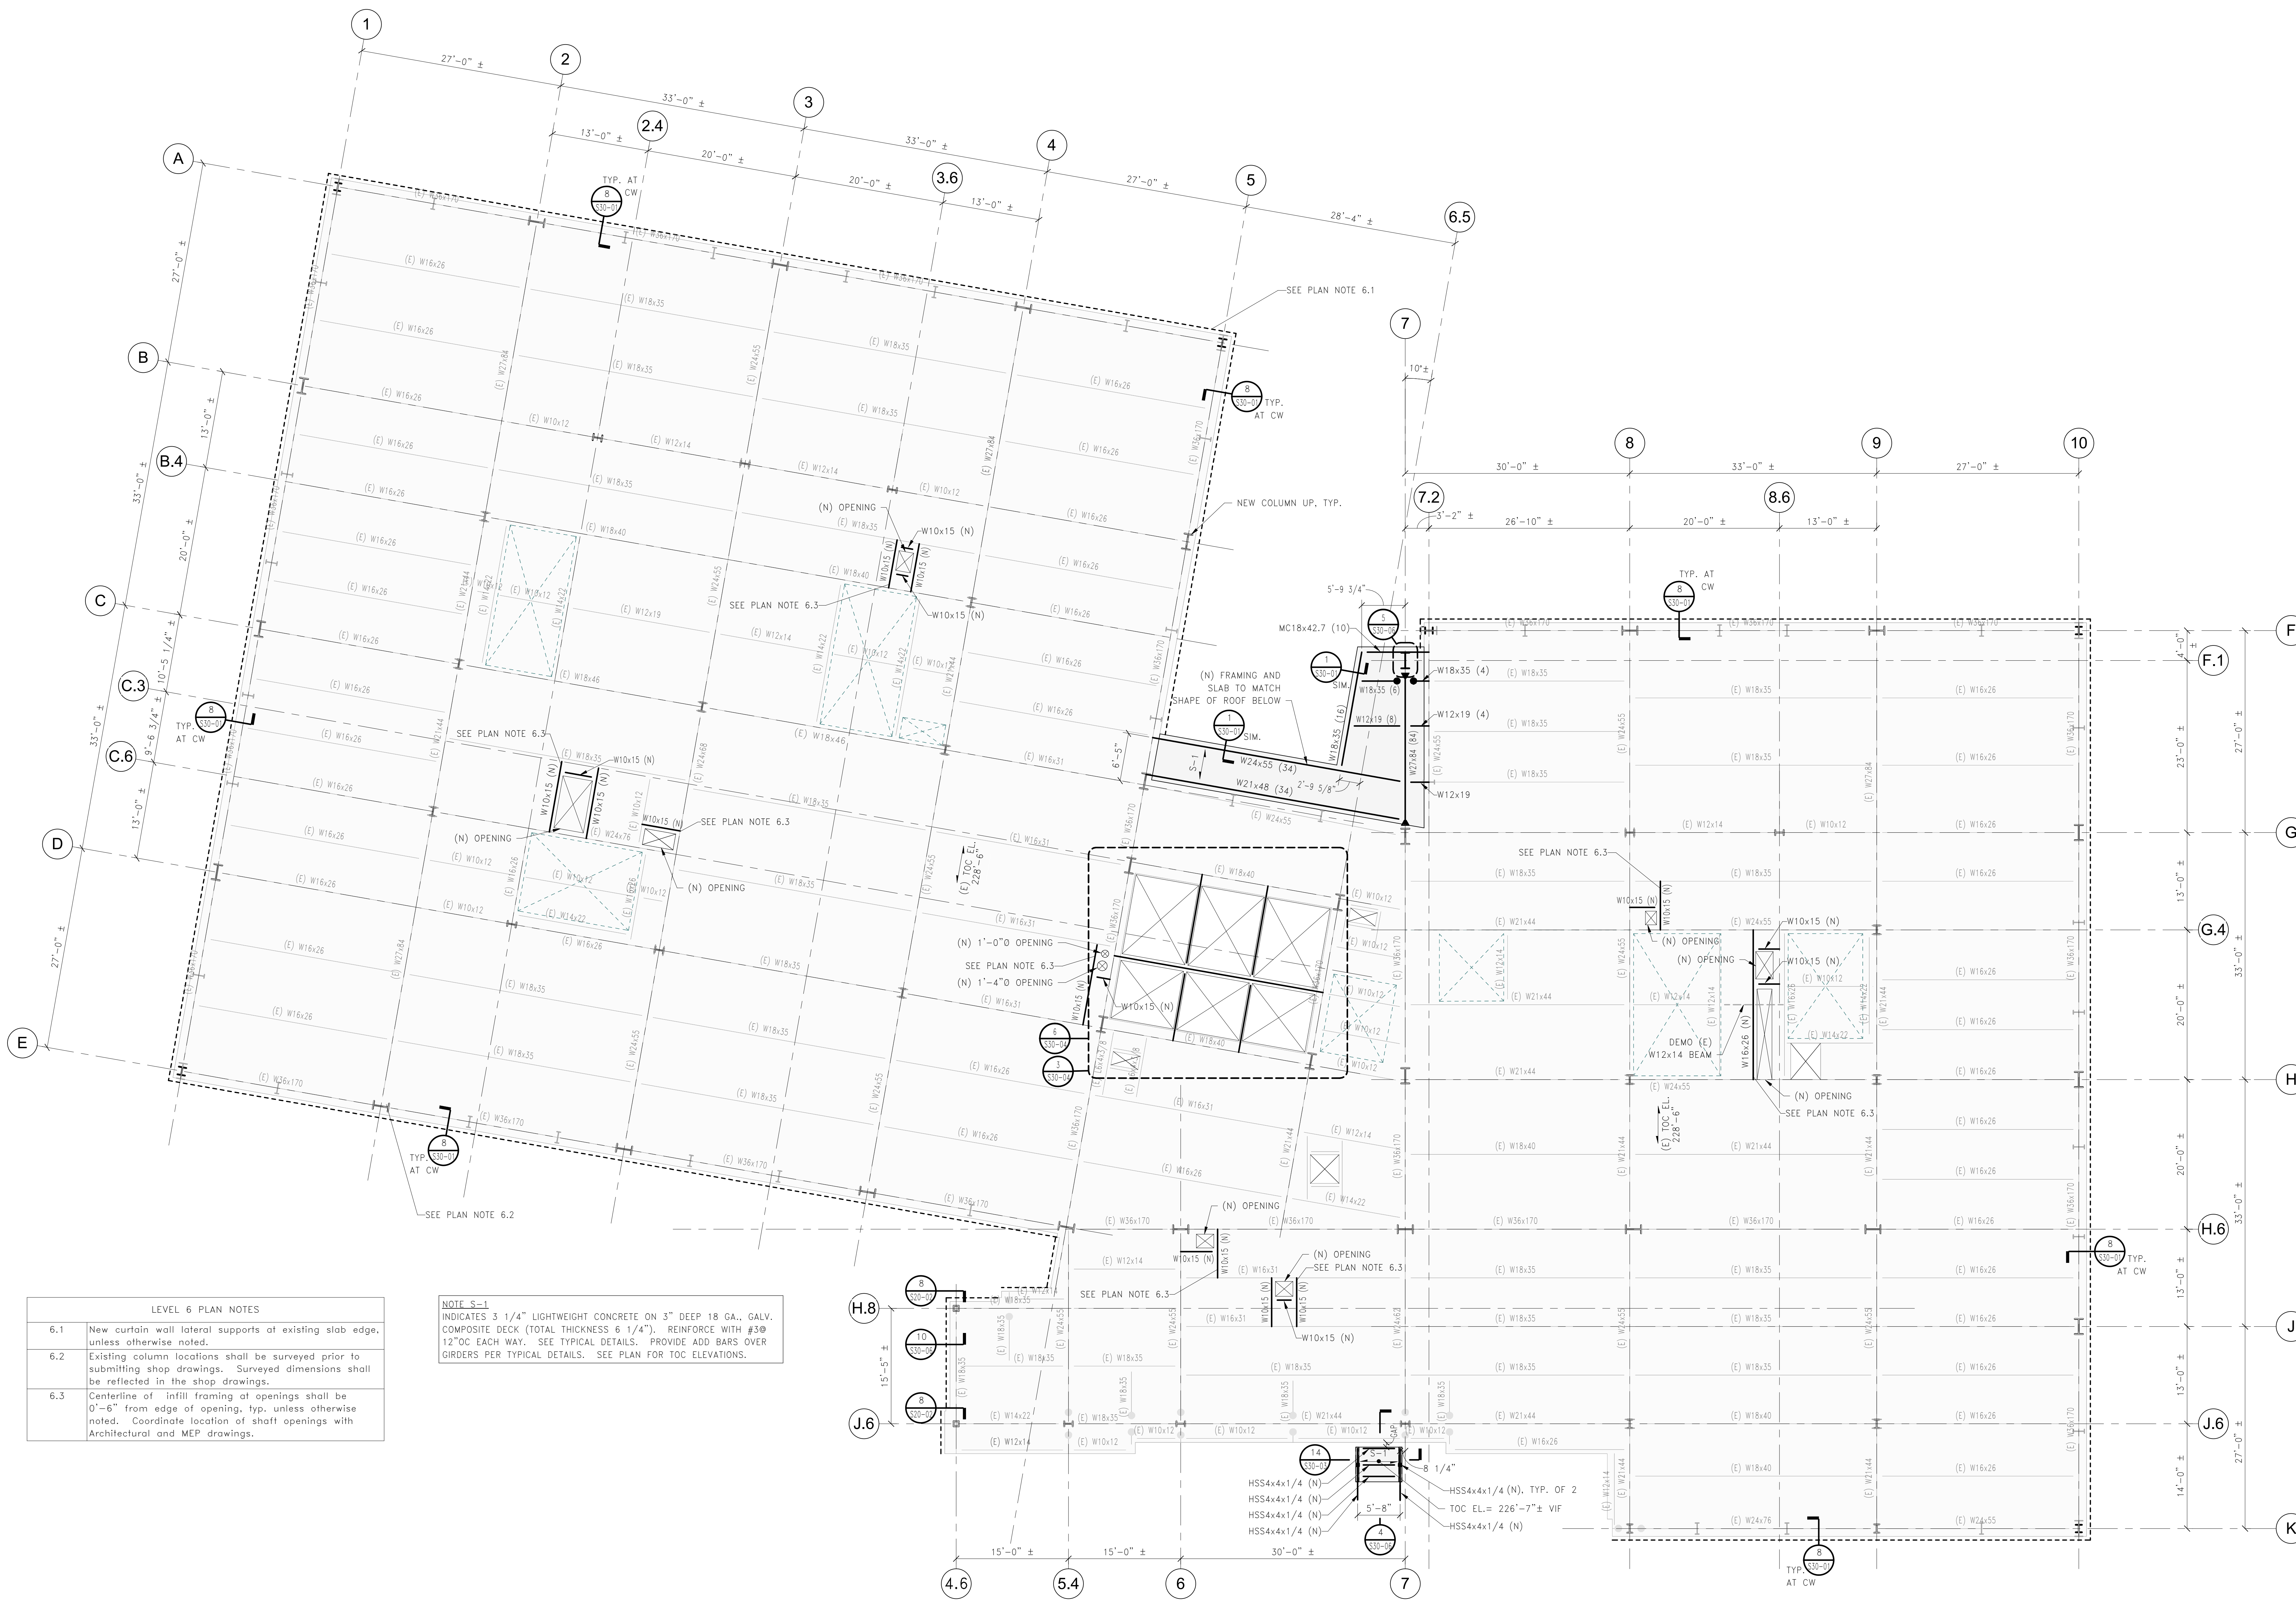

LEVEL 6 PLAN NOTES	
6.1	New curtain wall lateral supports at existing slab edge, unless otherwise noted.
6.2	Existing column locations shall be surveyed prior to submitting shop drawings. Surveyed dimensions shall be reflected in the shop drawings.
6.3	Centerline of infill framing at openings shall be 0'-6" from edge of opening, typ. unless otherwise noted. Coordinate location of shaft openings with Architectural and MEP drawings.

NOTE S-1
INDICATES 3 1/4" LIGHTWEIGHT CONCRETE ON 3" DEEP 18 GA. GALV. COMPOSITE DECK (TOTAL THICKNESS 6 1/4"). REINFORCE WITH #3@ 12"OC EACH WAY. SEE TYPICAL DETAILS. PROVIDE ADD BARS OVER GIRDERS PER TYPICAL DETAILS. SEE PLAN FOR TOC ELEVATIONS.

LEVEL 6 - EXISTING ROOF FRAMING PLAN - MODIFICATIONS
1/8" = 1'-0"