


1	ADDENDUM NO. 1	03/22/18
NO.	ISSUE	DATE
Job Number	B150312-000	
Drawn	DCC	
Checked	PJR	
Approved	PJR	

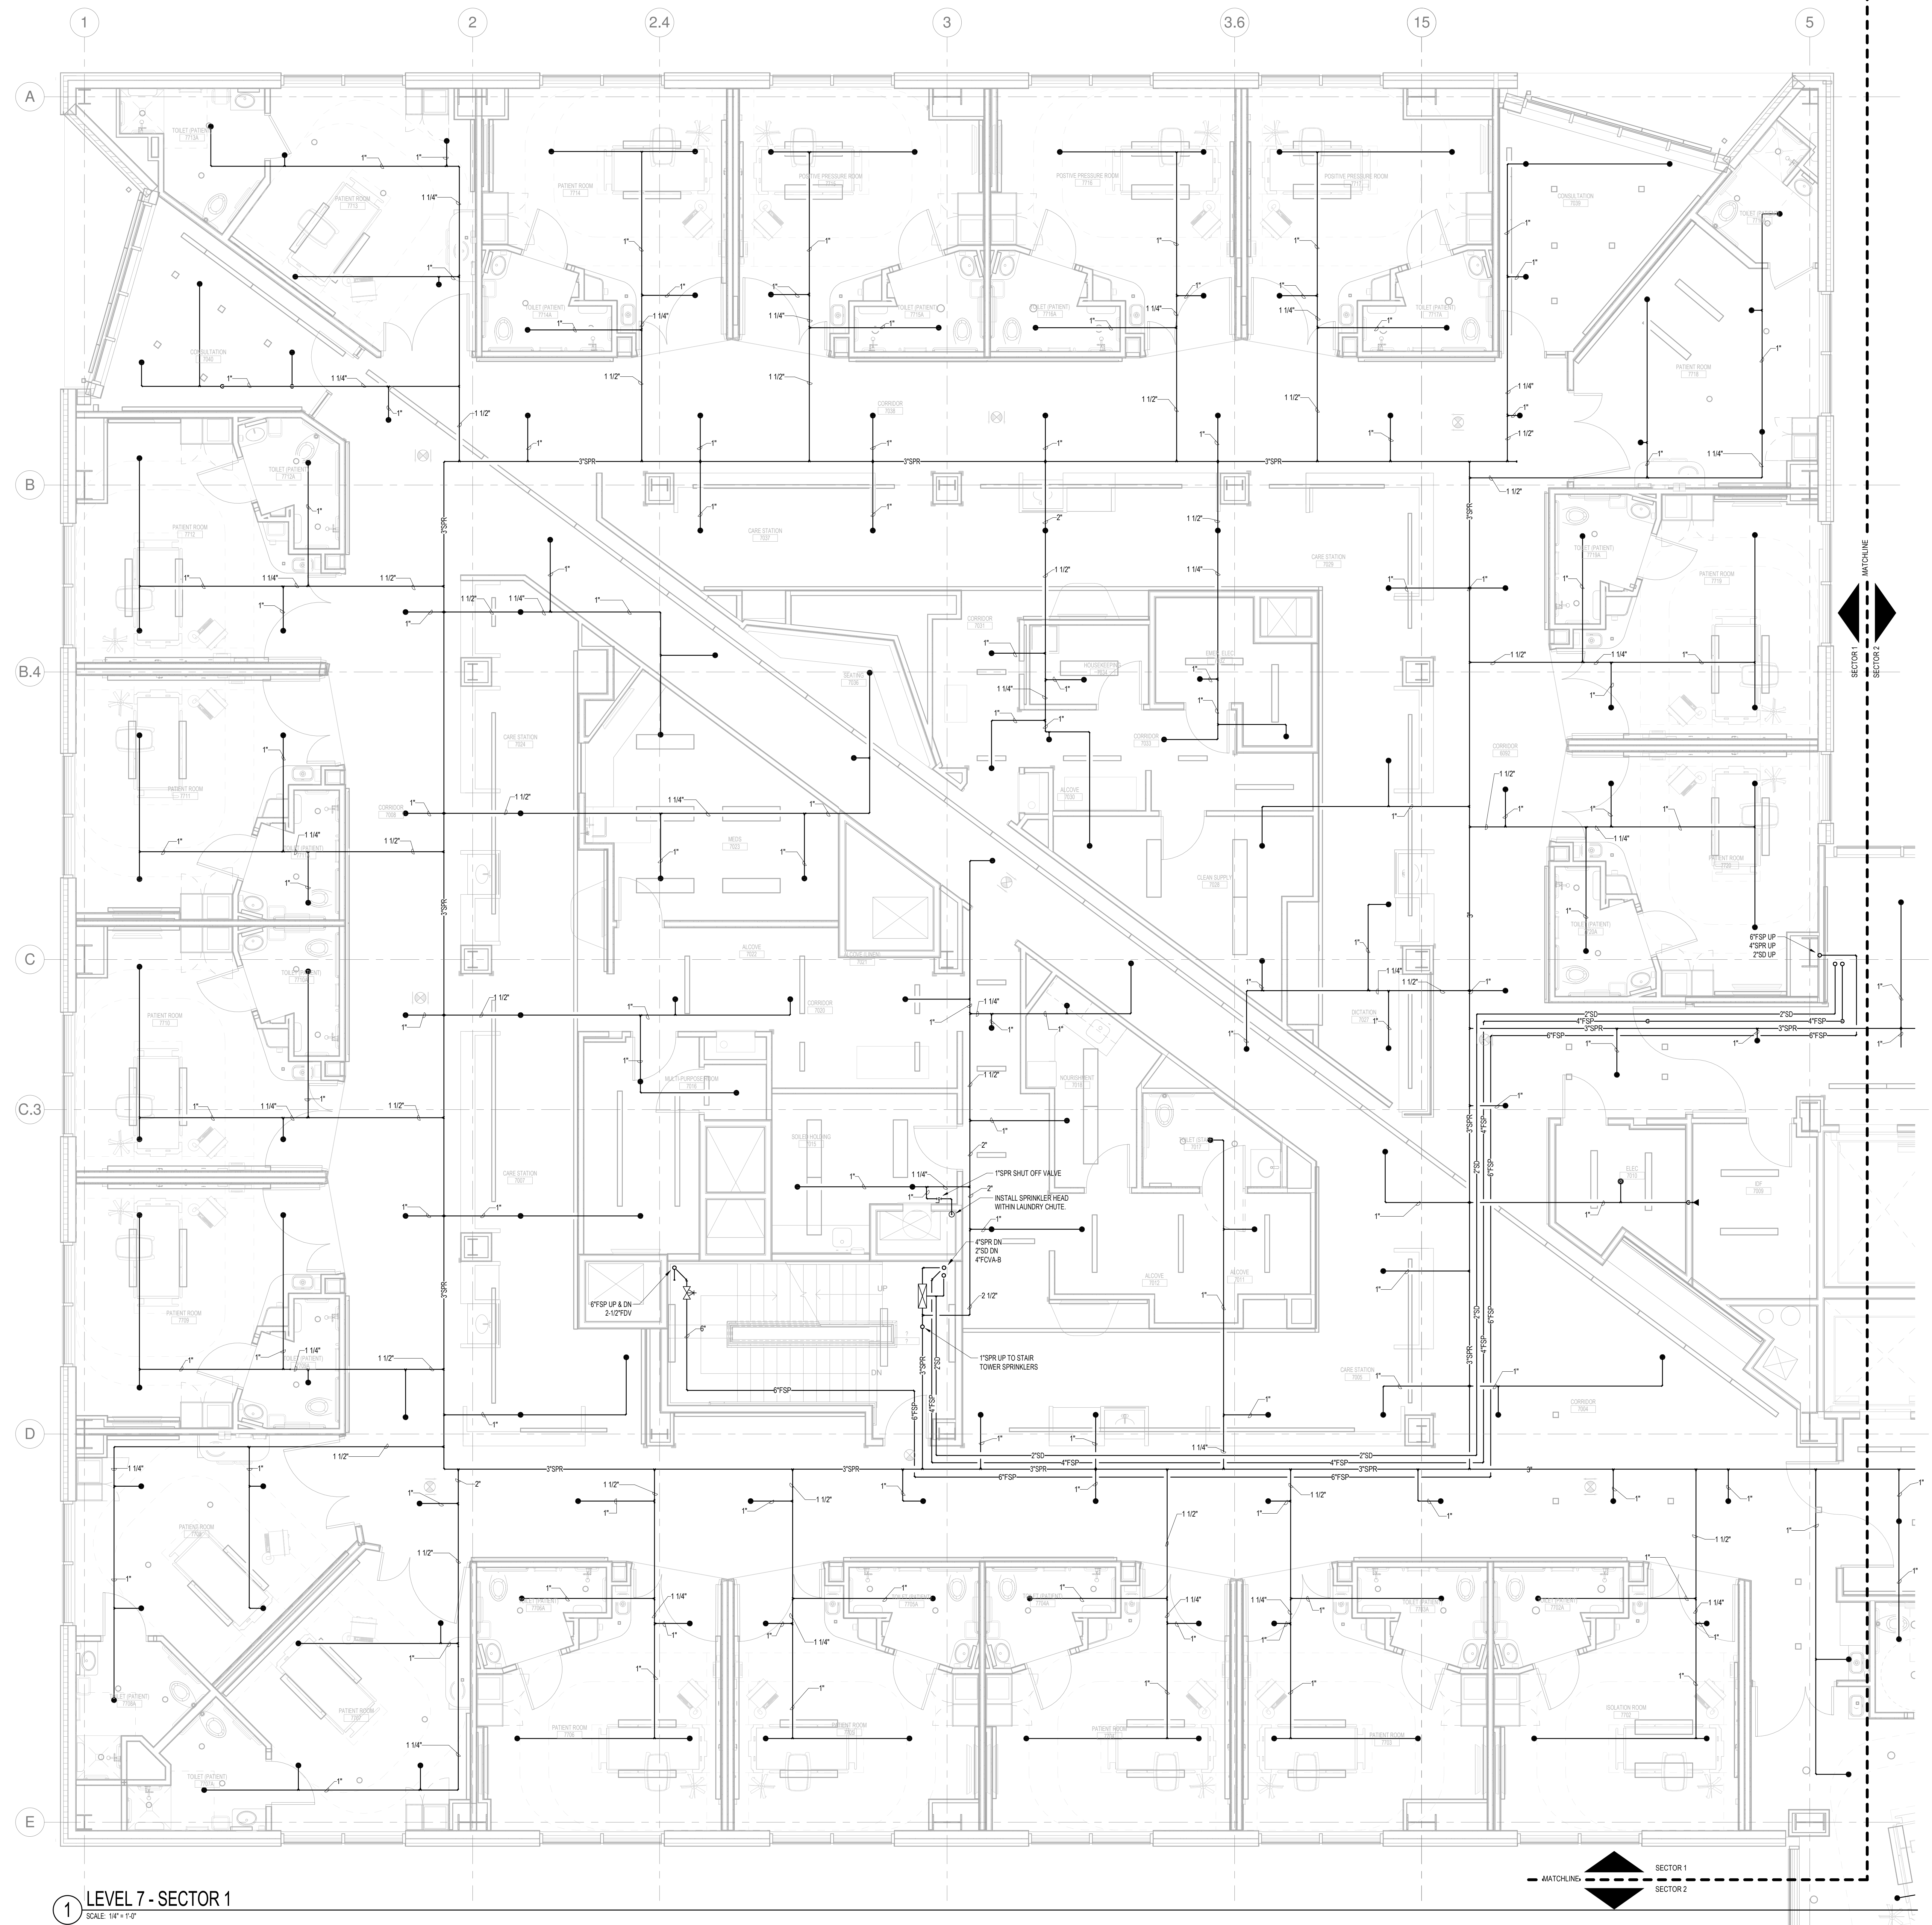

**AUTOMATIC SPRINKLER SYSTEM**  
DESIGN CRITERIA

TYPE	WET
ZONE	FLOORS 6-7
DENSITY	AREA OF APPLICATION 0.10 GPM 1,800 SQ. FT.
225 SQ. FT.	HOSE ALLOWANCE 90 GPM
LIGHT HAZARD	

NOTE:  
1. THIS DESIGN DENSITY USED FOR PATIENT CARE SPACES.

**1 LEVEL 7 - SECTOR 1**  
SCALE: 1/4" = 1'-0"



3/29/2018 11:16:18 AM  
C:\Revit Local Files\_B150312\000\MDC East Tower 6&7 MEP17\_Constr.dwg