


2	ADDENDUM NO. 2	03/29/18
1	ADDENDUM NO. 1	03/22/18
NO	ISSUE	DATE
Job Number	B150312-000	
Drawn	TU	
Checked	DFR	
Approved	DFR	

- DRAWING KEY NOTES:**
- PROVIDE DPM DIFFERENTIAL PRESSURE MONITOR ABOVE DOOR
 - PROVIDE TALL IN WALL VISUAL PRESSURE MONITOR ABOVE DOOR

SUPPLY AIR TERMINAL BOXES:

BOX #	1	2	3	4	5	6	7	8	9	10
CFM MAX	275	292	275	294	275	275	275	275	275	275
CFM MIN	275	292	275	294	275	275	275	275	275	275
CFM	275	292	275	294	275	275	275	275	275	275
SIZE	18x12	18x12	18x12	18x12	18x12	18x12	18x12	18x12	18x12	18x12

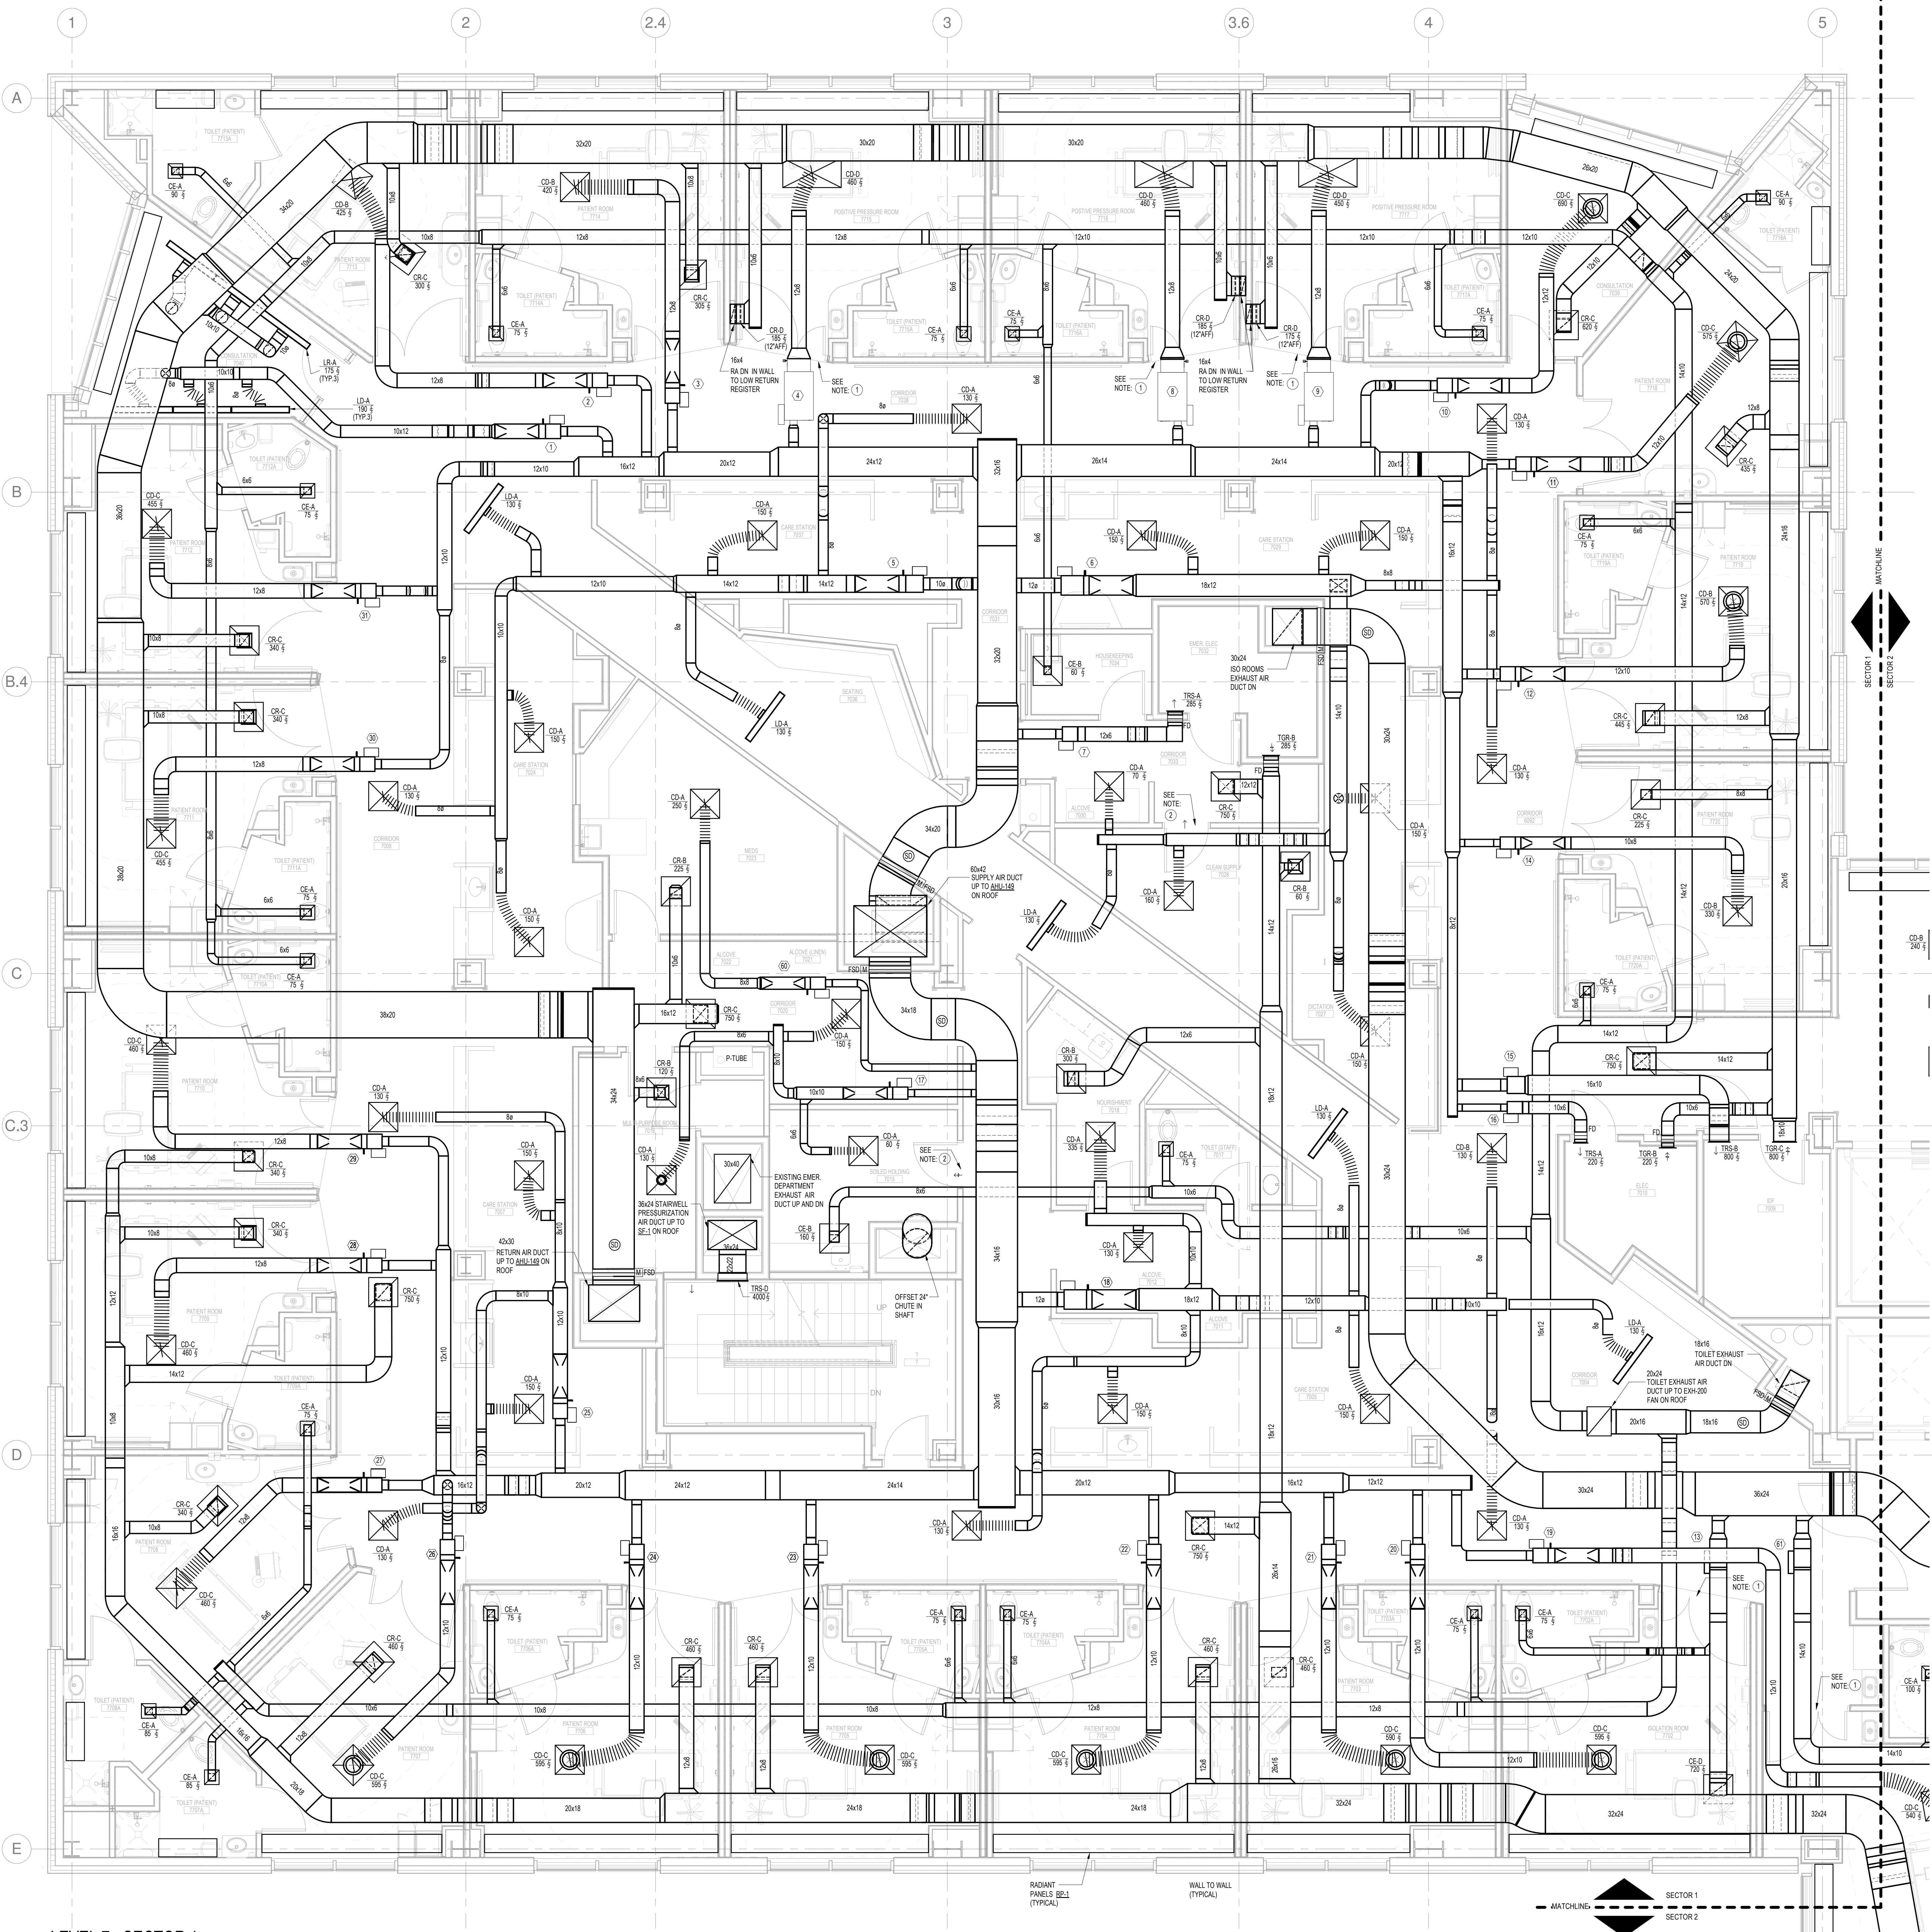

LEVEL 7 - SECTOR 1
 SCALE: 1/4" = 1'-0"

3/29/2018 11:28:18 AM
 C:\Revit Local Files_B\15012-000\MDC East Tower 6&7 MEP17_Constr_documents.rvt