


ADDENDUM NO.	DATE
1	03/22/18
NO	ISSUE
Job Number	B150312-000
Drawn	TU
Checked	DFR
Approved	DFR

- GENERAL NOTES
- MOUNT RADIANT PANEL CONTROL VALVES OUTSIDE OF PATIENT ROOMS.
 - PROVIDE A DUCT/ALTERNATE TO ELIMINATE THE RADIANT PANELS ASSOCIATED ROUNDOUTS AND CONTROLS.

SUPPLY AIR TERMINAL BOXES

BOX #	1	2	3	4	5	6	7	8	9	10
CFM MAX	275	282	275	274	276	276	277	278	279	272
CFM MIN	275	282	275	274	276	276	277	278	279	272
CFM	275	282	275	274	276	276	277	278	279	272
SIZE	1 1/2"	1 1/2"	1 1/2"	1 1/2"	1 1/2"	1 1/2"	1 1/2"	1 1/2"	1 1/2"	1 1/2"
TYPE	1	2	3	4	5	6	7	8	9	10

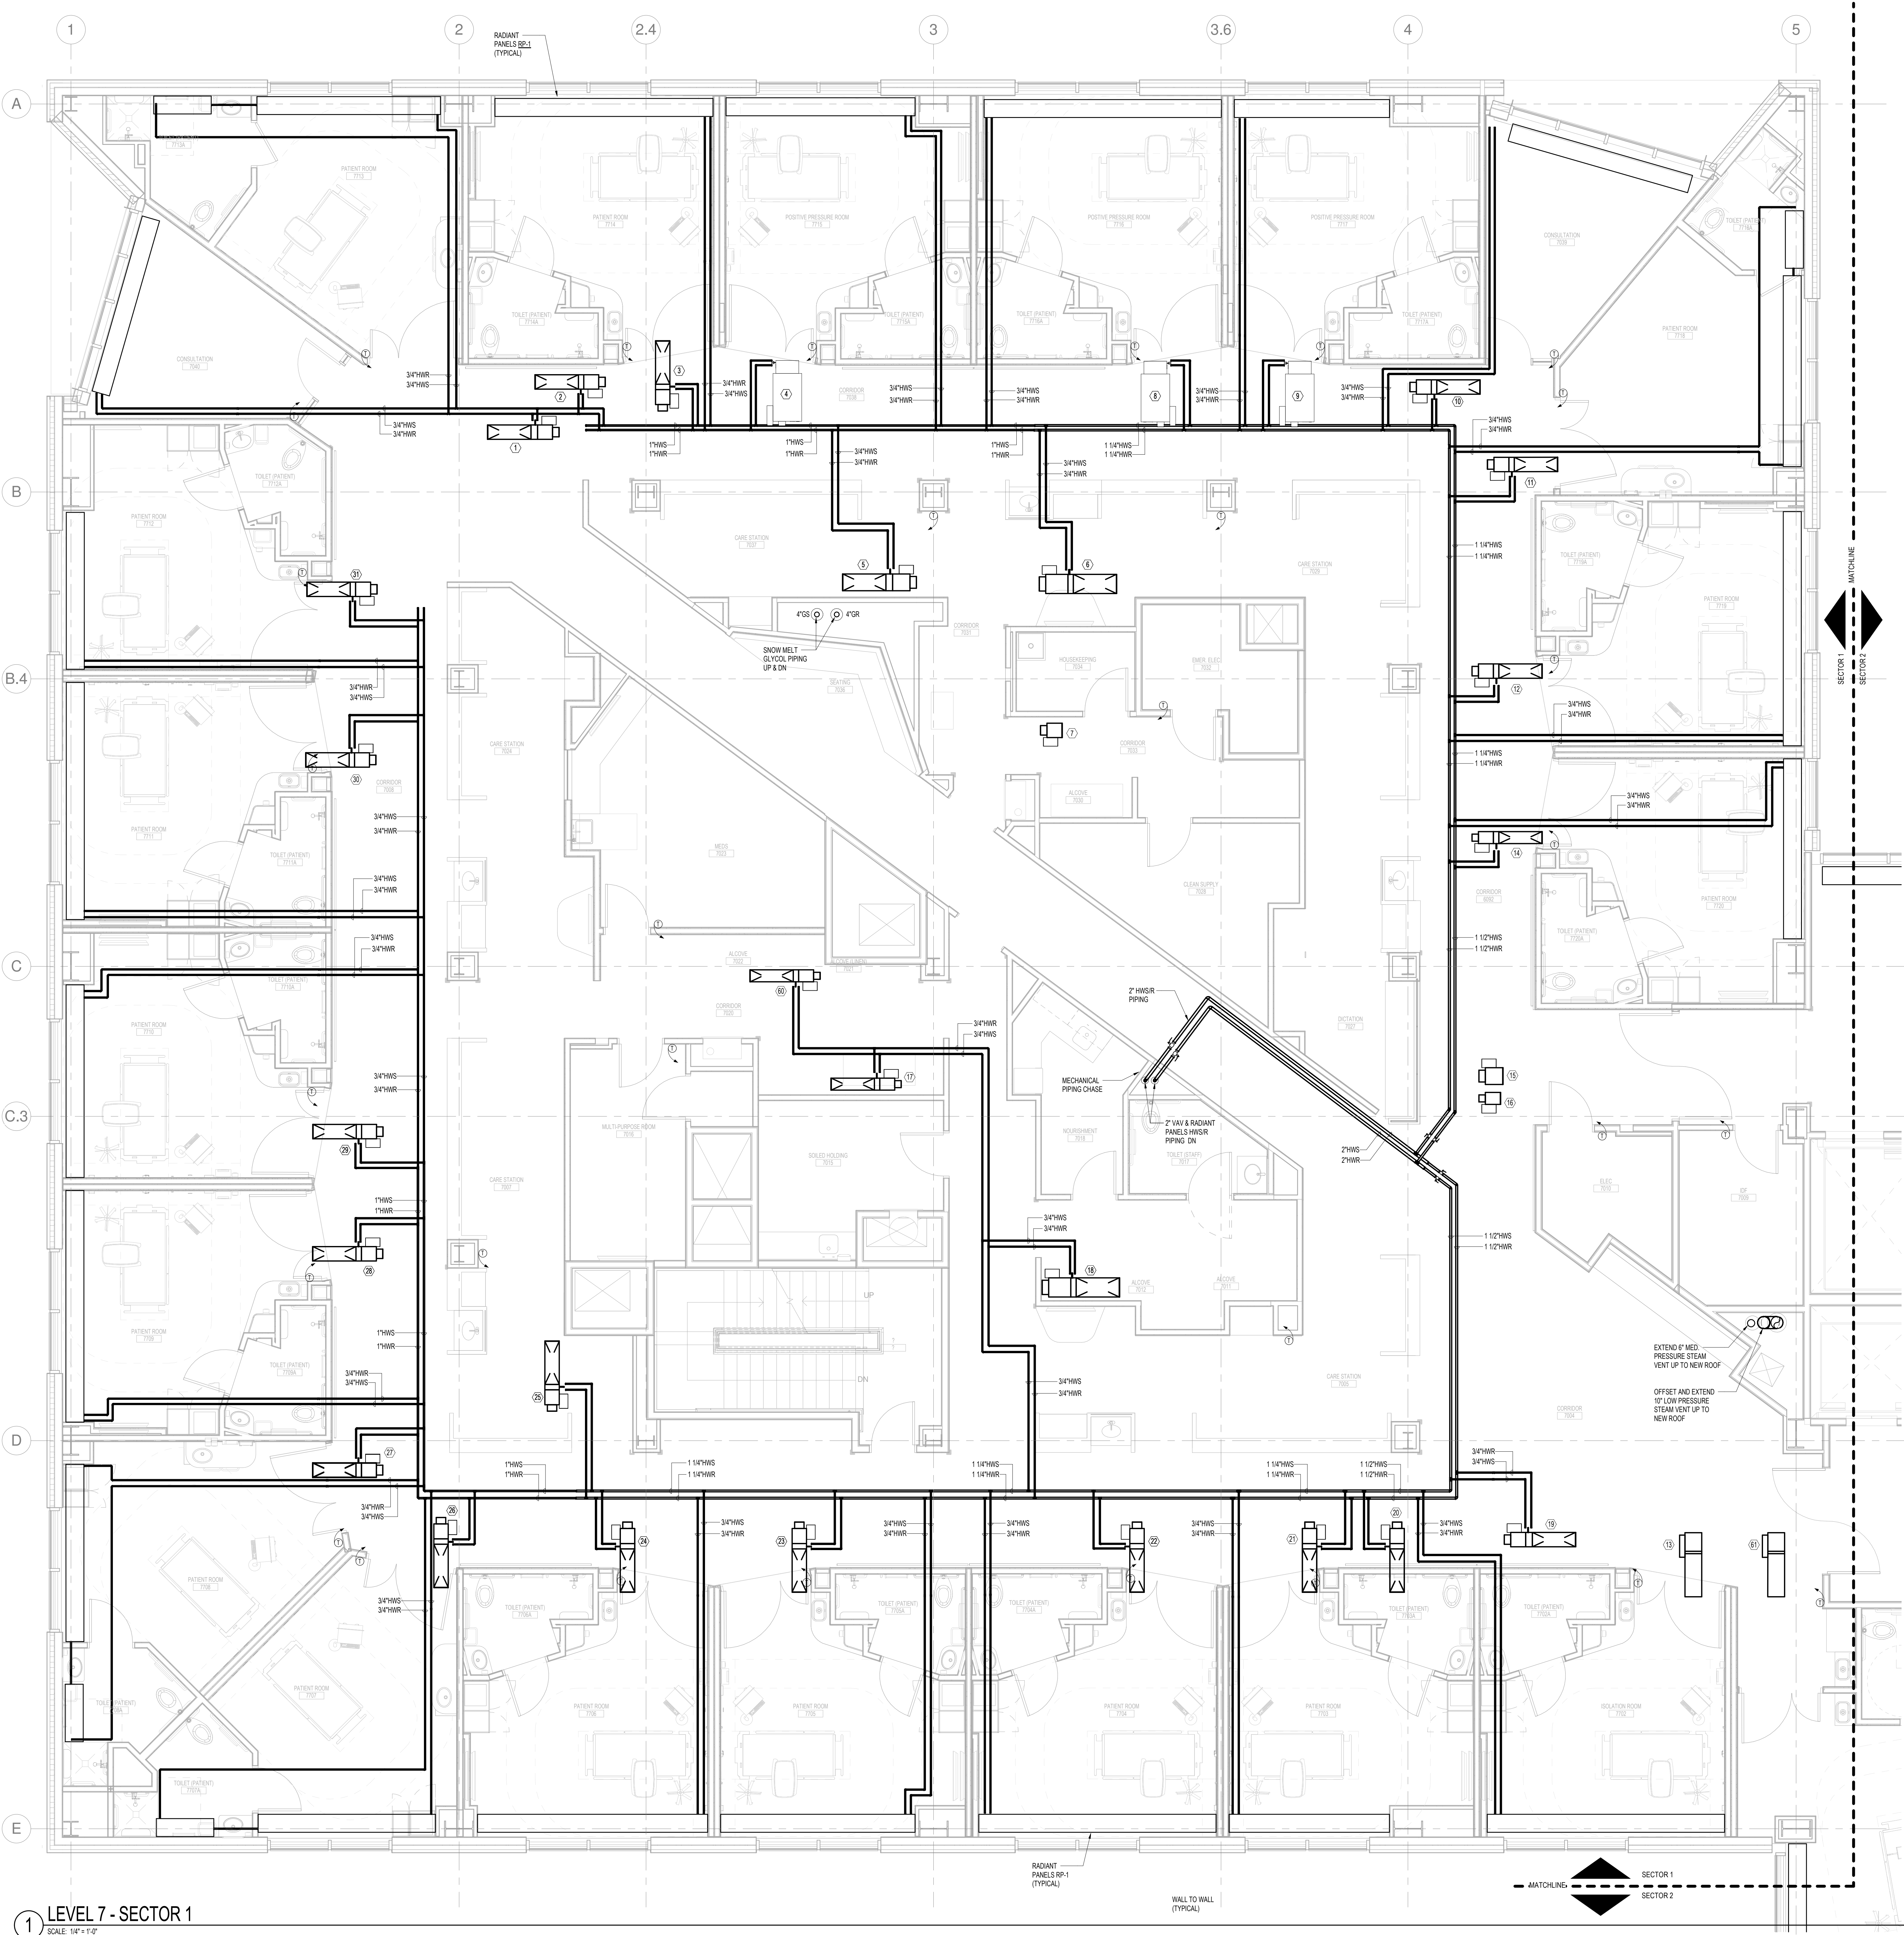

1 LEVEL 7 - SECTOR 1
SCALE: 1/4" = 1'-0"

3/28/2018 11:33:18 AM
C:\Revit Local Files_B150312\000\MDC East Tower 6&7 MEP17_Constr_documents.rvt