


ADDENDUM NO.	DATE	
1	03/22/18	
NO.	ISSUE	DATE
Job Number	B150312-000	
Drawn	MMS	
Checked	MFR	
Approved	MFR	

- DRAWING NOTES - PENTHOUSE PLAN:**
- REFER TO DRAWING E00-01 FOR ELECTRICAL SYMBOLS, NOTES AND ABBREVIATIONS.
  - REFER TO DRAWINGS E00-01 FOR POWER RISER DIAGRAM.
  - REFER TO DRAWINGS E00-11 AND E00-12 FOR ELECTRICAL AND MECHANICAL EQUIPMENT SCHEDULES.
  - ALL 120V AND 208V POWER DEVICES SHALL BE CIRCUITED TO 120/208V PANELBOARDS AS INDICATED ON THE FLOOR PLANS.
  - COORDINATE EXACT LOCATION OF ALL MECHANICAL AND PLUMBING EQUIPMENT WITH MECHANICAL AND PLUMBING DRAWINGS.
  - ALL BRANCH CIRCUITS IN EXCESS OF 10' ARE TO UTILIZE #10AWG CONDUCTORS.
  - PROVIDE A UL-98A MASTER LABEL LIGHTNING PROTECTION SYSTEM. REFER TO SPECIFICATIONS FOR ADDITIONAL REQUIREMENTS.
  - PROVIDE HEAT TRACE FOR ALL GUTTERS ON HELIPAD, RAMP AND DOWN SPOUTS. HEAT TRACE TO BE 377V, 1-PHASE HEAT TRACE CONTROLLER TO THE INTO BUILDING BMS SYSTEM. PROVIDE GFCI TYPE CIRCUIT BREAKER IN EQUIPMENT BRANCH PANEL. REFER TO SPECIFICATIONS FOR ADDITIONAL REQUIREMENTS.
  - NUMERAL ADJACENT TO THE DEVICES DENOTES CIRCUIT NUMBER. MINIMUM BRANCH CIRCUIT WIRING TO BE 3/12" #12 GROUND NOT ALLED. CONCEALED. REFER TO ELECTRICAL SPECIFICATIONS FOR WIRING METHODS.

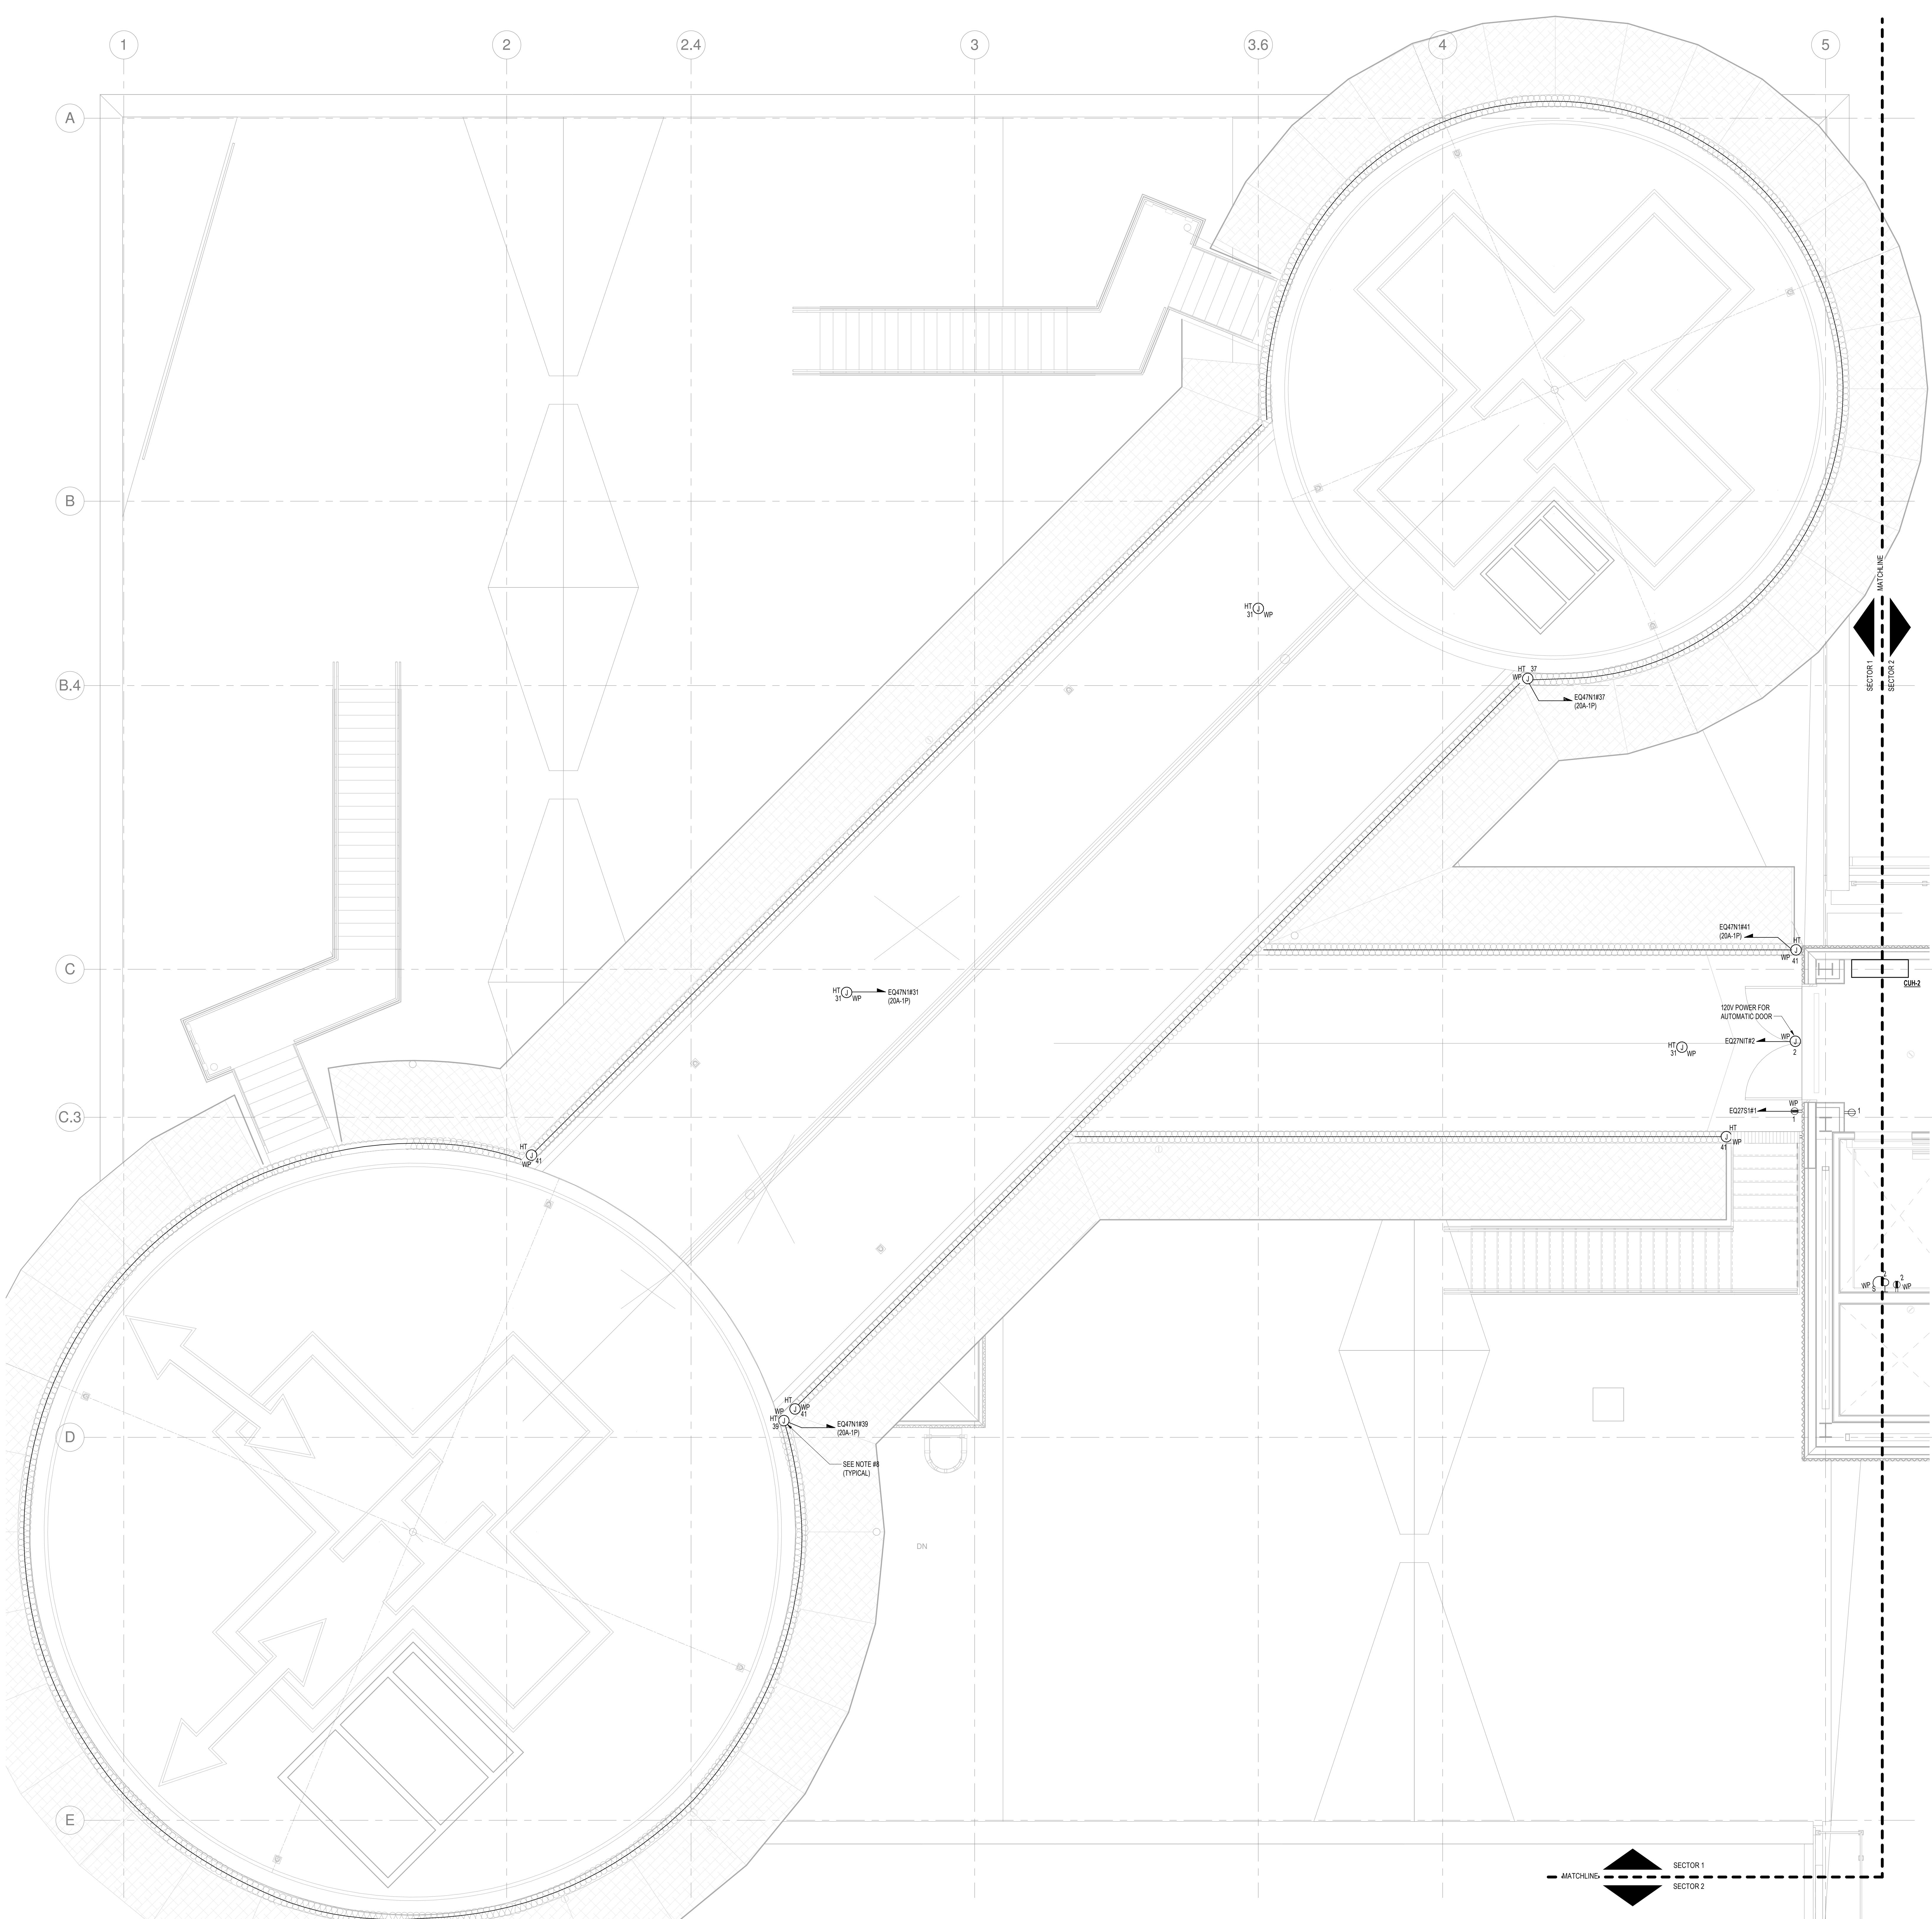

**1 PENTHOUSE - SECTOR 1**  
SCALE: 1/8" = 1'-0"

3/23/2018 11:05:56 AM  
C:\Revit Local Files\_B150312\000\MDC East Tower 6&7 MEP17\_Constral\_construction.rvt