


ADDENDUM NO.	DATE
1	03/22/18
NO	ISSUE
Job Number	B150312-000
Drawn	EL
Checked	BN
Approved	BN

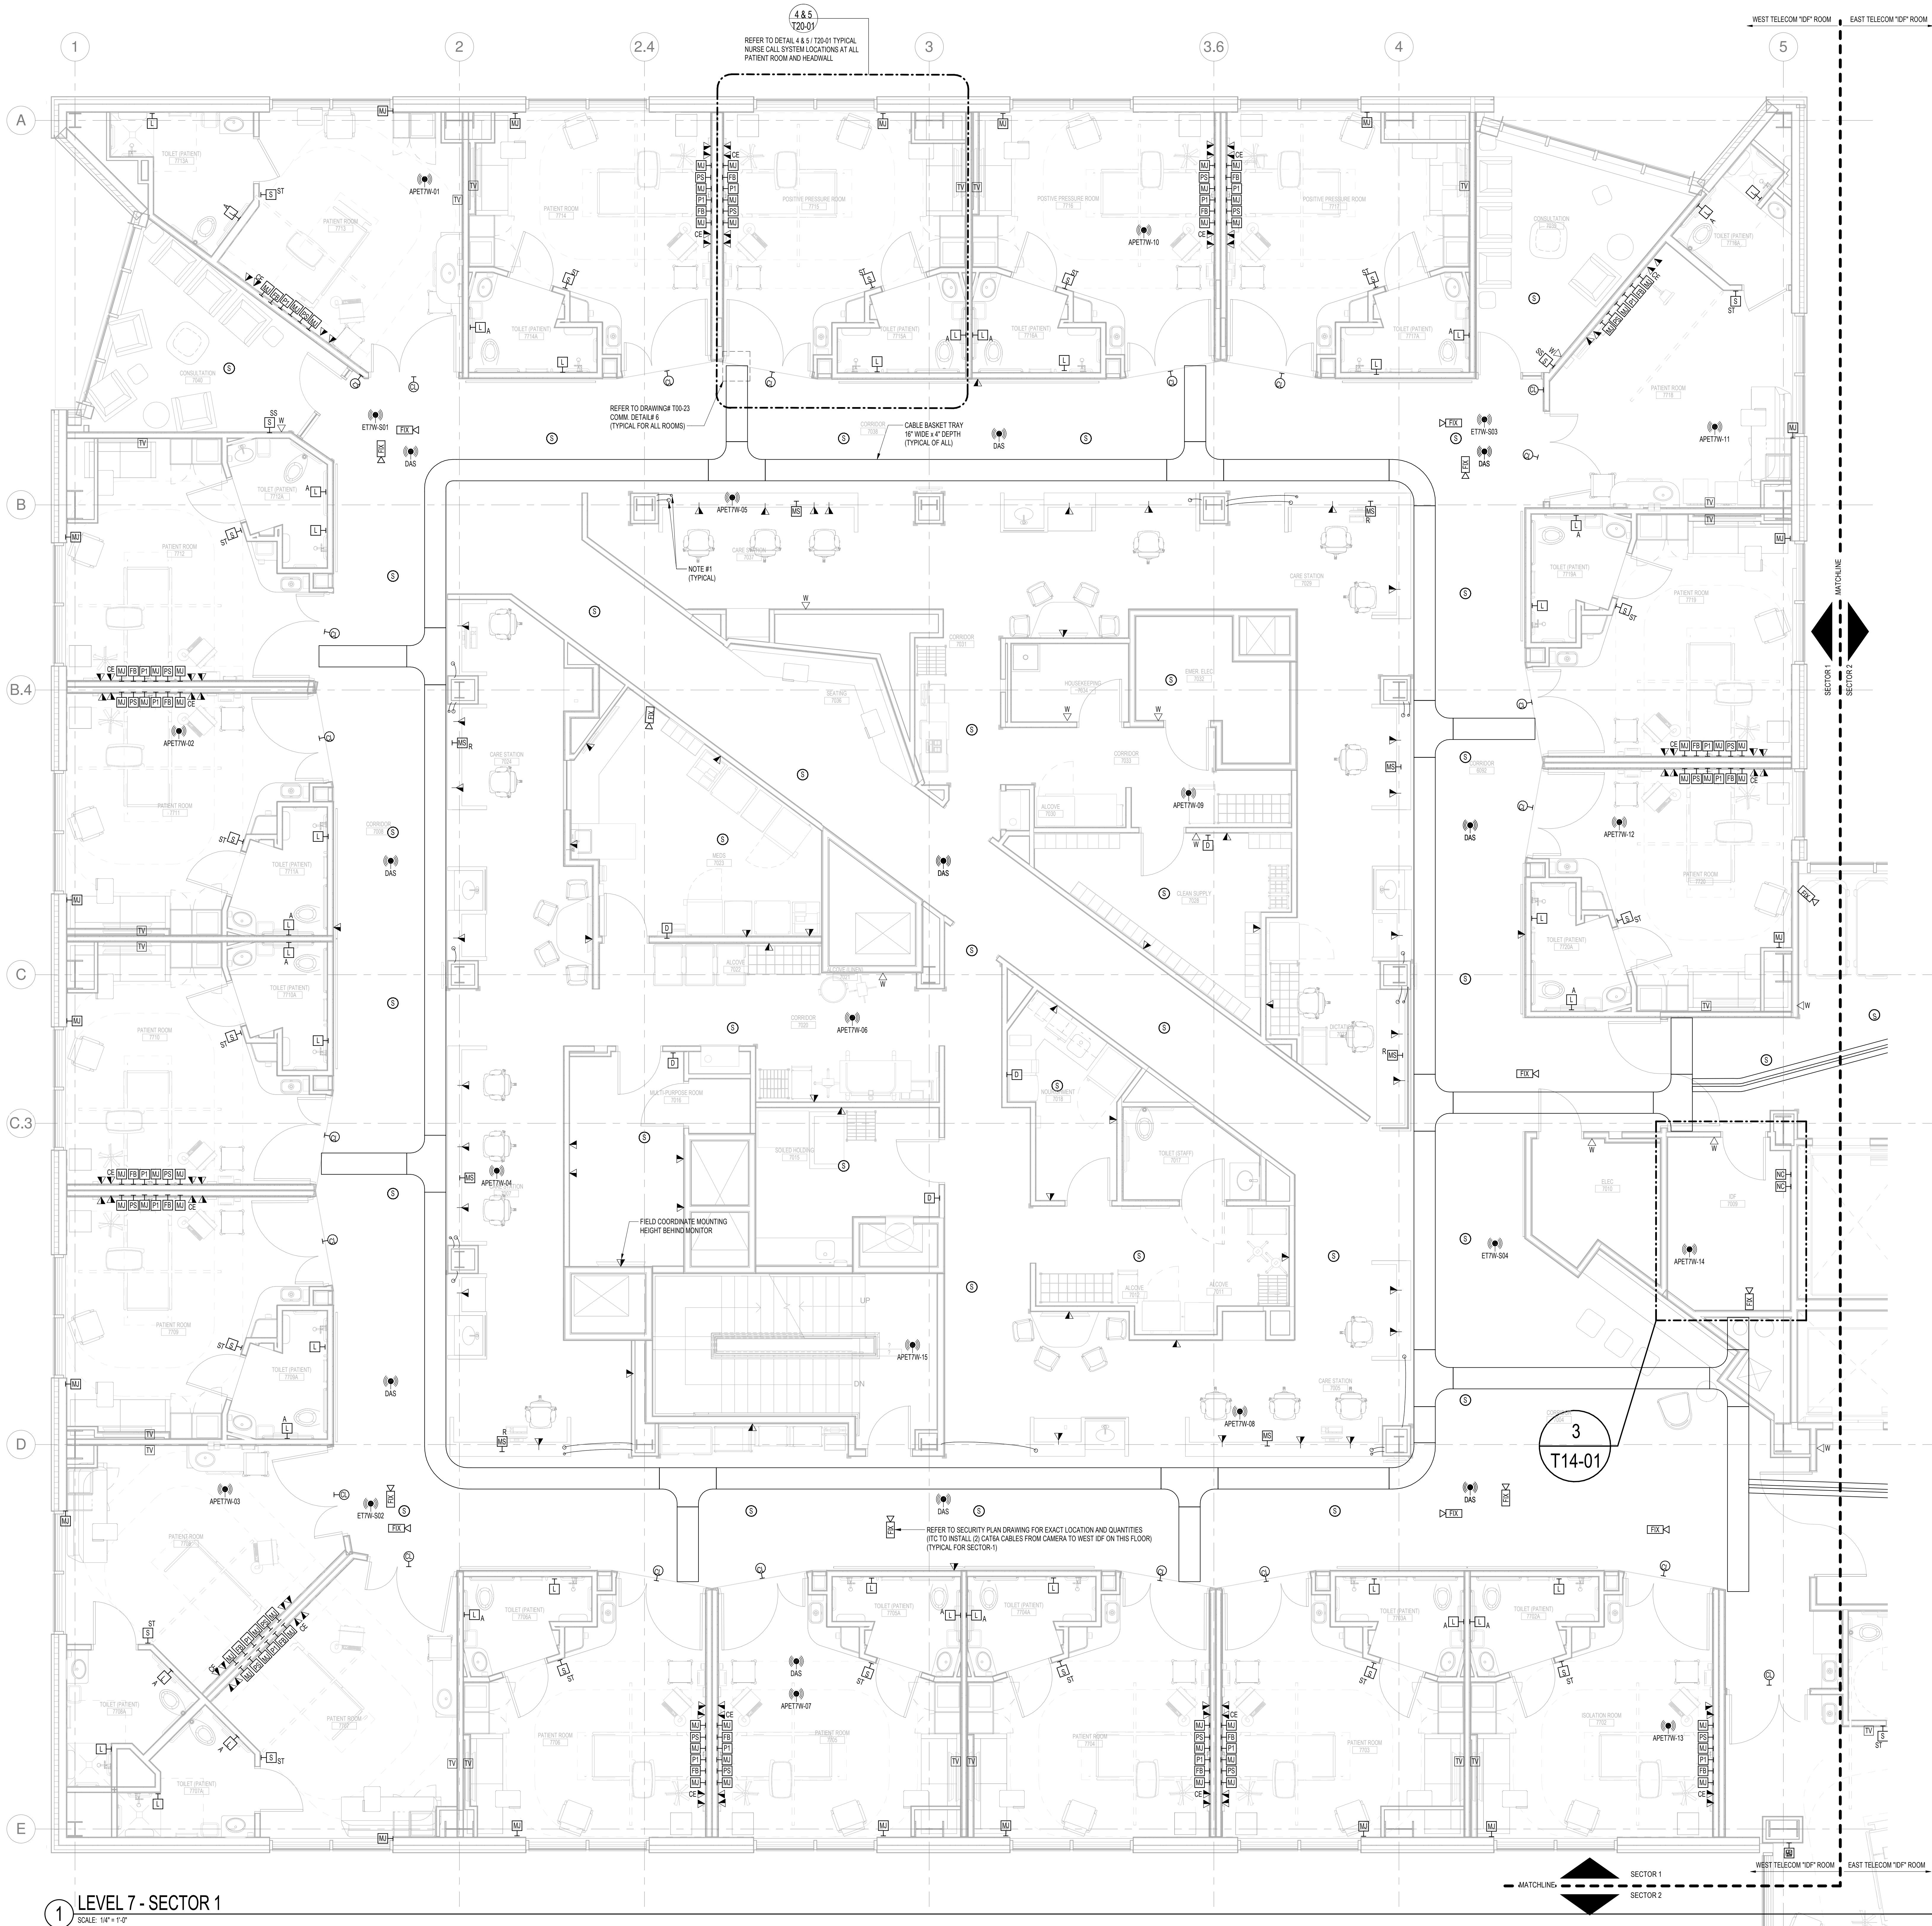

NOTE #1:
 CORE DRILL & SIZES BY GC. (COORDINATION IS REQUIRED)
 ALL LOW VOLTAGE FURNITURE FEED CONDUITS SHALL BE CONTINUOUS FROM THE
 WIREMOLD SURFACE RACEWAY SYSTEM TO ABOVE THE ACCESSIBLE CEILING.
 THE CONDUIT SYSTEM SHALL CONSIST OF THE FOLLOWING:
 (1) 1" CONDUIT FOR VOICE (DATA CABLEING)
 (1) 1" CONDUIT FOR NURSE CALL SYSTEM
 SEE ELECTRICAL DRAWING & SPECS FOR WIREMOLD RACEWAY DETAILS.

1 LEVEL 7 - SECTOR 1
 SCALE: 1/8" = 1'-0"

3/29/2018 11:54:28 AM
 C:\Revit Local Files_LB15012000\MDC East Tower 6&7\MEP17_Convial_comm.dwg