


PERMIT SET	03.28.16	
PERMIT SET	03.08.16	
DESIGN DEVELOPMENT	08.25.17	
NO.	ISSUE	DATE
Job Number	B150311-000	
Drawn	NV	
Checked	BN	
Approved	BN	


DRAWING NOTES:

- REFER TO FLOOR PLANS FOR EXACT QUANTITIES AND LOCATIONS OF DEVICES.
- ALL PENETRATIONS OF FIRE-RATED BARRIERS SHALL BE FIRE STOPPED AFTER CABLE INSTALLATION.
- ALL NEW CAMERAS IN EACH ELEVATOR LOBBY SHALL HAVE AT MINIMUM OF A 3 MEGAPIXEL RESOLUTION AND ENOUGH VIDEO MEMORY FOR 30-DAYS OF STORAGE.

CABLE LEGEND		
SYMBOL	DESCRIPTION	DEVICE
A (COMPOSITE CABLE PLENUM)	A1 6C #22AWG TWISTED, SHIELDED - CARD READER	[A1]
	A2 2C #22AWG TWISTED, SHIELDED - DOOR CONTACT	[A2]
	A3 4C #22AWG UNSHIELDED - REK - MOTION DETECTOR / PUSH BUTTON	[A3]
	A4 4C #18AWG UNSHIELDED - ELEC LOCKSET / ELEC STRIKE / MAGNETIC LOCK	[A4]
B	6C #22AWG TWISTED, SHIELDED - CARD READER	[B]
C	2C #22AWG TWISTED, SHIELDED - DOOR CONTACT / DURESS BUTTON	[C]
D	4C #18AWG TWISTED, SHIELDED - MOTION DETECTOR / GLASS BREAK / LOCAL ALARM / KEYSWITCH / CRASH BAR	[D]
E	4PR #24AWG TWISTED, UNSHIELDED CAT6A BLUE CABLE - CAMERA / CONTROL PANEL / INTERCOM STATION	[E]
F	2PR #24AWG TWISTED, SHIELDED, WIDRAIN RS-485 - CONTROLLER PANEL / HUB COMMUNICATION	[F]

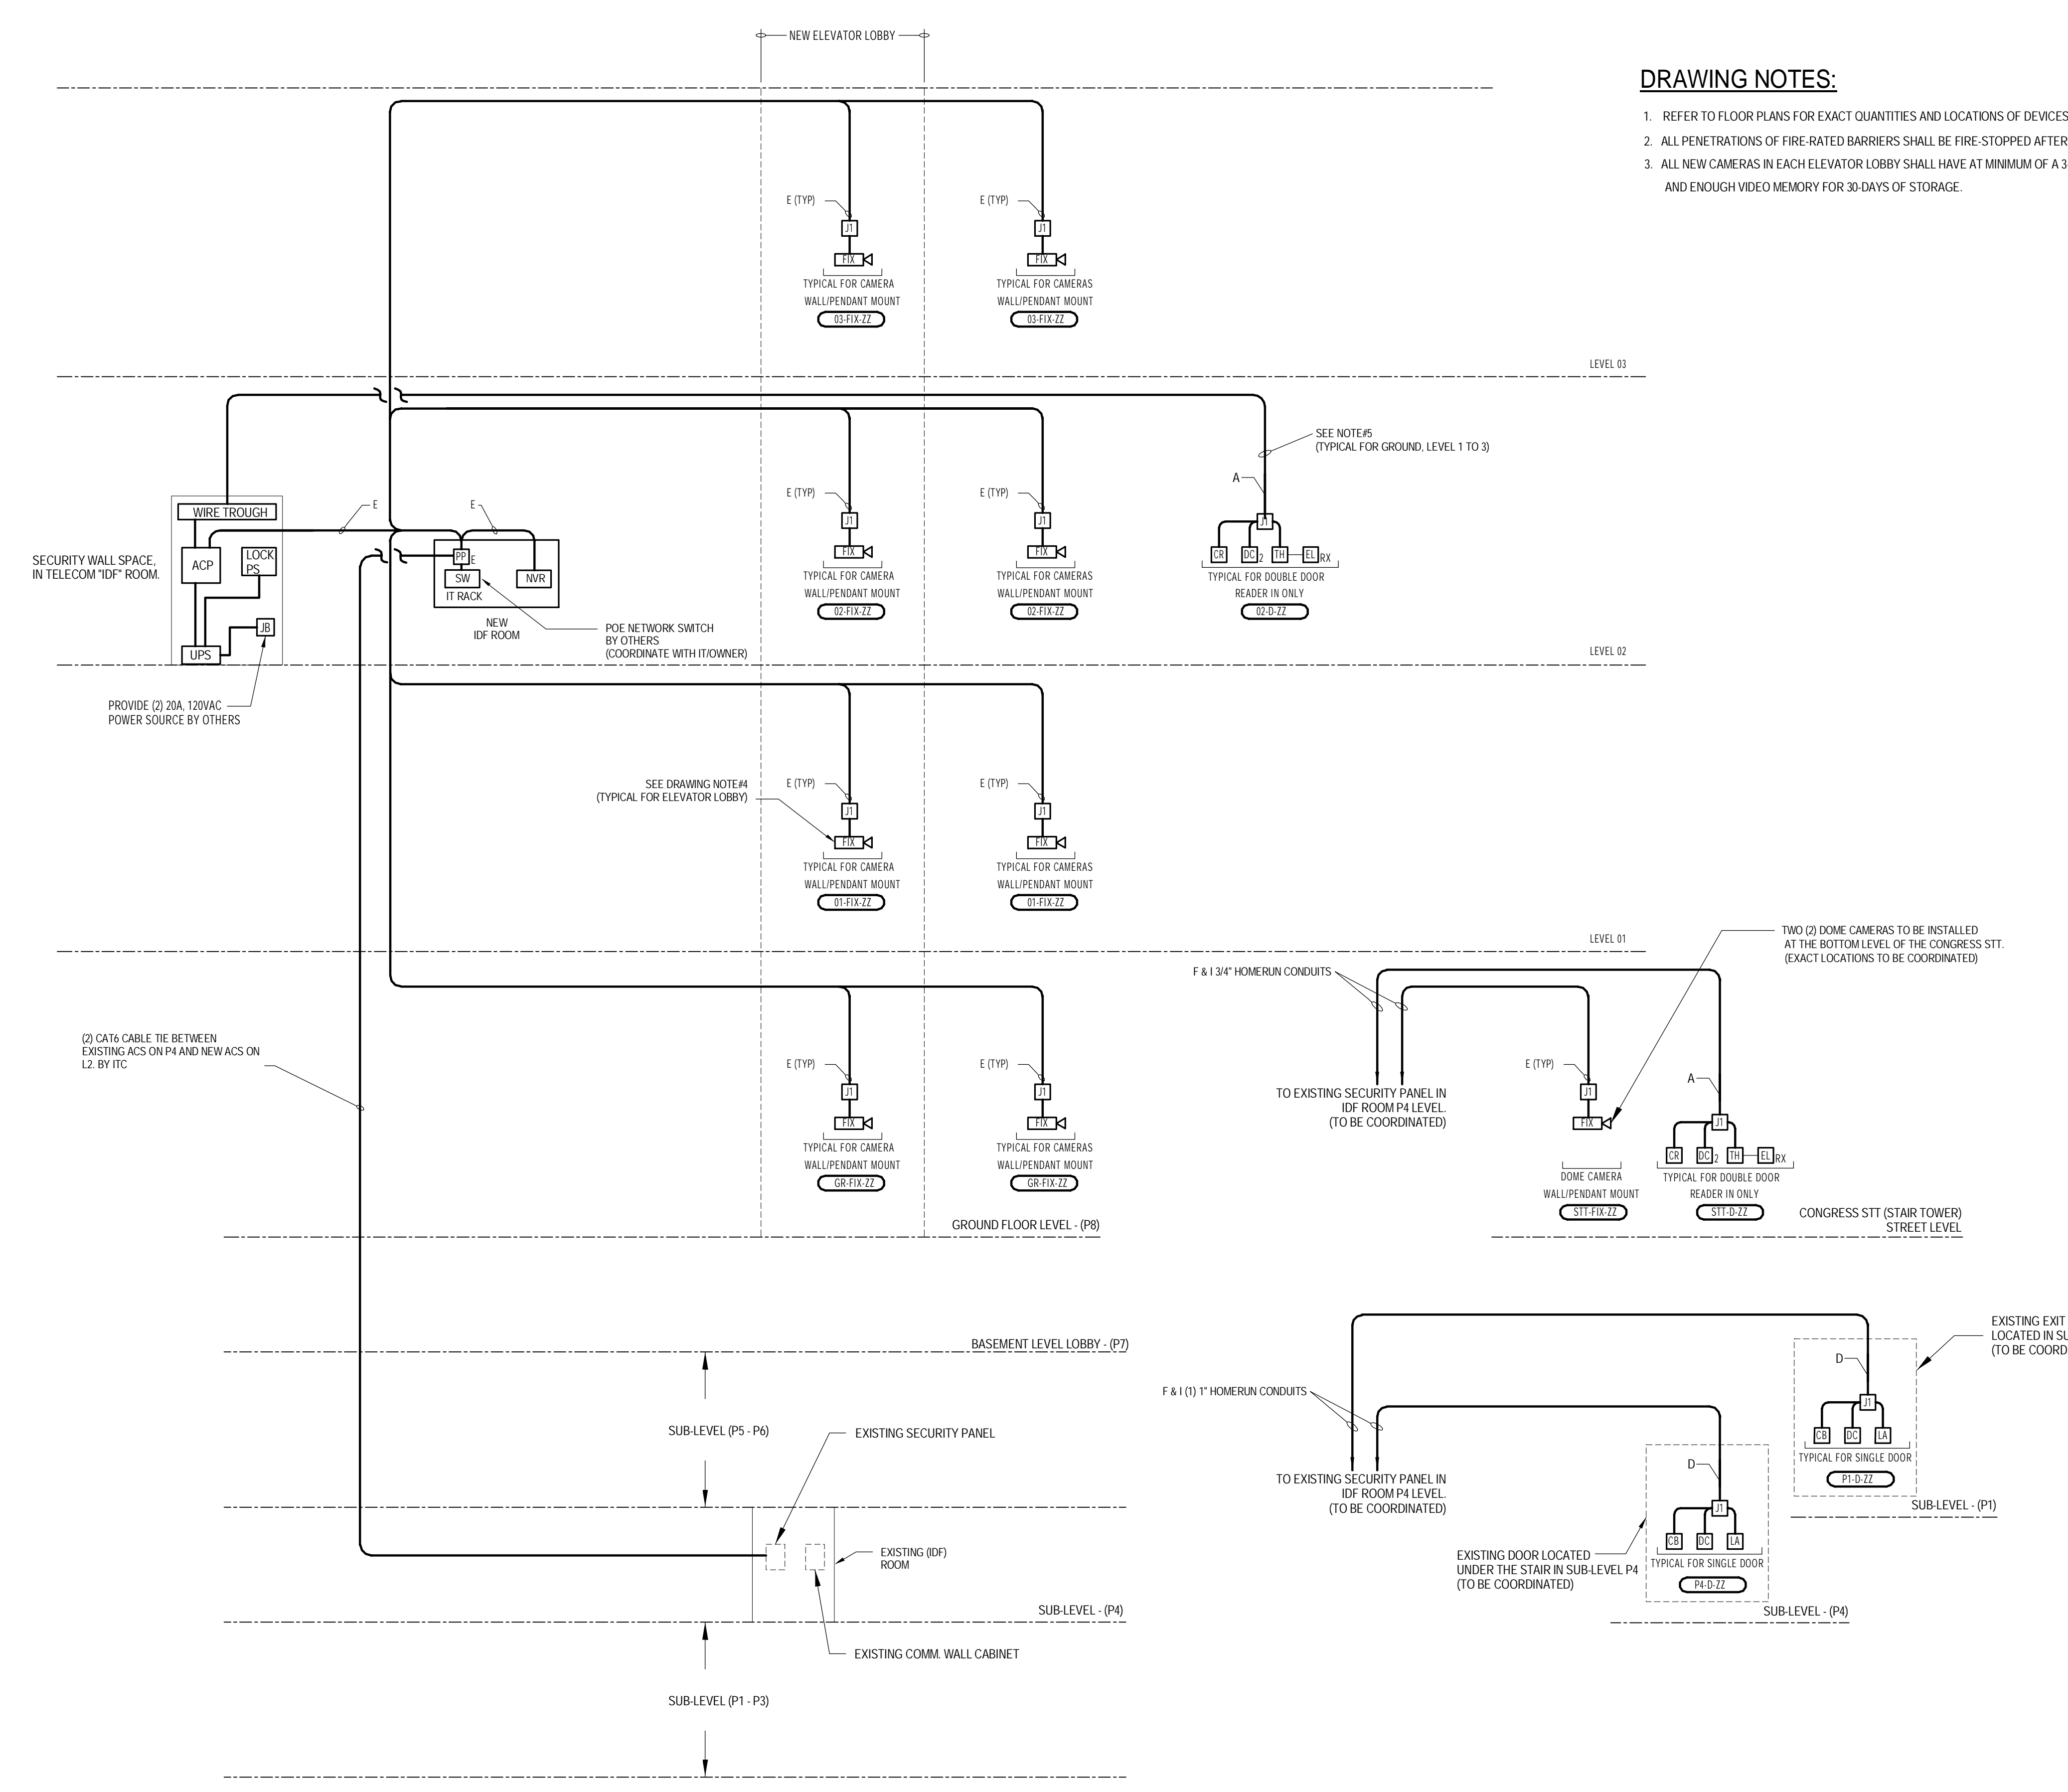

2 SECURITY RISER DIAGRAM
SCALE: NTS

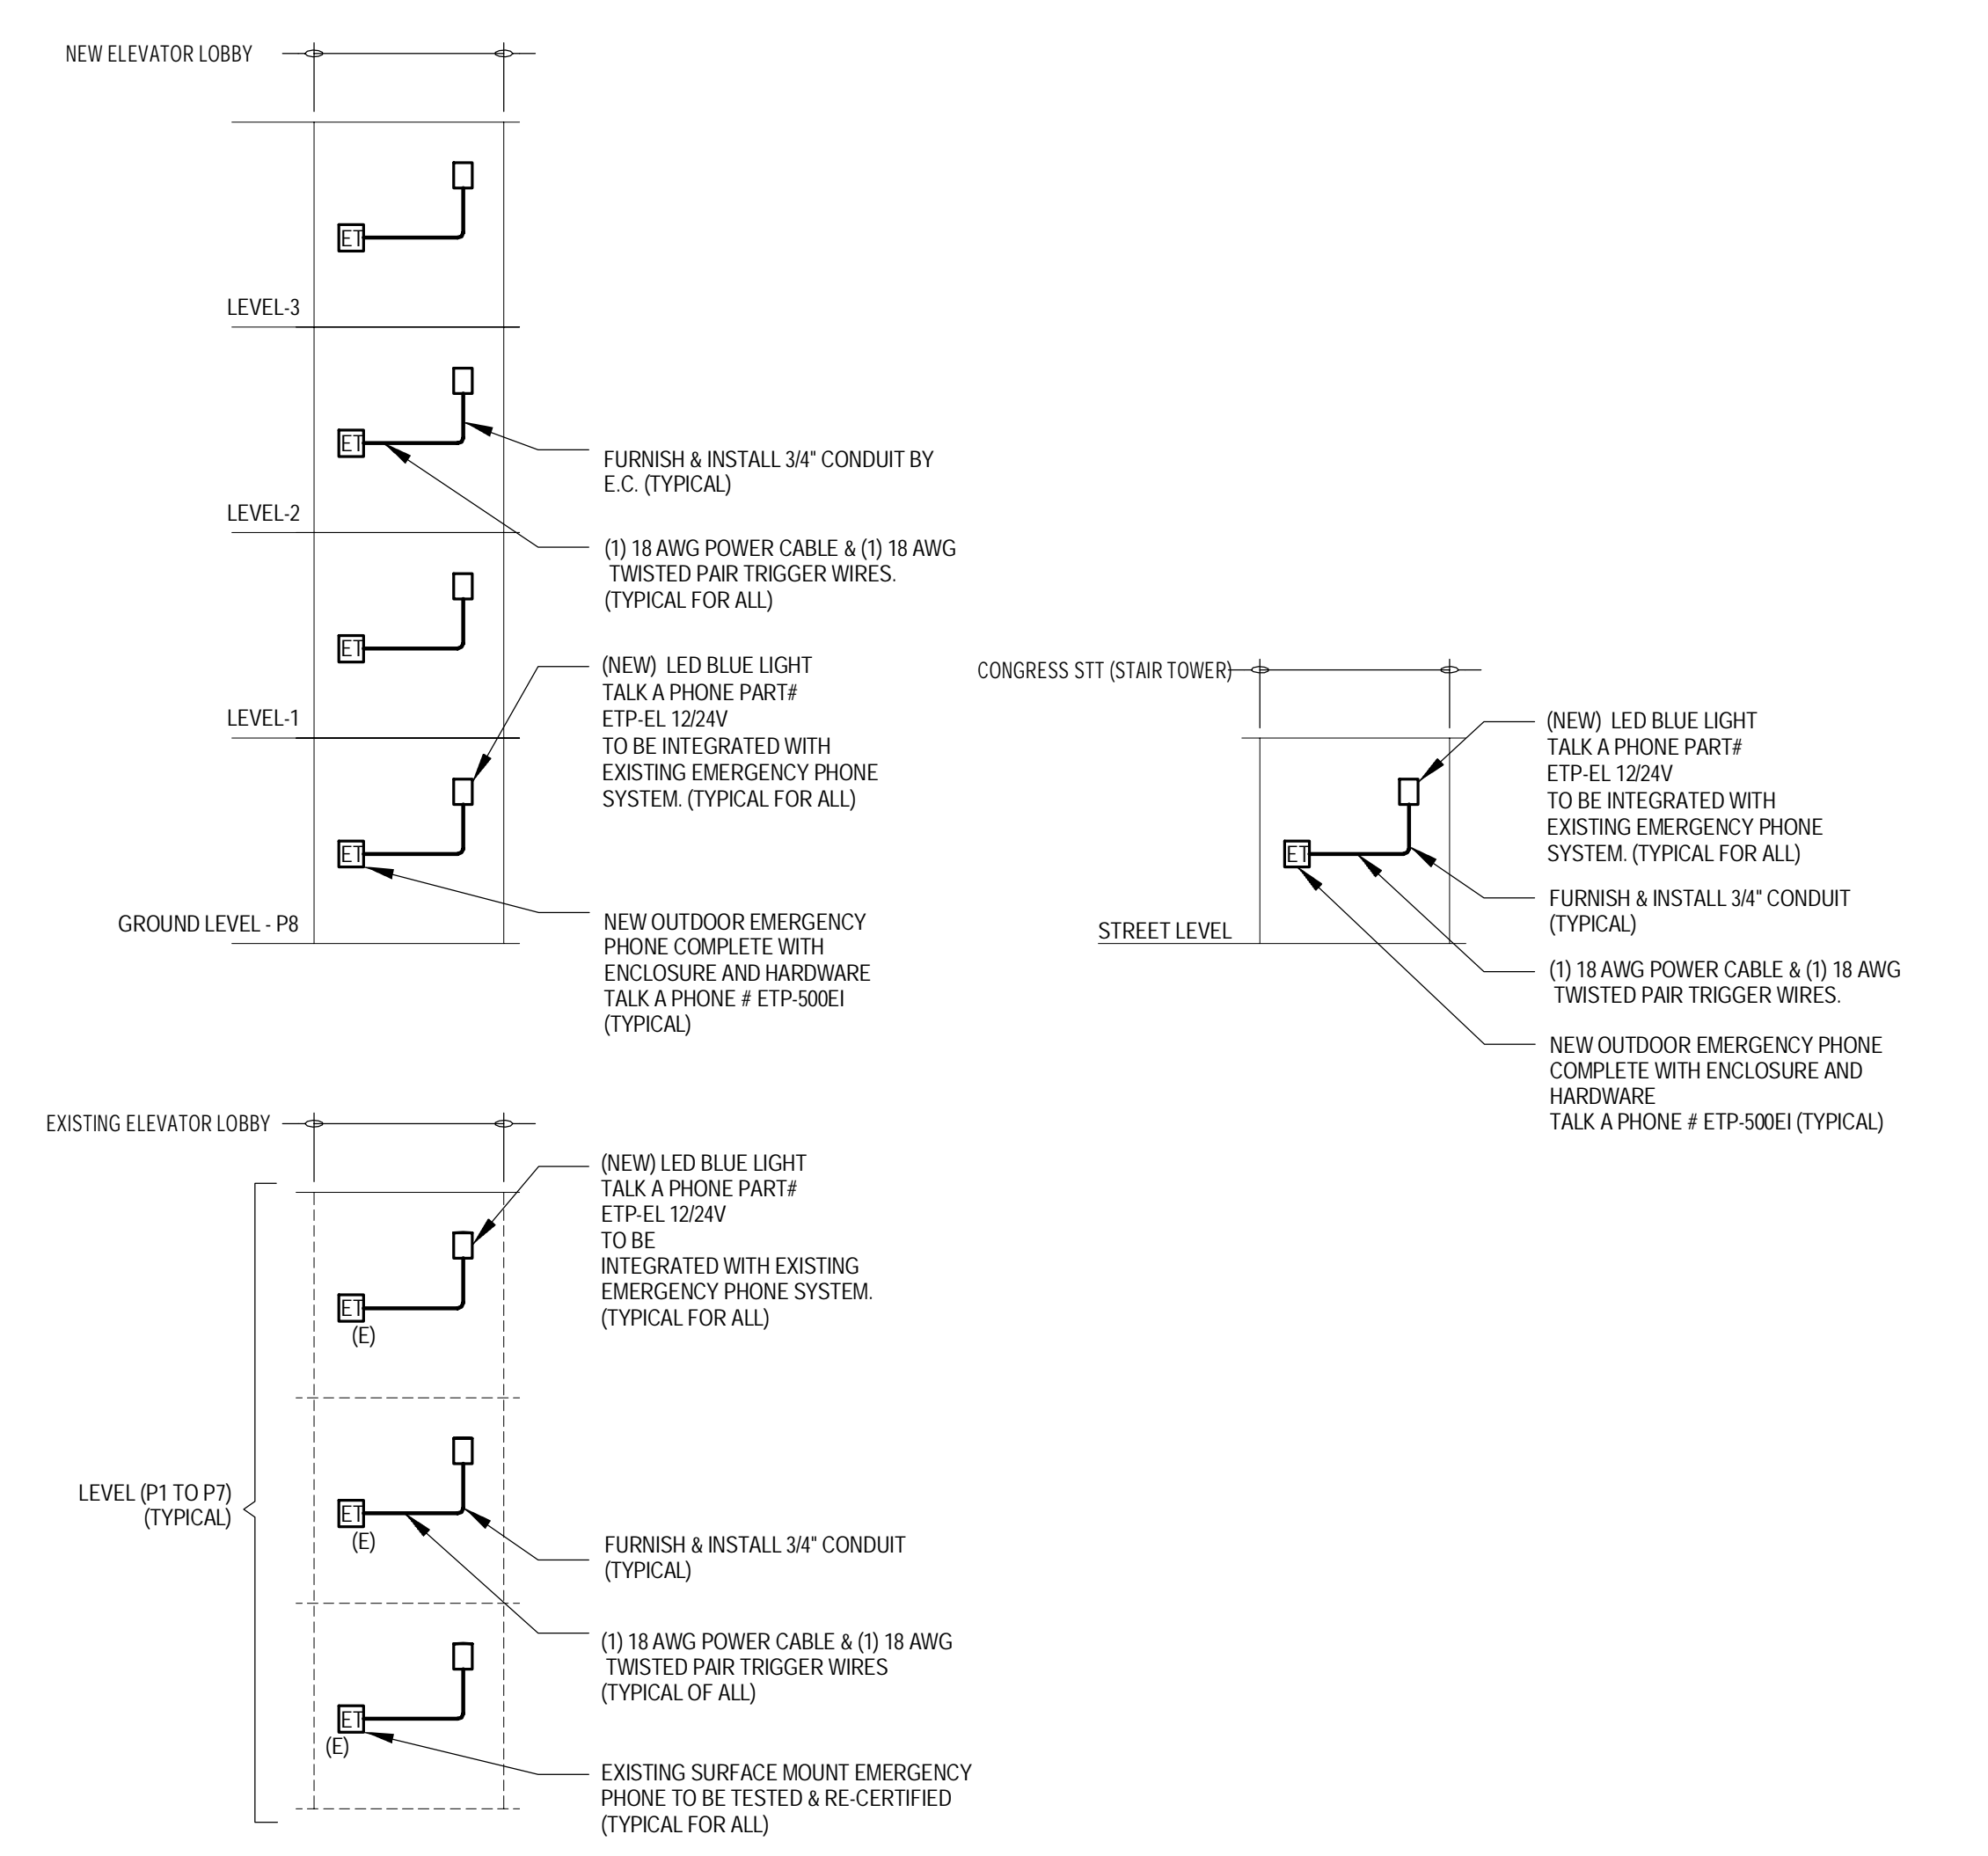

1 EMERGENCY PHONE & BLUE LIGHTS DIAGRAM
SCALE: NONE