


### PIPING SYMBOLS

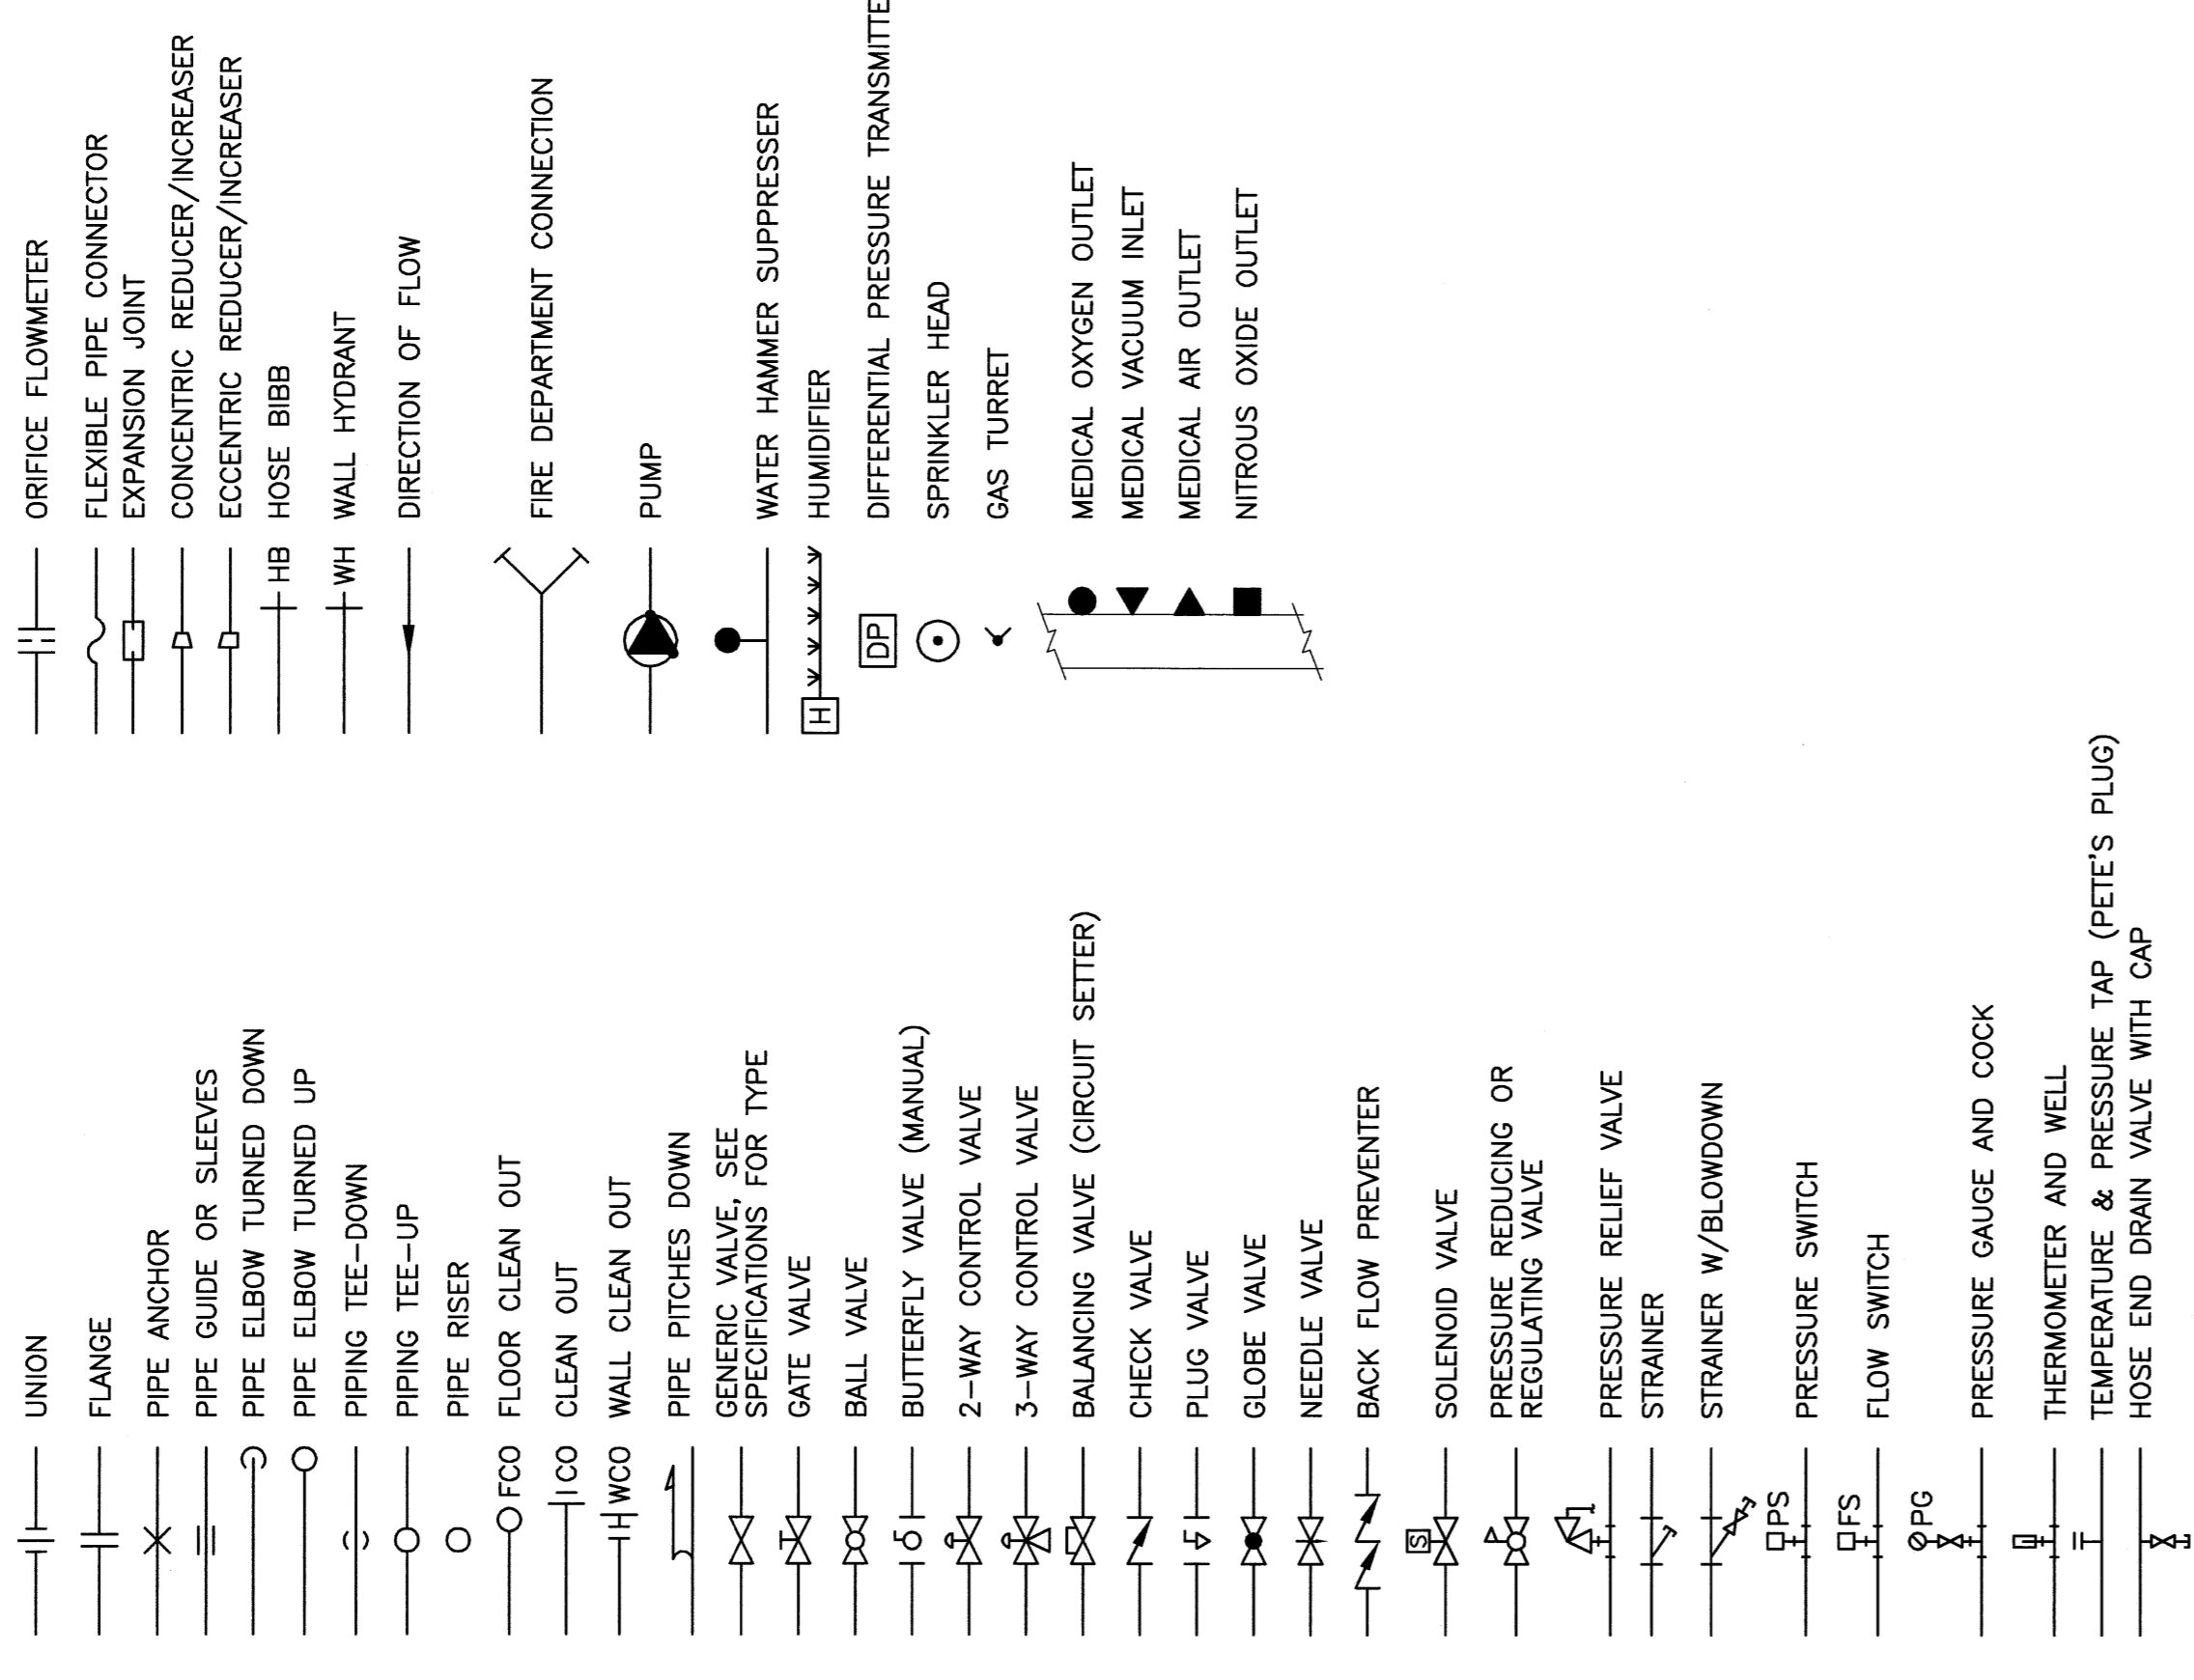

### ABBREVIATIONS

AV	AUTOMATIC AIR VENT	ENC ENCLOSURE	PPE PURCHASED EQUIPMENT
AD	ACCESS DOOR	(E) EXISTING	PRS PRESSURE REDUCING STATION
AFF	ABOVE FINISHED FLOOR	EXST EXISTING	PRV PRESSURE REDUCING VALVE
AHU	AIR HANDLING UNIT	FBO FURNISHED BY OWNER	(R) REMOVE
ATC	AUTOMATIC TEMPERATURE CONTROL	FC FLEXIBLE CONNECTION	(REL) RELOCATED
AV	AIR VENT	FCC FLOOR CLEANOUT	RD ROOF DRAIN
BA	BREATHING COMPRESSED AIR	FD-# FLOOR DRAIN TAG	RHC REHEAT COIL
BFP	BACKFLOW PREVENTER	FG FIBERGLASS	RM ROOM
BUDS	BUILDING	FRHB FREEZE RESISTANT HOSE BIBB	RPZ REDUCED PRESSURE ZONE BFP
BOD	BOTTOM OF DUCT	FS FLOW SWITCH	RV RELIEF VALVE
BOP	BOTTOM OF PIPE	GC GENERAL CONTRACTOR	SCV SELF CONTAINED VALVE
BTU	BRITISH THERMAL UNIT	GPM GALLONS PER MINUTE	SS STAINLESS STEEL
CAF	CAPPED FOR FUTURE	H HUMIDIFIER	TE TEMPERATURED ELEMENT (SENSOR)
CLG	CUBIC FEET PER HOUR	HRU HEAT RECOVERY UNIT	TOS TOP OF PIPE
CO	CLEANOUT	HTR HEATER	TYP TYPICAL
CONT	CONTINUATION	H & V HEATING AND VENTILATION	UC UP IN CHASE
COORD	COORDINATE	HVAC HEATING, VENTILATING AND AIR CONDITIONING	UW UP IN WALL
CT	COOLING TOWER	HW HOT WATER	UV UNIT VENTILATOR
CTE	CONNECT TO EXISTING	HX HEAT EXCHANGER	VB VACUUM BREAKER
CU	COPPER	IN WG INCHES WATER GAUGE	VTR VENT THRU ROOF
CY	CONTROL VALVE	MAU MAKE UP AIR UNIT	VCF VALVED AND CAPPED FOR FUTURE
CW	COLD WATER	MAX MAXIMUM	VFD VARIABLE FREQUENCY DRIVE
CW-P	CITY WATER-PROCESS	MBH 1000 BTU/HR.	VOC VOLATILE ORGANIC COMPOUNDS
DC	DOUBLE CONTAINED	ME MECHANICAL ENGINEER	W/ WITH
DDC	DIRECT DIGITAL CONTROL	MFR MANUFACTURER	WCO WALL CLEANOUT
DIA	DIAMETER	MIN MINIMUM	WH WALL HYDRANT
DIC	DOWN IN CHASE	MPV MULTI-PURPOSE VALVE	
DIW	DOWN IN WALL	MTD MOUNTED	
DN	DOWN	MUA MAKE UP AIR	
DS	DOWNSPOUT	NPW NON-POTABLE WATER	
DT	DROP AND TRANSITION	NIS NOT TO SCALE	
DWG	DRAWING	P-# PLUMBING FIXTURE TAG	
DWH	DOMESTIC WATER HEATER	PP POLY-PROPYLENE	


### PIPING SYSTEMS

AV	ACID VENT	MP	MEDICAL VACUUM
AD	ACID DRAIN	NZNP	NON-PROCESS NITROGEN
AD	ACID DRAIN (BELOW SLAB)	NZ	NITROGEN
BA	BREATHING AIR	NG	NATURAL GAS
CD	CONDENSATE DRAIN	HNG	HIGH PRESSURE NATURAL GAS
CD	COMPRESSED DRY AIR	N02	NITROUS OXIDE
OB	DISTRIBUTION VALVE BOX	NEG. SOLV.	NEGATIVE SOLVENT DRAIN
DIS	DEIONIZED WATER SUPPLY	NPW	NON POTABLE COLD WATER
DIR	DEIONIZED WATER RETURN	O2	OXYGEN
EXCD	EXC DRAIN	OFA	OIL FREE COMPRESSED AIR
ESW	ETWASH	PD	PUMPED DISCHARGE
GLY	GLYCOL	POS. SOLV.	POSITIVE SOLVENT DRAIN
GV	GAS VENT	PM	POTABLE WATER
H	HYDROGEN	R	RELIEF LINE
H2O2	HYDROGEN PEROXIDE	SLD	MIXED SOLVENT DRAIN
HCV	HOUSE CLEAN VACUUM	SV	SOLVENT
AD	ISOPROPYL ALCOHOL DRAIN	SP	SPRINKLER
LP	LIQUID PROPANE GAS	VAC	VACUUM
HLP	HIGH PRESSURE LIQUID PROPANE GAS	ZB	ZONE VALVE BOX
MA	MEDICAL AIR		

### GENERAL NOTE

1. ALL GENERAL NOTES, SYMBOL LISTS AND DETAILS ARE TO BE CONSIDERED AS APPLICABLE TO ALL PLUMBING DRAWINGS FOR THIS PROJECT. SYMBOLS AND ABBREVIATIONS SHOWN ON THIS SHEET ARE FOR REFERENCE ONLY AND DO NOT INDICATE THEIR INCORPORATION INTO THE DESIGN.

ISSUED FOR CONSTRUCTION  
9-12-08

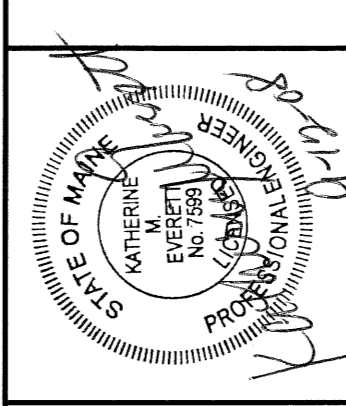

SMRI  
MAINE MEDICAL CENTER - RICHARDS WING 2ND FLOOR  
INPATIENT SERVICES  
LEGEND AND ABBREVIATIONS

SCALE	NOT TO SCALE	DATE	9-12-08
PROJECT MANAGER	CP	GRAPHIC SCALE	0'
JOB CAP/DRWN:	MR/DRIL		
DATE OF RECORD:	KNE	SHEET NO.	P-001
SHEET CAD FILE:	P-001-08-103		
PROJECT NO.	08103		

### A1 PARTIAL FLOOR PLAN

1/4" = 1'-0"