

NOTE:

1. SEE SHEET E-001 FOR LEGEND AND GENERAL NOTES.


KEYED NOTE:

- 1 REINSTALL FIRE ALARM SYSTEM DEVICE REMOVED DURING DEMOLITION AND REPROGRAMMING AS REQUIRED FOR A COMPLETE AND OPERABLE SYSTEM.
- 2 FURNISH AND INSTALL 4" SQUARE JUNCTION BOX WITH 1/2" CONDUIT STUB UP TO ABOVE ACCESSIBLE CEILING. PROVIDE PULLSTRINGS AND RUBBER GASKETS BETWEEN CONDUITS AND BACKBOXES. COORDINATE WITH OWNER'S SYSTEMS CONTRACTORS PRIOR TO INSTALLATION.
- 3 FURNISH AND INSTALL 4" SQUARE JUNCTION BOX WITH ONE CONDUIT RIGIDLY ROUTED TO ABOVE CEILING IN CORRIDOR. PROVIDE PULLSTRINGS AND RUBBER GASKETS BETWEEN CONDUITS AND BACKBOXES. COORDINATE WITH NURSE CALL SYSTEM INSTALLER PRIOR TO WORK.
- 4 REINSTALL WALL CLOCK AND ELAPSE TIME WALL CLOCK AND DEMOLITION AND EXTEND EXISTING WIRING AS REQUIRED.
- 5 SECURITY CAMERA LOCATION. PROVIDE 4" SQUARE JUNCTION BOX W/ 3" CONDUIT STUBBED TO ABOVE CORRIDOR ACCESSIBLE CEILING. EXACT LOCATION AND MOUNTING HEIGHT W/ OWNER'S SECURITY CONTRACTOR.
- 6 FURNISH AND INSTALL NEW FIRE ALARM SYSTEM SMOKE DETECTOR TO MATCH EXISTING HONEYWELL SYSTEM. DETECTOR TO BE MOUNTED TO CEILING AS REQUIRED FOR A COMPLETE AND OPERABLE SYSTEM.
- 7 PROVIDE DUCT SMOKE DETECTORS FOR SMOKE DAMPER LOCATION. REUSE EXISTING UNIT REMOVED DURING DEMOLITION AND/OR PROVIDE NEW UNITS TO PICK UP THE EXISTING WIRING. REPROGRAMMING AND REPROGRAMMING OF EXISTING SYSTEM AS REQUIRED.
- 8 CEILING MOUNT NURSE CALL DOME BY OWNER'S NURSE CALL SYSTEM INSTALLER.
- 9 PUBLIC ADDRESS SPEAKER TO BE INSTALLED BY OWNER UNDER SEPARATE CONTRACT.
- 10 FEED FOR TEL/DATA DEVICES INSTALLED IN MILLWORK. FURNISH AND INSTALL 4" SQUARE JUNCTION BOX IN NEAREST WALL OR COLUMN WITH 1" CONDUIT STUB UP TO ABOVE ACCESSIBLE CEILING. PROVIDE PULLSTRINGS AND RUBBER GASKETS BETWEEN CONDUITS AND BACKBOXES. COORDINATE WITH OWNER'S TEL/DATA AND SYSTEMS CONTRACTORS PRIOR TO INSTALLATION.
- 11 FEED FOR TEL/DATA DEVICES INSTALLED IN MILLWORK. FURNISH AND INSTALL 4" SQUARE JUNCTION BOX WITH 1" CONDUIT ROUTED BELOW FLOOR COVER TO NEAREST WALL OR COLUMN WITH 1" CONDUIT STUB UP TO ABOVE ACCESSIBLE CEILING. PROVIDE PULLSTRINGS AND RUBBER GASKETS BETWEEN CONDUITS AND BACKBOXES. COORDINATE WITH OWNER'S TEL/DATA AND SYSTEMS CONTRACTORS PRIOR TO INSTALLATION.
- 12 COORDINATE MOUNTING HEIGHT WITH ARCHITECT AND OWNER

REV.	ISSUED FOR CONSTRUCTION	DATE
0		9-12-08
1		

ISSUED FOR CONSTRUCTION
9-12-08

CURRENT ISSUE STATUS:

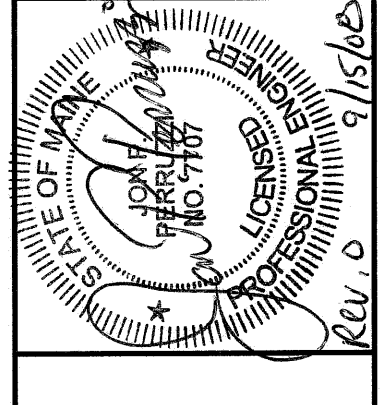

144 Fore Street, 2nd Fl., Box 618
Portland, Maine 04104
Tel: (207) 772-3846
Fax: (207) 772-1070
www.smrt.com

SMRT
ARCHITECTURE
ENGINEERING
PLANNING
INTERIOR DESIGN
COMMISSIONING

MAINE MEDICAL CENTER - L.L. BEAN WING 2ND FLOOR
SURGICAL SERVICES
PORTLAND, MAINE

SYSTEMS
PARTIAL FLOOR PLAN SHEET 2

SHEET TITLE:	DATE:	9-12-08
PROJECT MANAGER:	CDP:	GRAPHIC SCALE
DR. CAPORASIA:	HW/CDS:	1" = 10'
DATE OF RECORD:	IPP:	SHEET No.
SMRT CAD FILE:	EY102-28098	EY102
PROJECT No.:	08098	

A1 PARTIAL FLOOR PLAN

1/4" = 1'-0"

08098-28098-2