NOTE:

1. SEE P-001 FOR LEGEND, ABBREVIATIONS AND GENERAL NOTES.

KEYED NOTES:

1. REMOVE EXISTING LAVATORY AND ASSOCIATED CW & HW PIPING.
2. REMOVE EXISTING WATER CLOSET AND ASSOCIATED CW PIPING.
3. REMOVE EXISTING SINK. TO BE RE-INSTALLED IN SAME LOCATION.

FIRE PROTECTION NOTES:

1. REWORK EXISTING SPRINKLER LAYOUT PER NFPA 13 REQUIREMENTS TO MATCH NEW CEILING GRID (RE: ARCHITECTURAL).
2. MODIFY AND REWORK EXISTING SPRINKLER SYSTEM TO AVOID CONFLICTS WITH HVAC, CEILING HEIGHT CHANGES AND OTHER NEW INSTALLATIONS.
3. CONTRACTOR SHALL VERIFY THE EXISTING CONDITIONS AND IDENTIFY POTENTIAL CONFLICTS WITH NEW INSTALLATION PRIOR TO FINALIZING PROJECT BID. CHANGE ORDERS BASED ON CONFLICTS BETWEEN EXISTING PIPING AND NEW INSTALLATIONS WILL NOT BE ALLOWED.

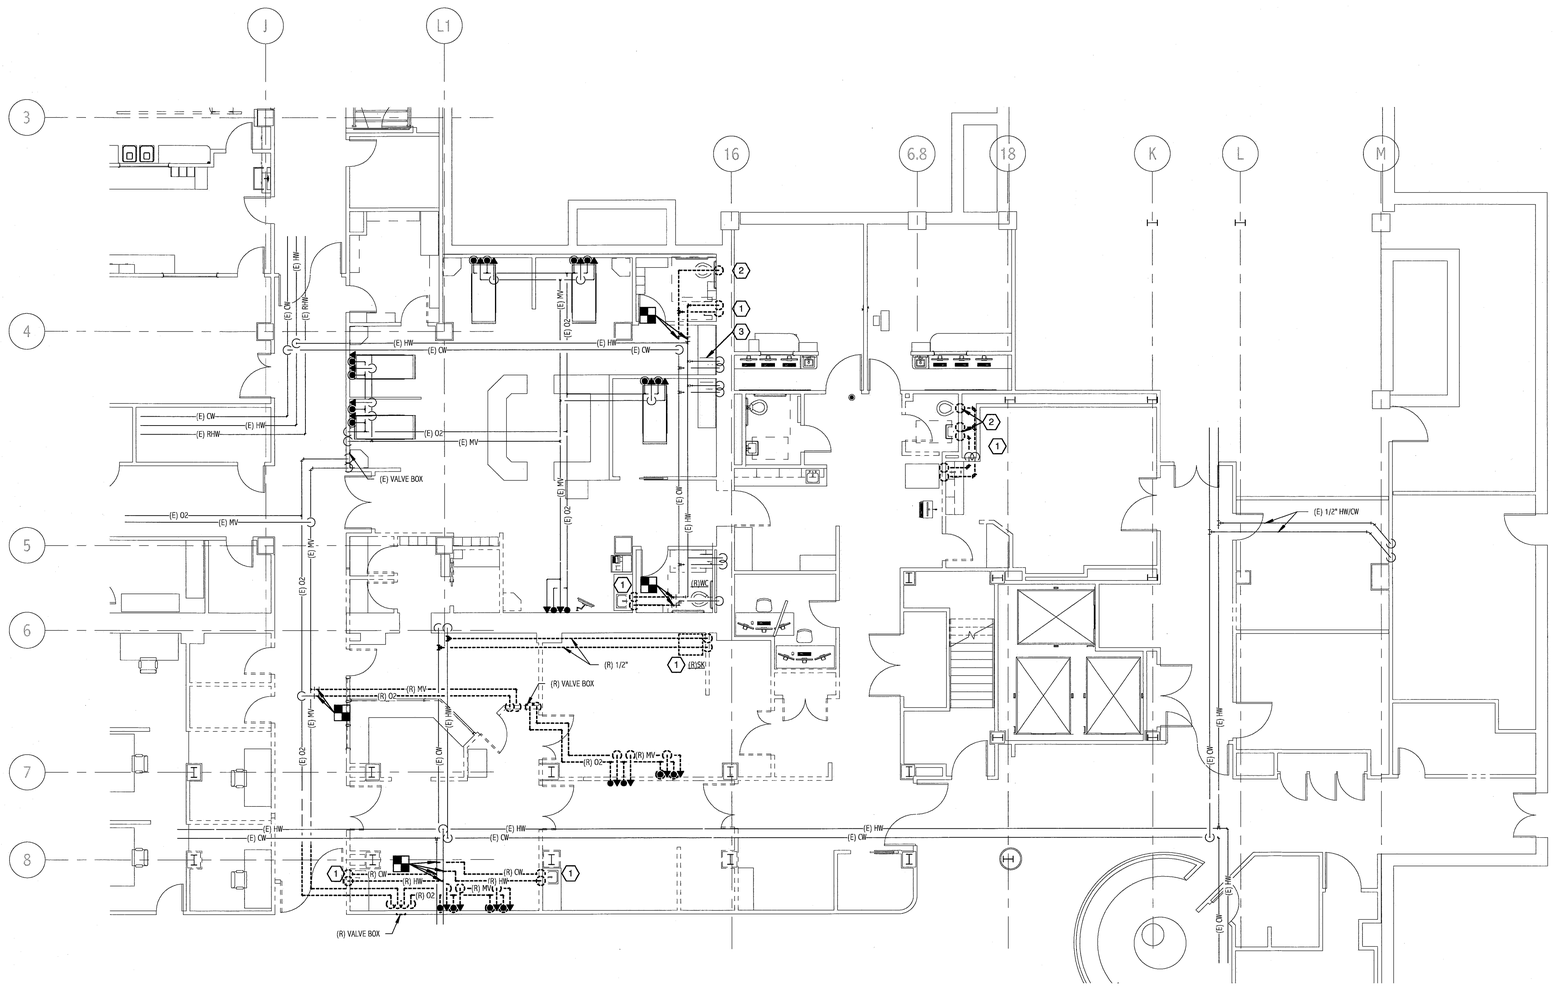

BASEMENT LEVEL SUPPLY PIPING DEMOLITION PLAN
1/8" = 1'-0"

144 Fore Street/P.O. Box 618
Portland, Maine 04104
tel. (207) 772-3846
fax. (207) 772-1070
www.smrtinc.com

ARCHITECTURE
ENGINEERING
PLANNING
INTERIOR DESIGN
COMMISSIONING

SMRT

STATE OF MAINE
TODD A. CHASE
No. 9241
PROFESSIONAL ENGINEER
2/24/12

MAINE MEDICAL CENTER
HOLDING, RADCU & PBC RENOVATION
PORTLAND, ME

ISSUED FOR CONSTRUCTION
02.24.12
CURRENT ISSUE STATUS:

REV	DESCRIPTION	DATE
0	ISSUED FOR CONSTRUCTION	2.24.12

GRAPHIC SCALE: 0" 1"

SCALE:	1/8" = 1'-0"
PROJECT MANAGER:	DJV
JC/DRAWN BY:	BGC
A/E OF RECORD:	TAC
PROJECT NO:	11063
DATE:	02.24.12

SHEET TITLE:
BASEMENT SUPPLY PIPING DEMOLITION PLAN

SHEET No.
PD102

©COPYRIGHT 2008 SMRT INC.