



8TH FLOOR-RICHARDS BUILDING

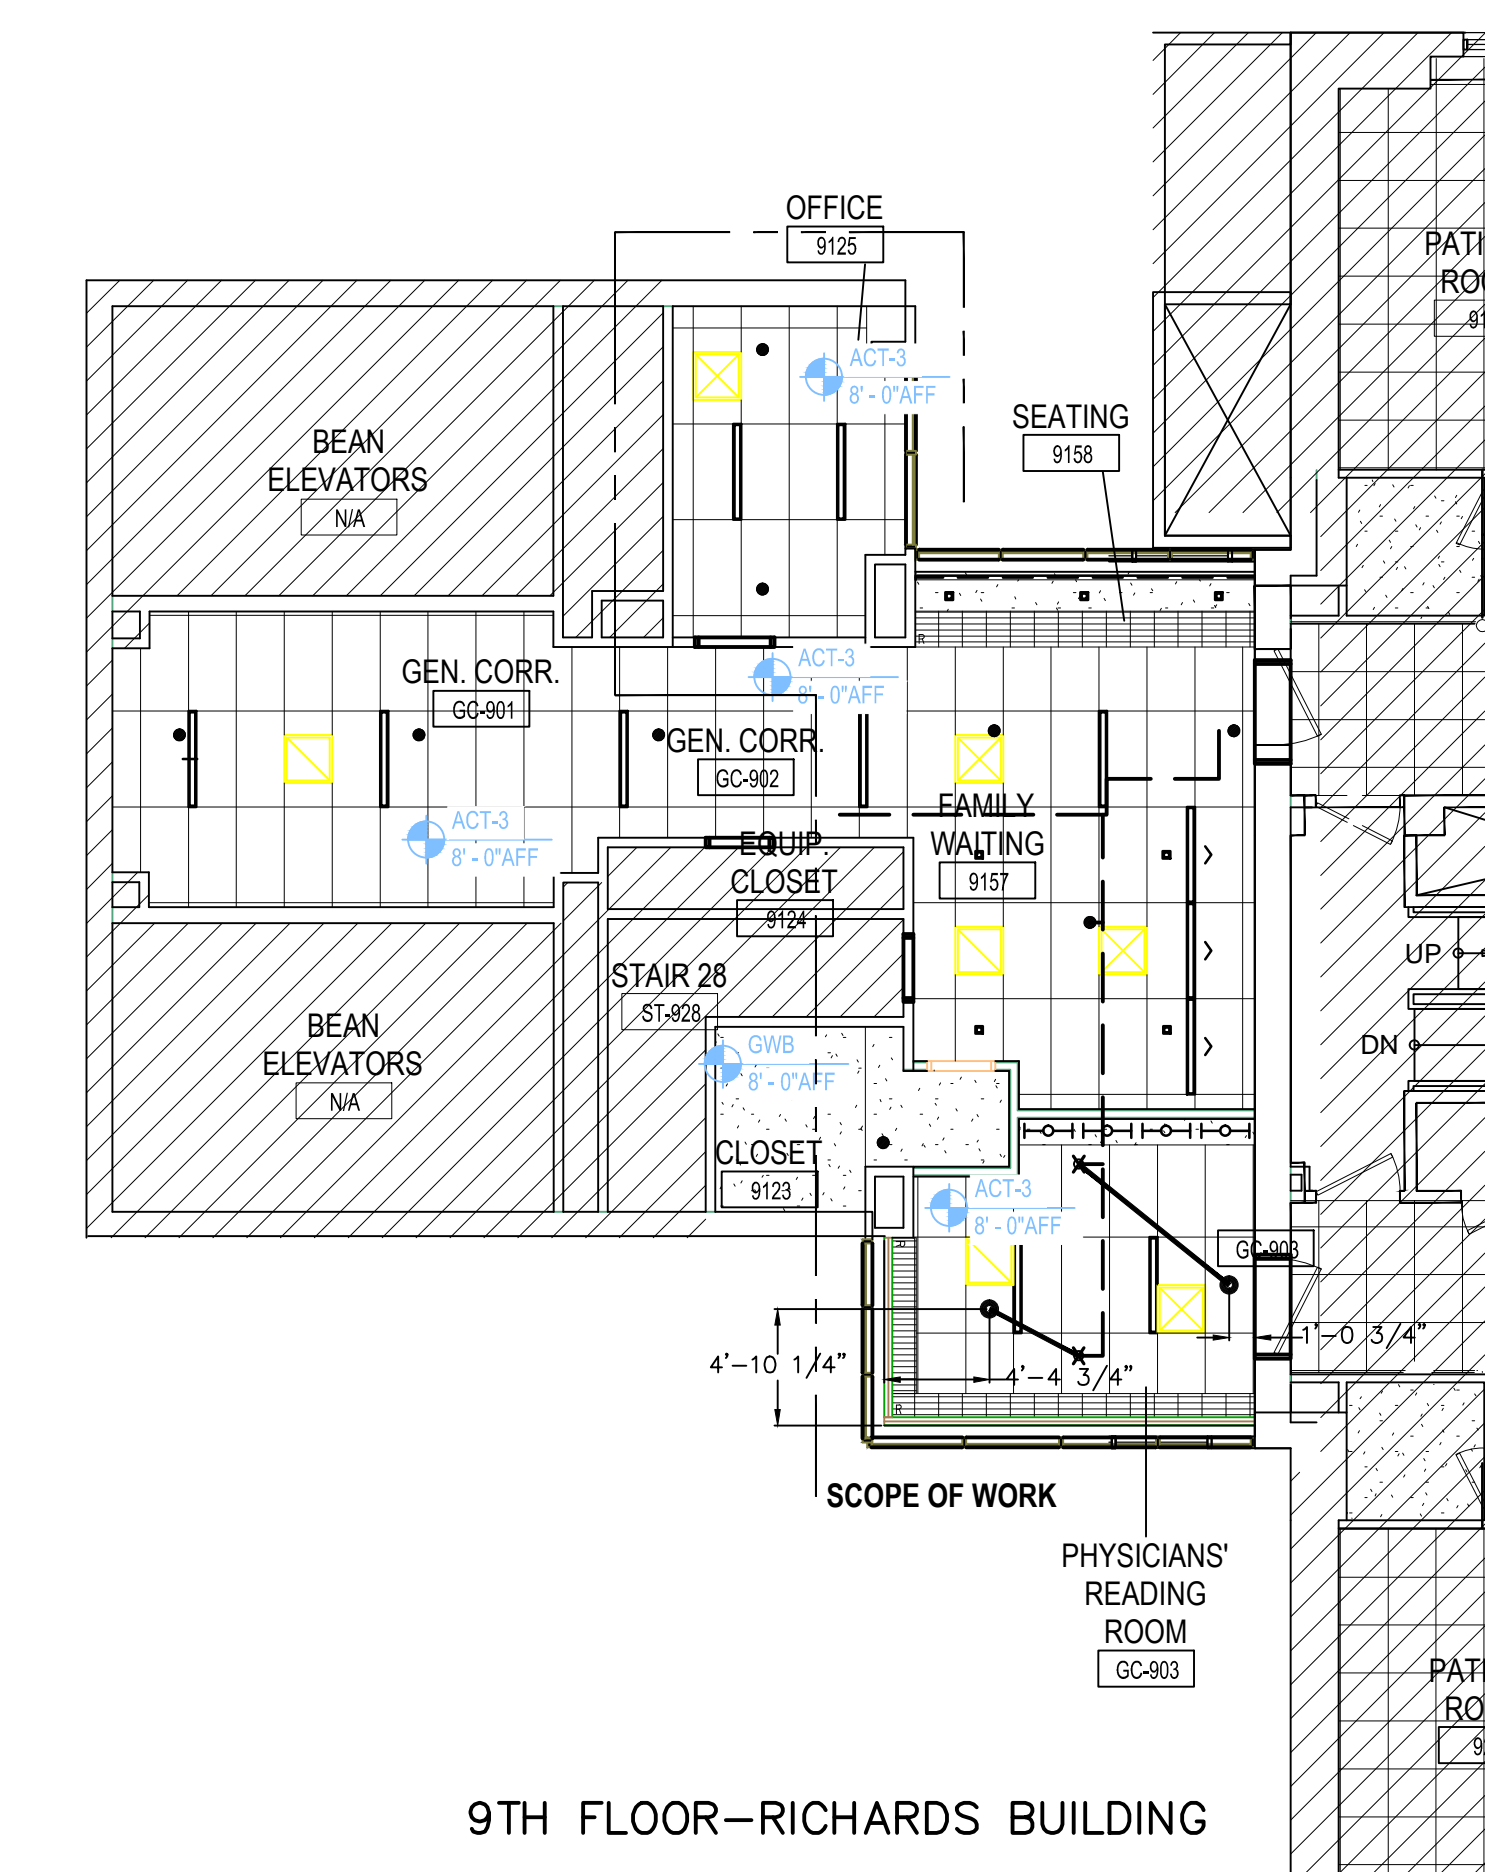

9TH FLOOR-RICHARDS BUILDING

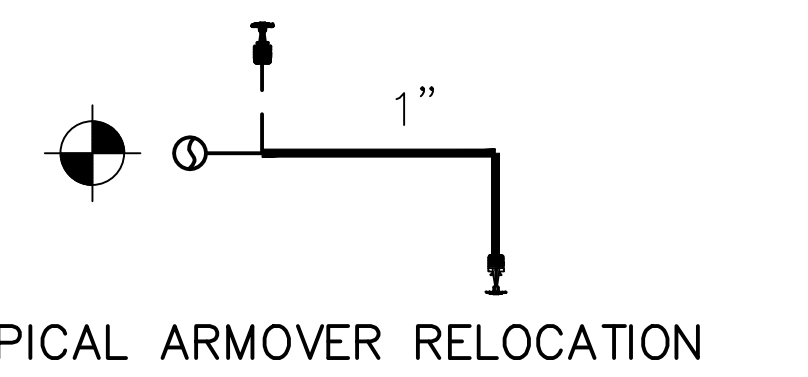


NOTE A: PIPING BEYOND THIS POINT IS TO BE VERIFIED DURING A LATER PHASE OF RENOVATION

GENERAL NOTES:
 ALL SPRINKLER PIPING TO BE TIED INTO EXISTING SYSTEM WITH SCHEDULE 40 STEEL PIPE AND FITTINGS.
 BUILDING AREAS BEYOND SUBJECT WORK ARE FULLY SPRINKLERED. EXISTING HEADS & PIPING OUTSIDE OF SUBJECT AREAS ARE NOT SHOWN FOR CLARITY.


SCOPE OF WORK:
 RENOVATE AN EXISTING WET SYSTEM OF AUTOMATIC SPRINKLERS THROUGHOUT THE REVISED PAVILION AND THE 7TH, 8TH & 9TH FLOORS OF THE RICHARDS BLDG. THIS IS SPRINKLER HEAD RELOCATION ONLY TO SUIT NEW ROOM LAYOUTS. THERE IS NO CHANGE TO OCCUPANCY OR HYDRAULIC DEMAND. NO UPDATED HYDRAULIC CALCULATIONS ARE REQUIRED.

LEGEND:


- CONCEALED SPRINKLER ON A BRANCH LINE
- F.g = X'-X" FINISHED FLOOR TO PIPE CENTERLINE
- ⊗ LOCATION OF EXISTING 1" OUTLET
- SPRINKLER HEAD TO REMAIN

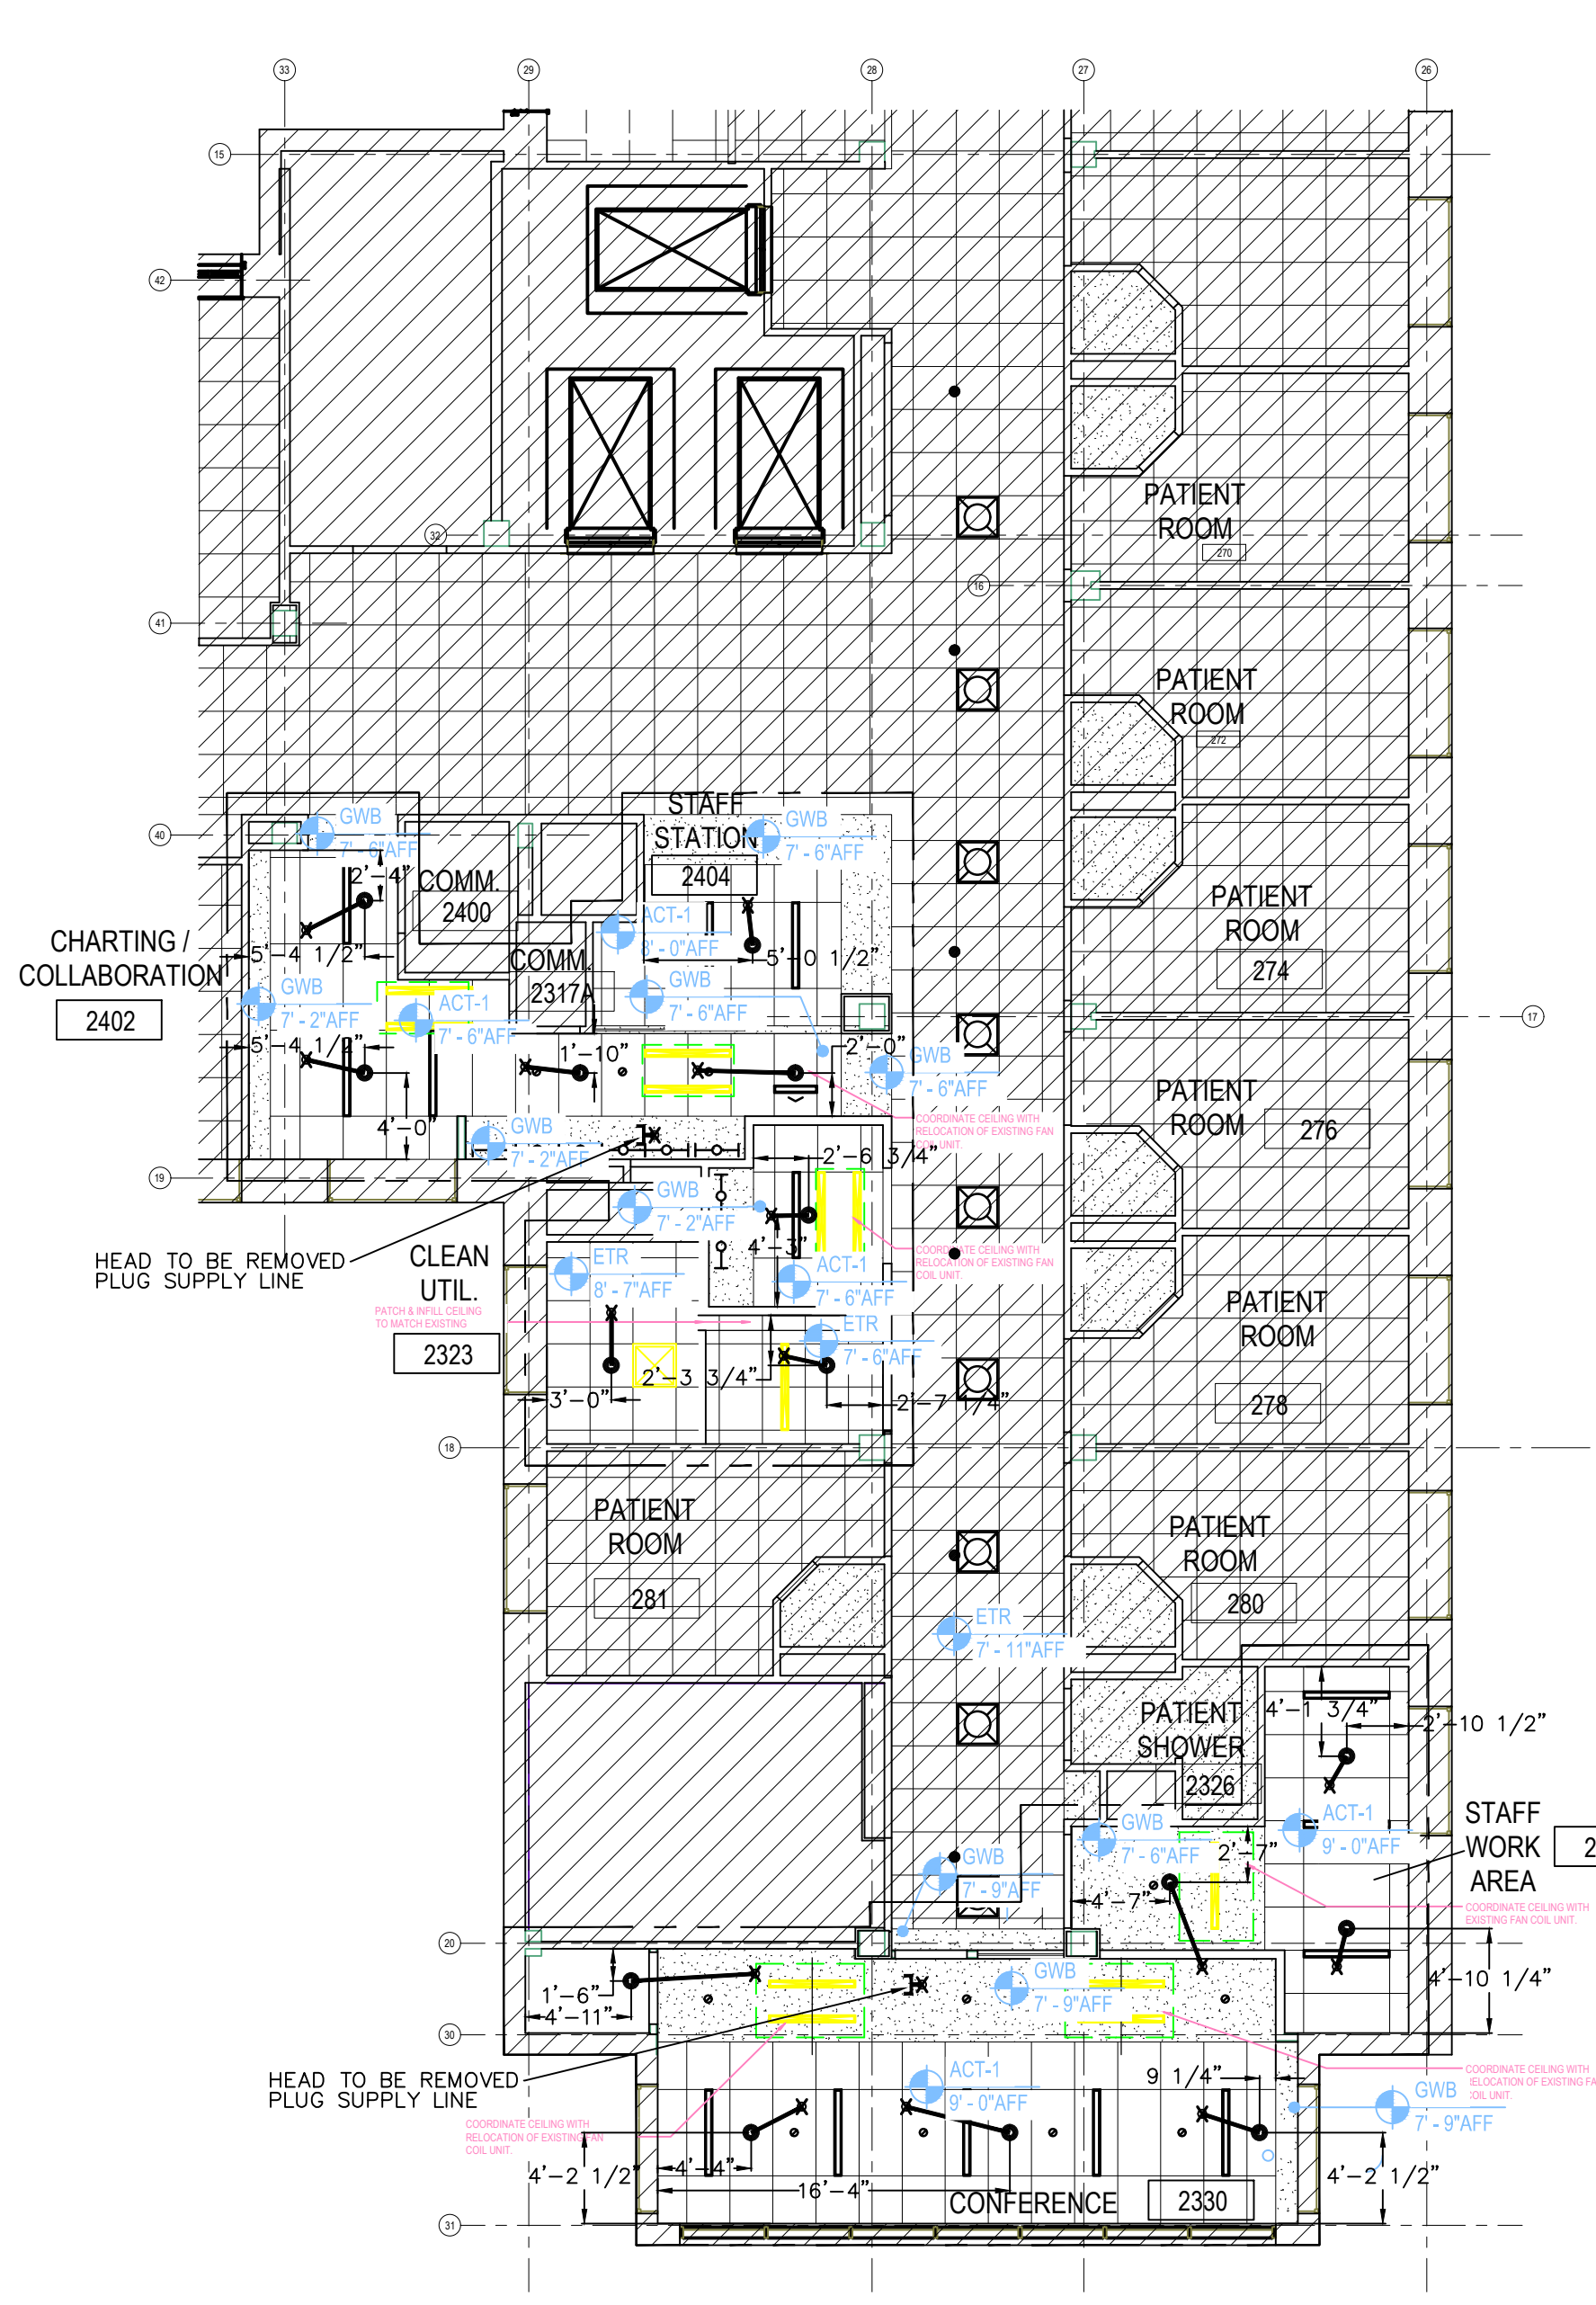


PAVILION - SOUTH

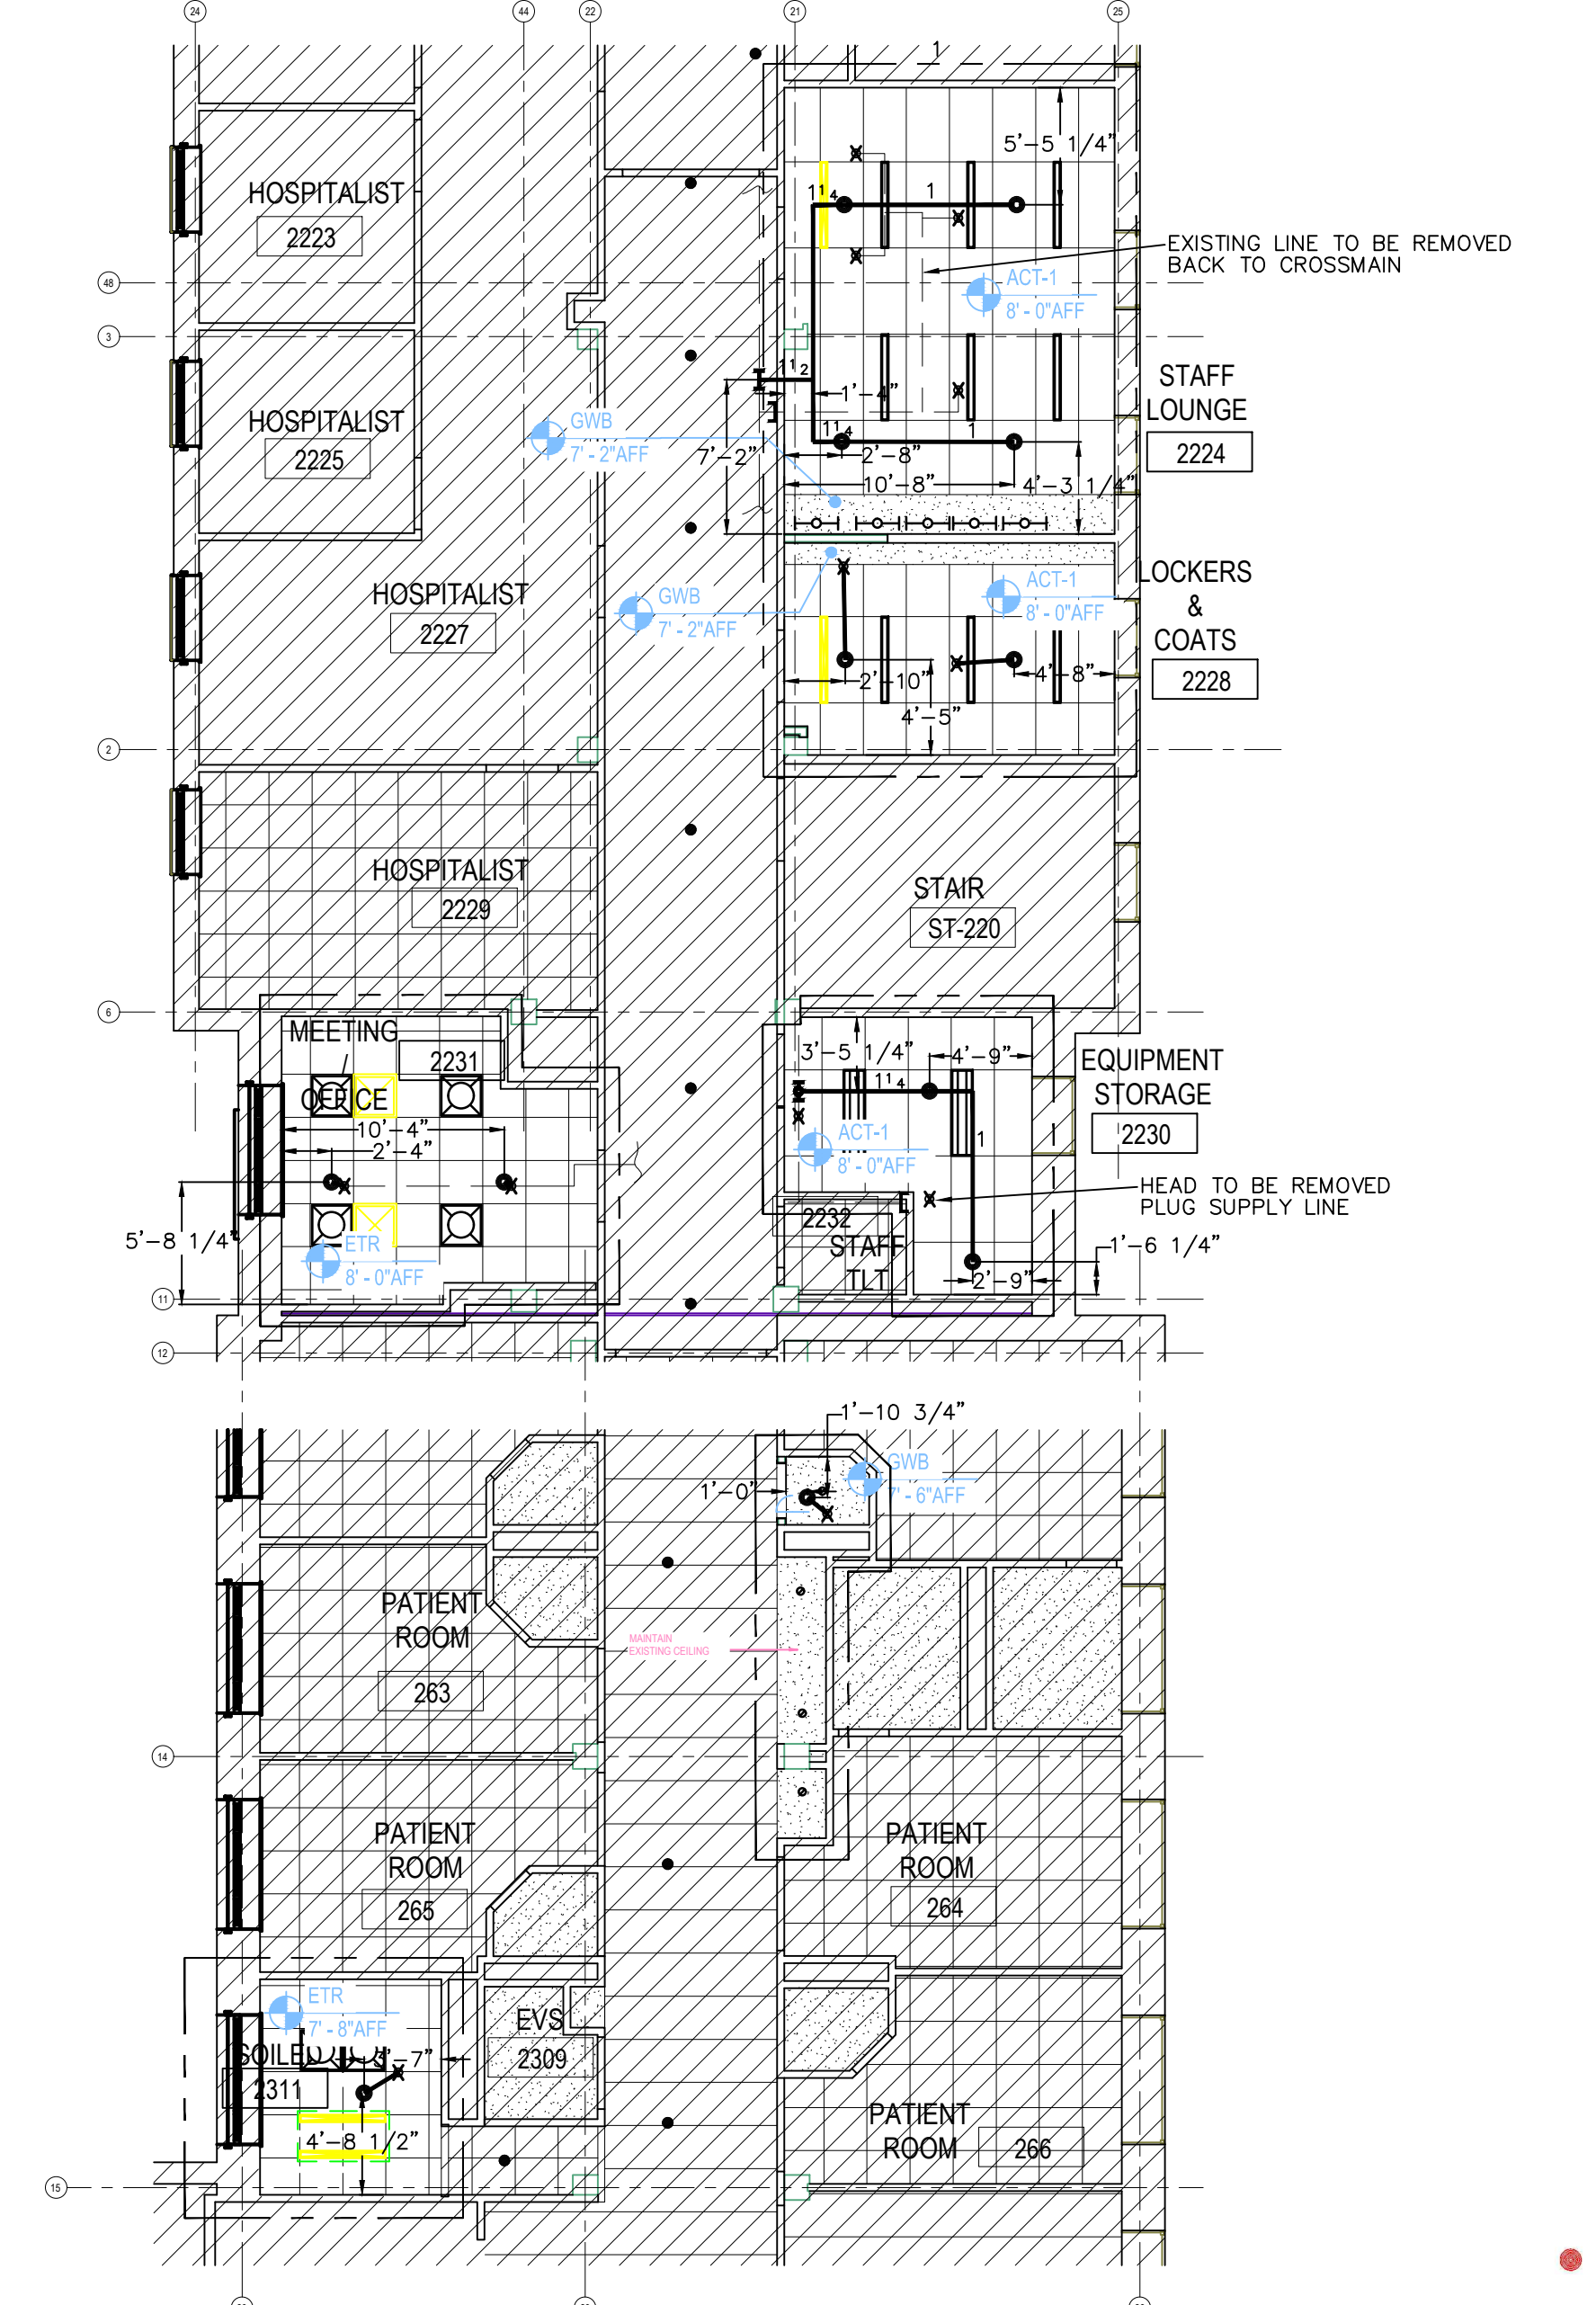

PAVILION - NORTH

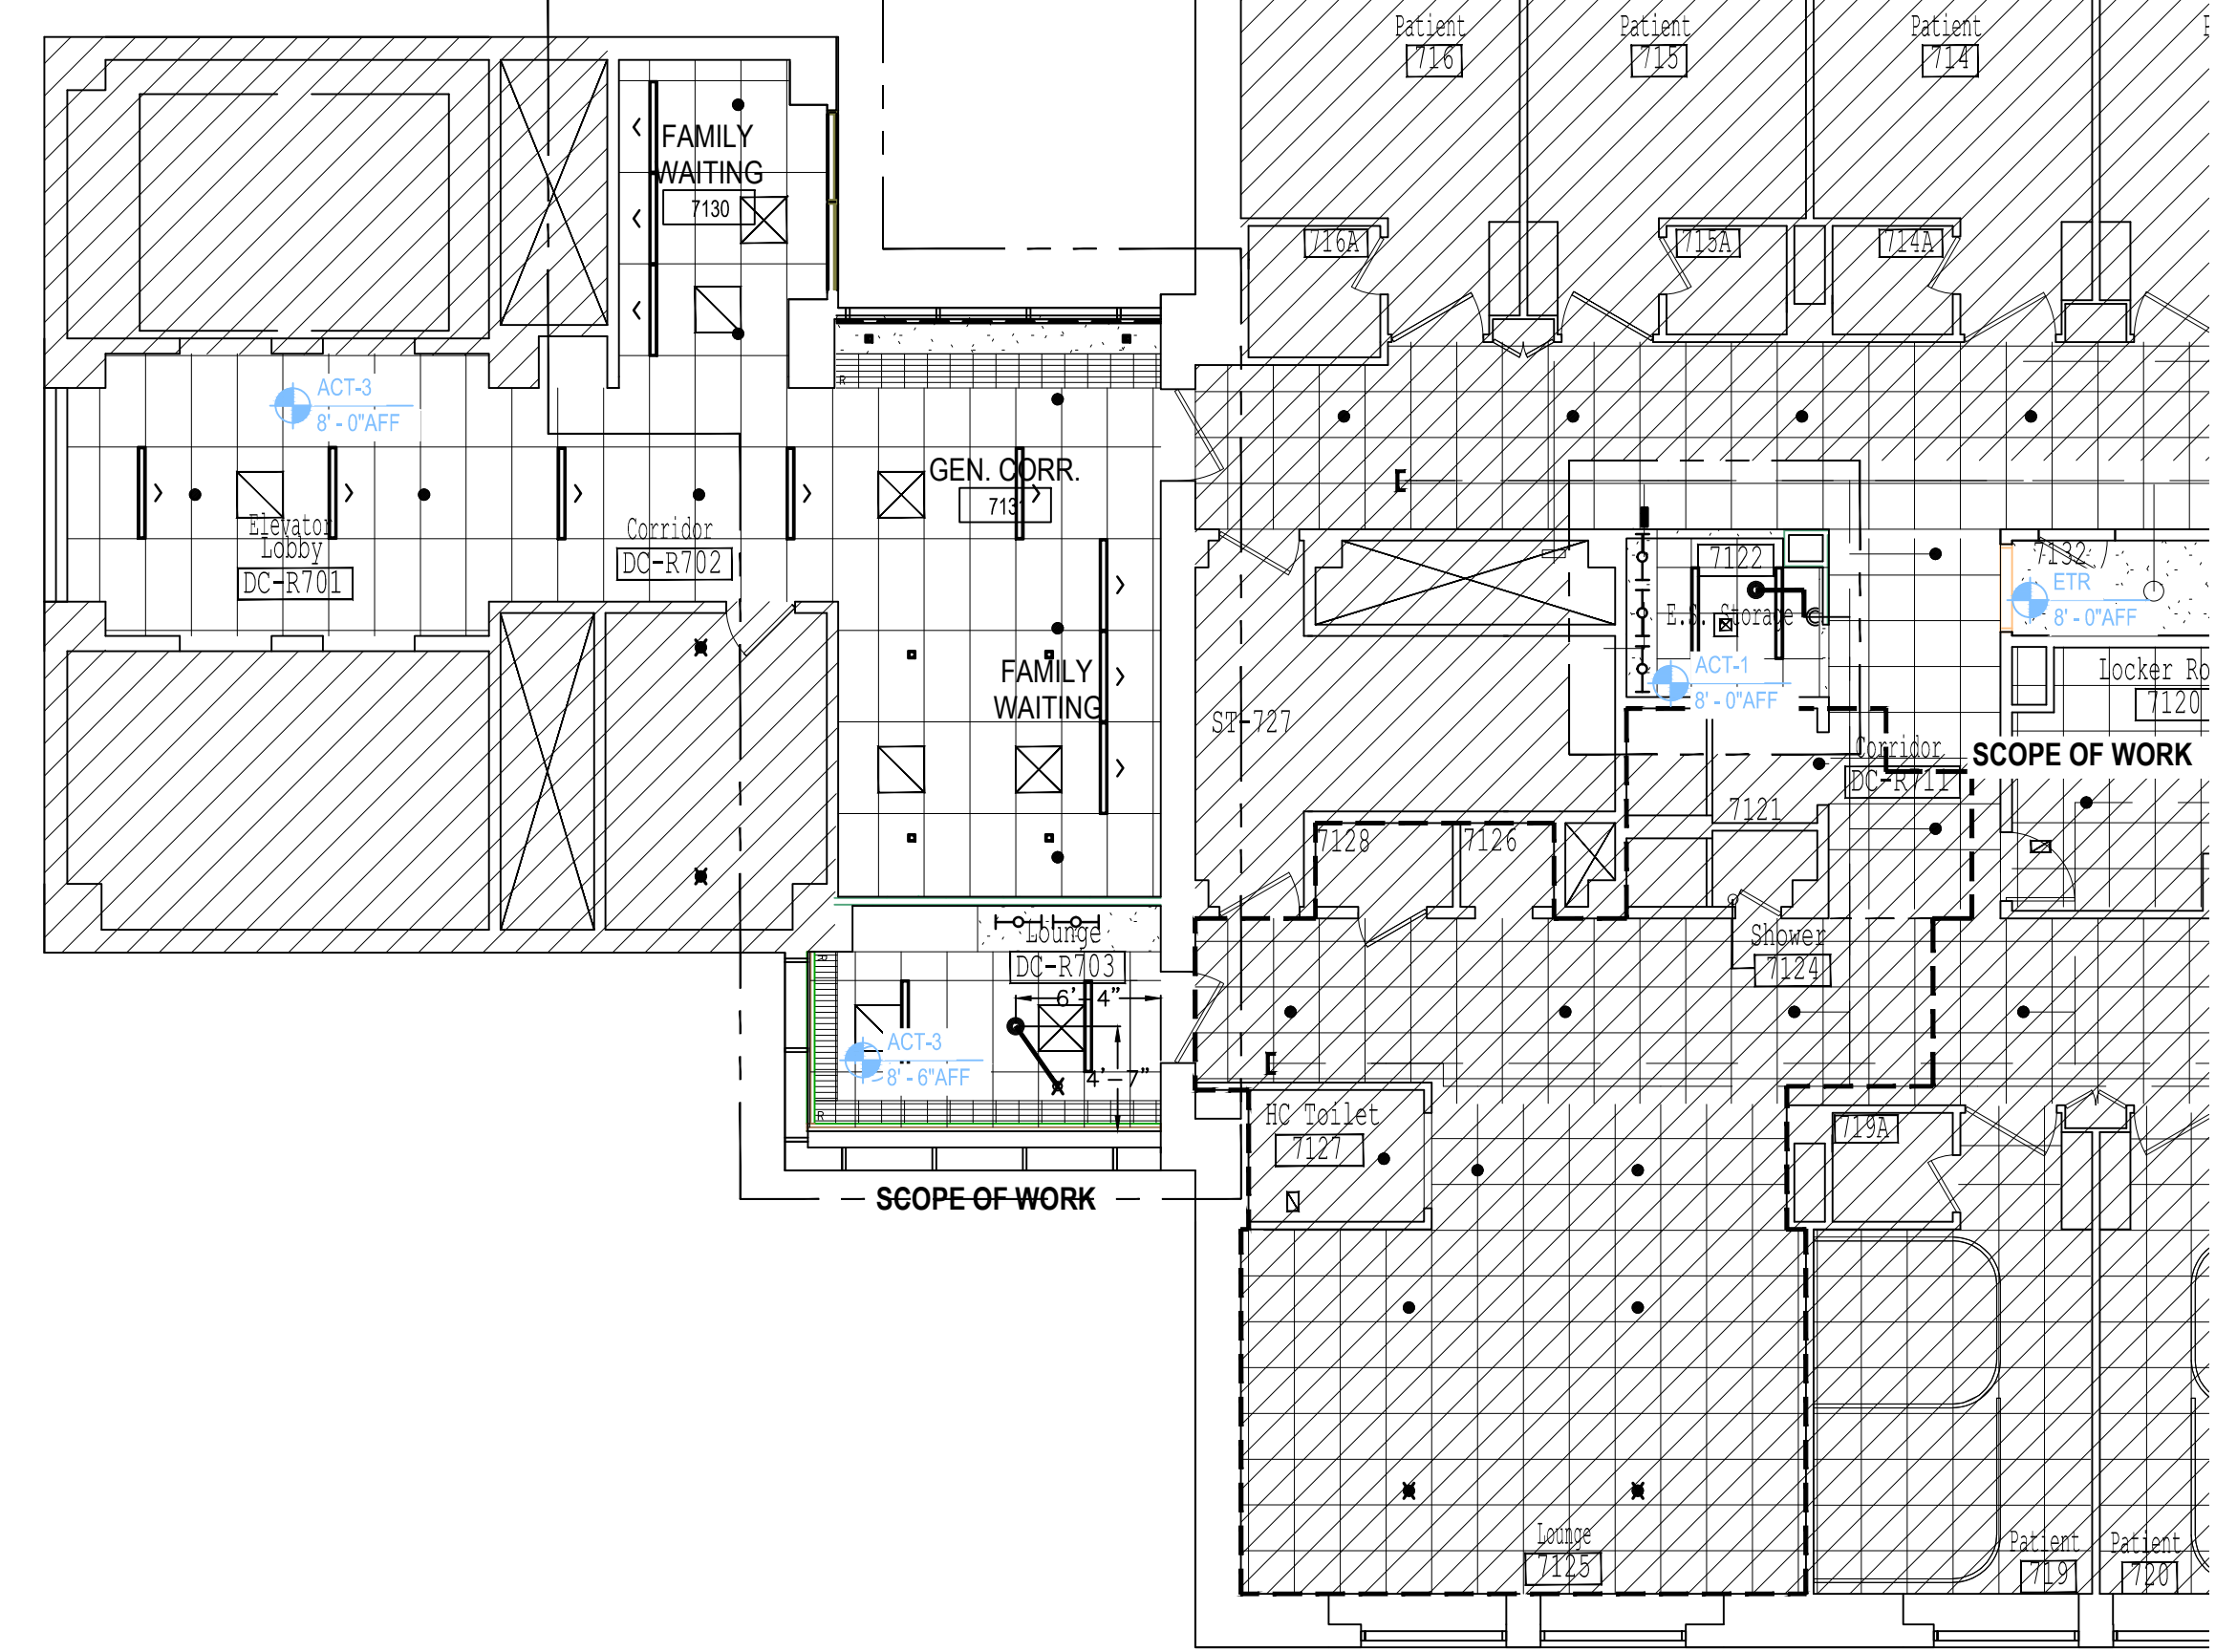

7TH FLOOR-RICHARDS BUILDING

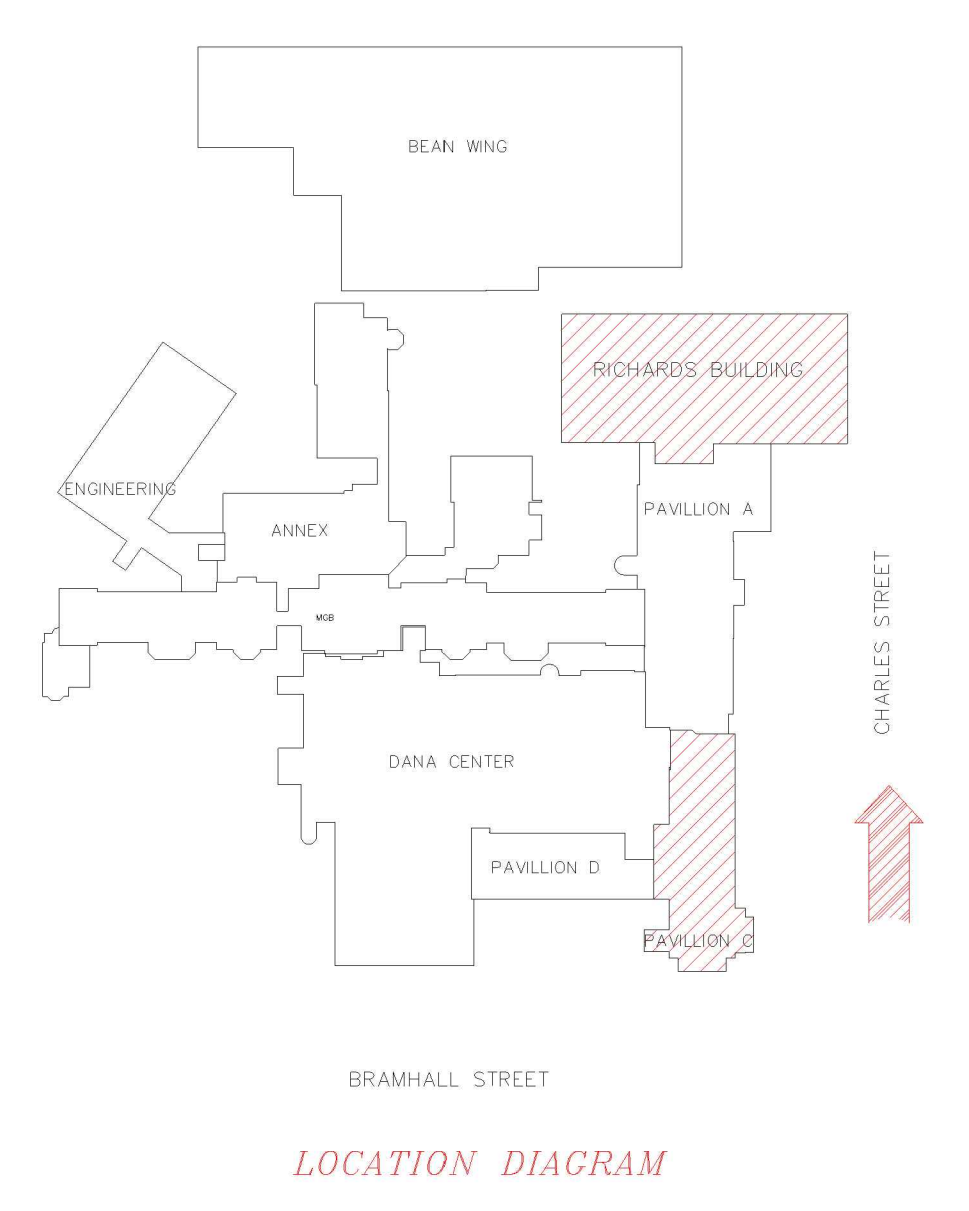

LOCATION DIAGRAM

DEAN & ALLYN, INC.
 FIRE PROTECTION • SPECIAL HAZARD
 116 LEWISTON ROAD, GRAY, MAINE 04039
 (207)657-5646 FAX:(207)657-5647

		DANA A. STEWART NICET IV - #064544		DRAWING TITLE: ACCU2 RENOVATIONS		REV. 0	
APPROVED BY: _____ DATE: _____		SURVEYED BY: PLAN _____ DATE: _____		JOB: MAINE MEDICAL CENTER 22 BRAMHALL STREET PORTLAND, MAINE 04102		NO. OF SPRINKLERS SHOWN ON THIS SHEET 114	
(C) FOR SUBMITTAL 12/21/16		DRAWN BY: DDS 11/22/16		CONTRACT WITH: LANGFORD AND LOW 148 WARREN AVENUE PORTLAND, MAINE 04101		CONTRACT NO. C161375	
(P) FOR PERMIT 12/21/16		CHECKED BY: DN 11/22/16		SCALE 1/8"=1'-0" U/N SHEET NO. 1 OF 1		NO. OF SPRINKLERS ON JOB 114	
(S) SUBMIT FOR COORD 12/22/16		DATE: _____		REVISIONS: _____			

114 VIKING WK462 - PART NUMBER 13505A
 155' QUICK RESPONSE / STANDARD COVERAGE
 CONCEALED PENDENT W/ WHITE COVERPLATE
 1 1/2" x 1 1/2" K=4.56
 HEAD WRENCH - PART NUMBER 14047 (STANDARD)