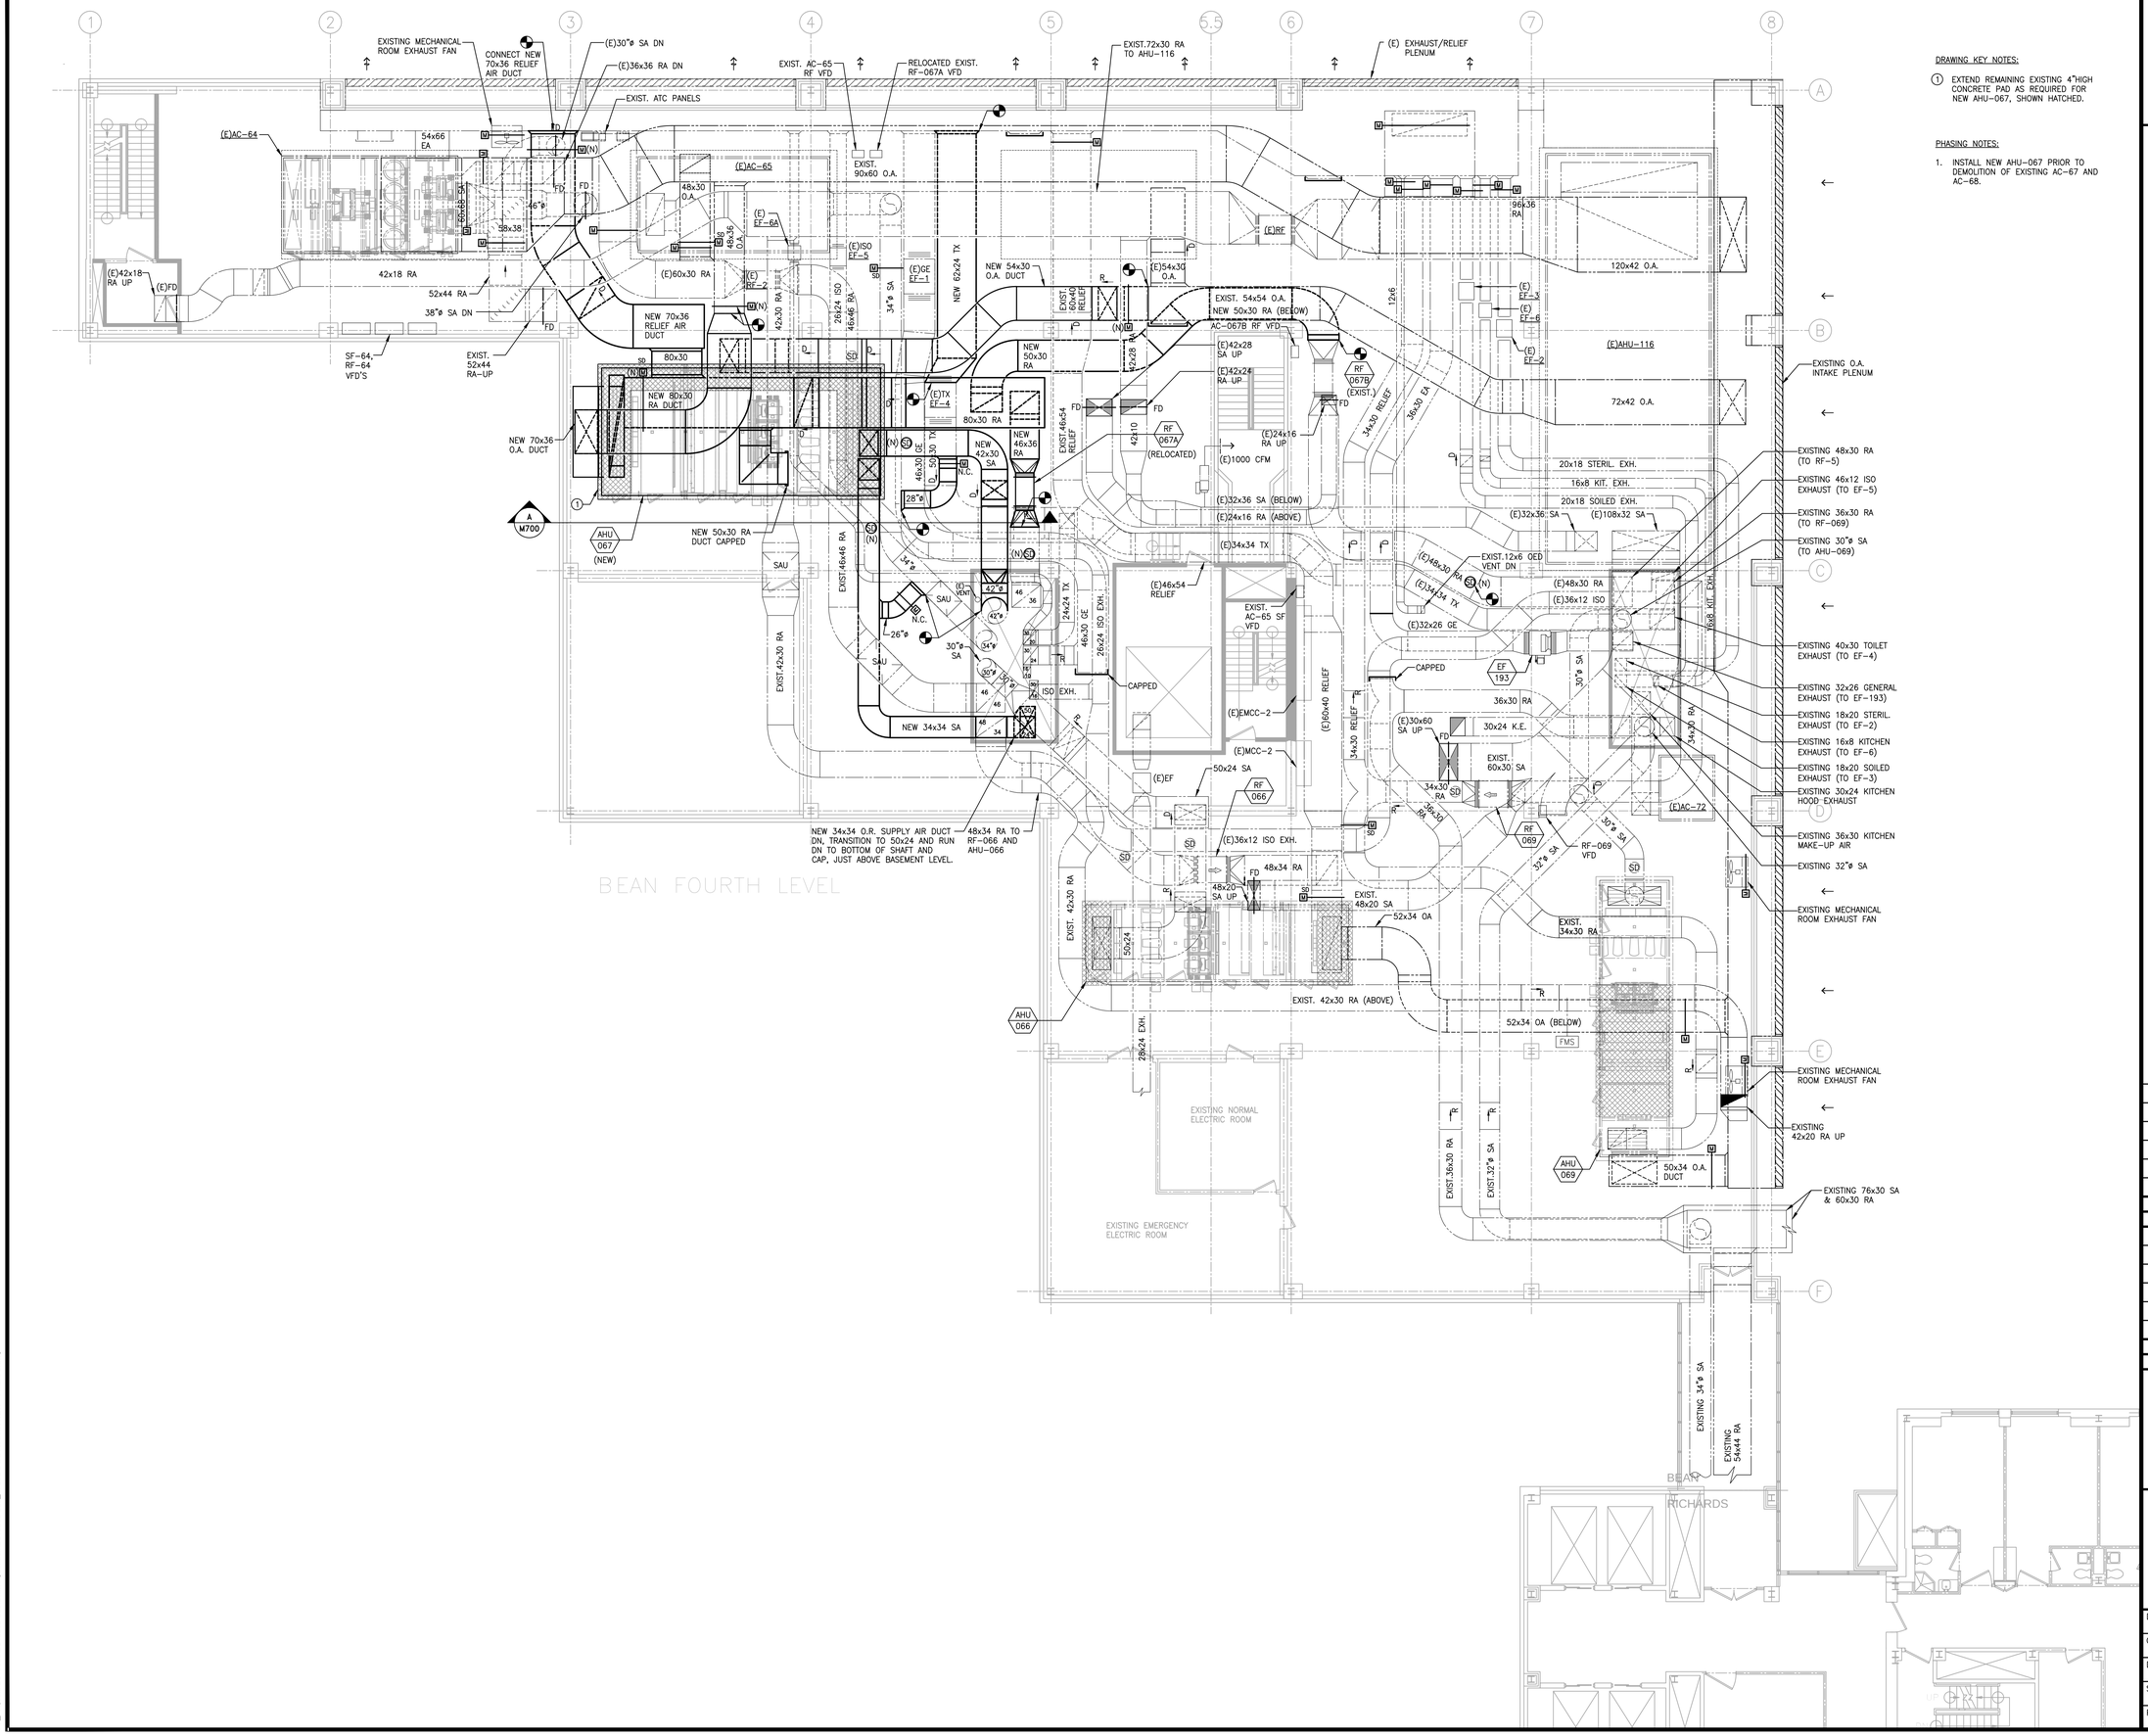

DRAWING KEY NOTES:

1. EXTEND REMAINING EXISTING 4"HIGH CONCRETE PAD AS REQUIRED FOR NEW AHU-067, SHOWN HATCHED.

PHASING NOTES:

1. INSTALL NEW AHU-067 PRIOR TO DEMOLITION OF EXISTING AC-67 AND AC-68.

AKF
99 Bedford Street, 2nd Fl.
Boston, MA 02111
T: 617.737.1111 F: 617.737.4311
ABINGTON / BOSTON / MEXICO CITY / MINNEAPOLIS / NEW YORK
PHILADELPHIA / PRINCETON / ROCHESTER / STAMFORD
ENGINEERING / ANALYSIS & TESTING / BUILDING MANAGEMENT SYSTEMS / CIVIL/SITE / LEED CONSULTING / COMMISSIONING / CRITICAL SYSTEMS / ENERGY & SUSTAINABILITY
FIRE PROTECTION / IT/AV/SECURITY / KITCHEN DESIGN / SPECIALIZED CODES
www.AKFgroup.com

No.	Date	Description
		REVISION
	02/27/2015	CONSTRUCTION DOCUMENTS
	01/26/2015	FOR OWNER REVIEW
	12/01/2014	DESIGN DEVELOPMENT
No.	Date	Description
		ISSUE

PROJECT

Maine Medical Center
Bean Building
AHU Replacement

DRAWING TITLE

MECHANICAL
PENTHOUSE DUCTWORK
NEW AHU-067 PLAN
PHASE 3

Drawn By	TU
Checked By	DPR
Date	12/01/2014
Scale	1/8"=1'-0"
Project No.	B140263-000

Drawing No.

M-302

SAVE DATE: 2/27/2015 2:31 PM
PLOT DATE: 2/27/2015 2:31 PM
LOGIN: Ustain, Antonina
P:_Projects\B140000\B140263-000\Drawings\Mech\B140263-000_M-302 DUCTWORK NEW - Phase 3.dwg