


General Notes:

1. EXISTING SPRINKLERS IN THIS AREA TO BE REMOVED, INCLUDING ALL ASSOCIATED PIPING BACK TO ACTIVE MAIN AND CAPPED WATER STOP. VERIFY SPRINKLER SYSTEM.
2. REMOVE EXISTING SPRINKLERS AND PIPING AS NOTED TO SHIP NEW EXISTING INSTALLATIONS.

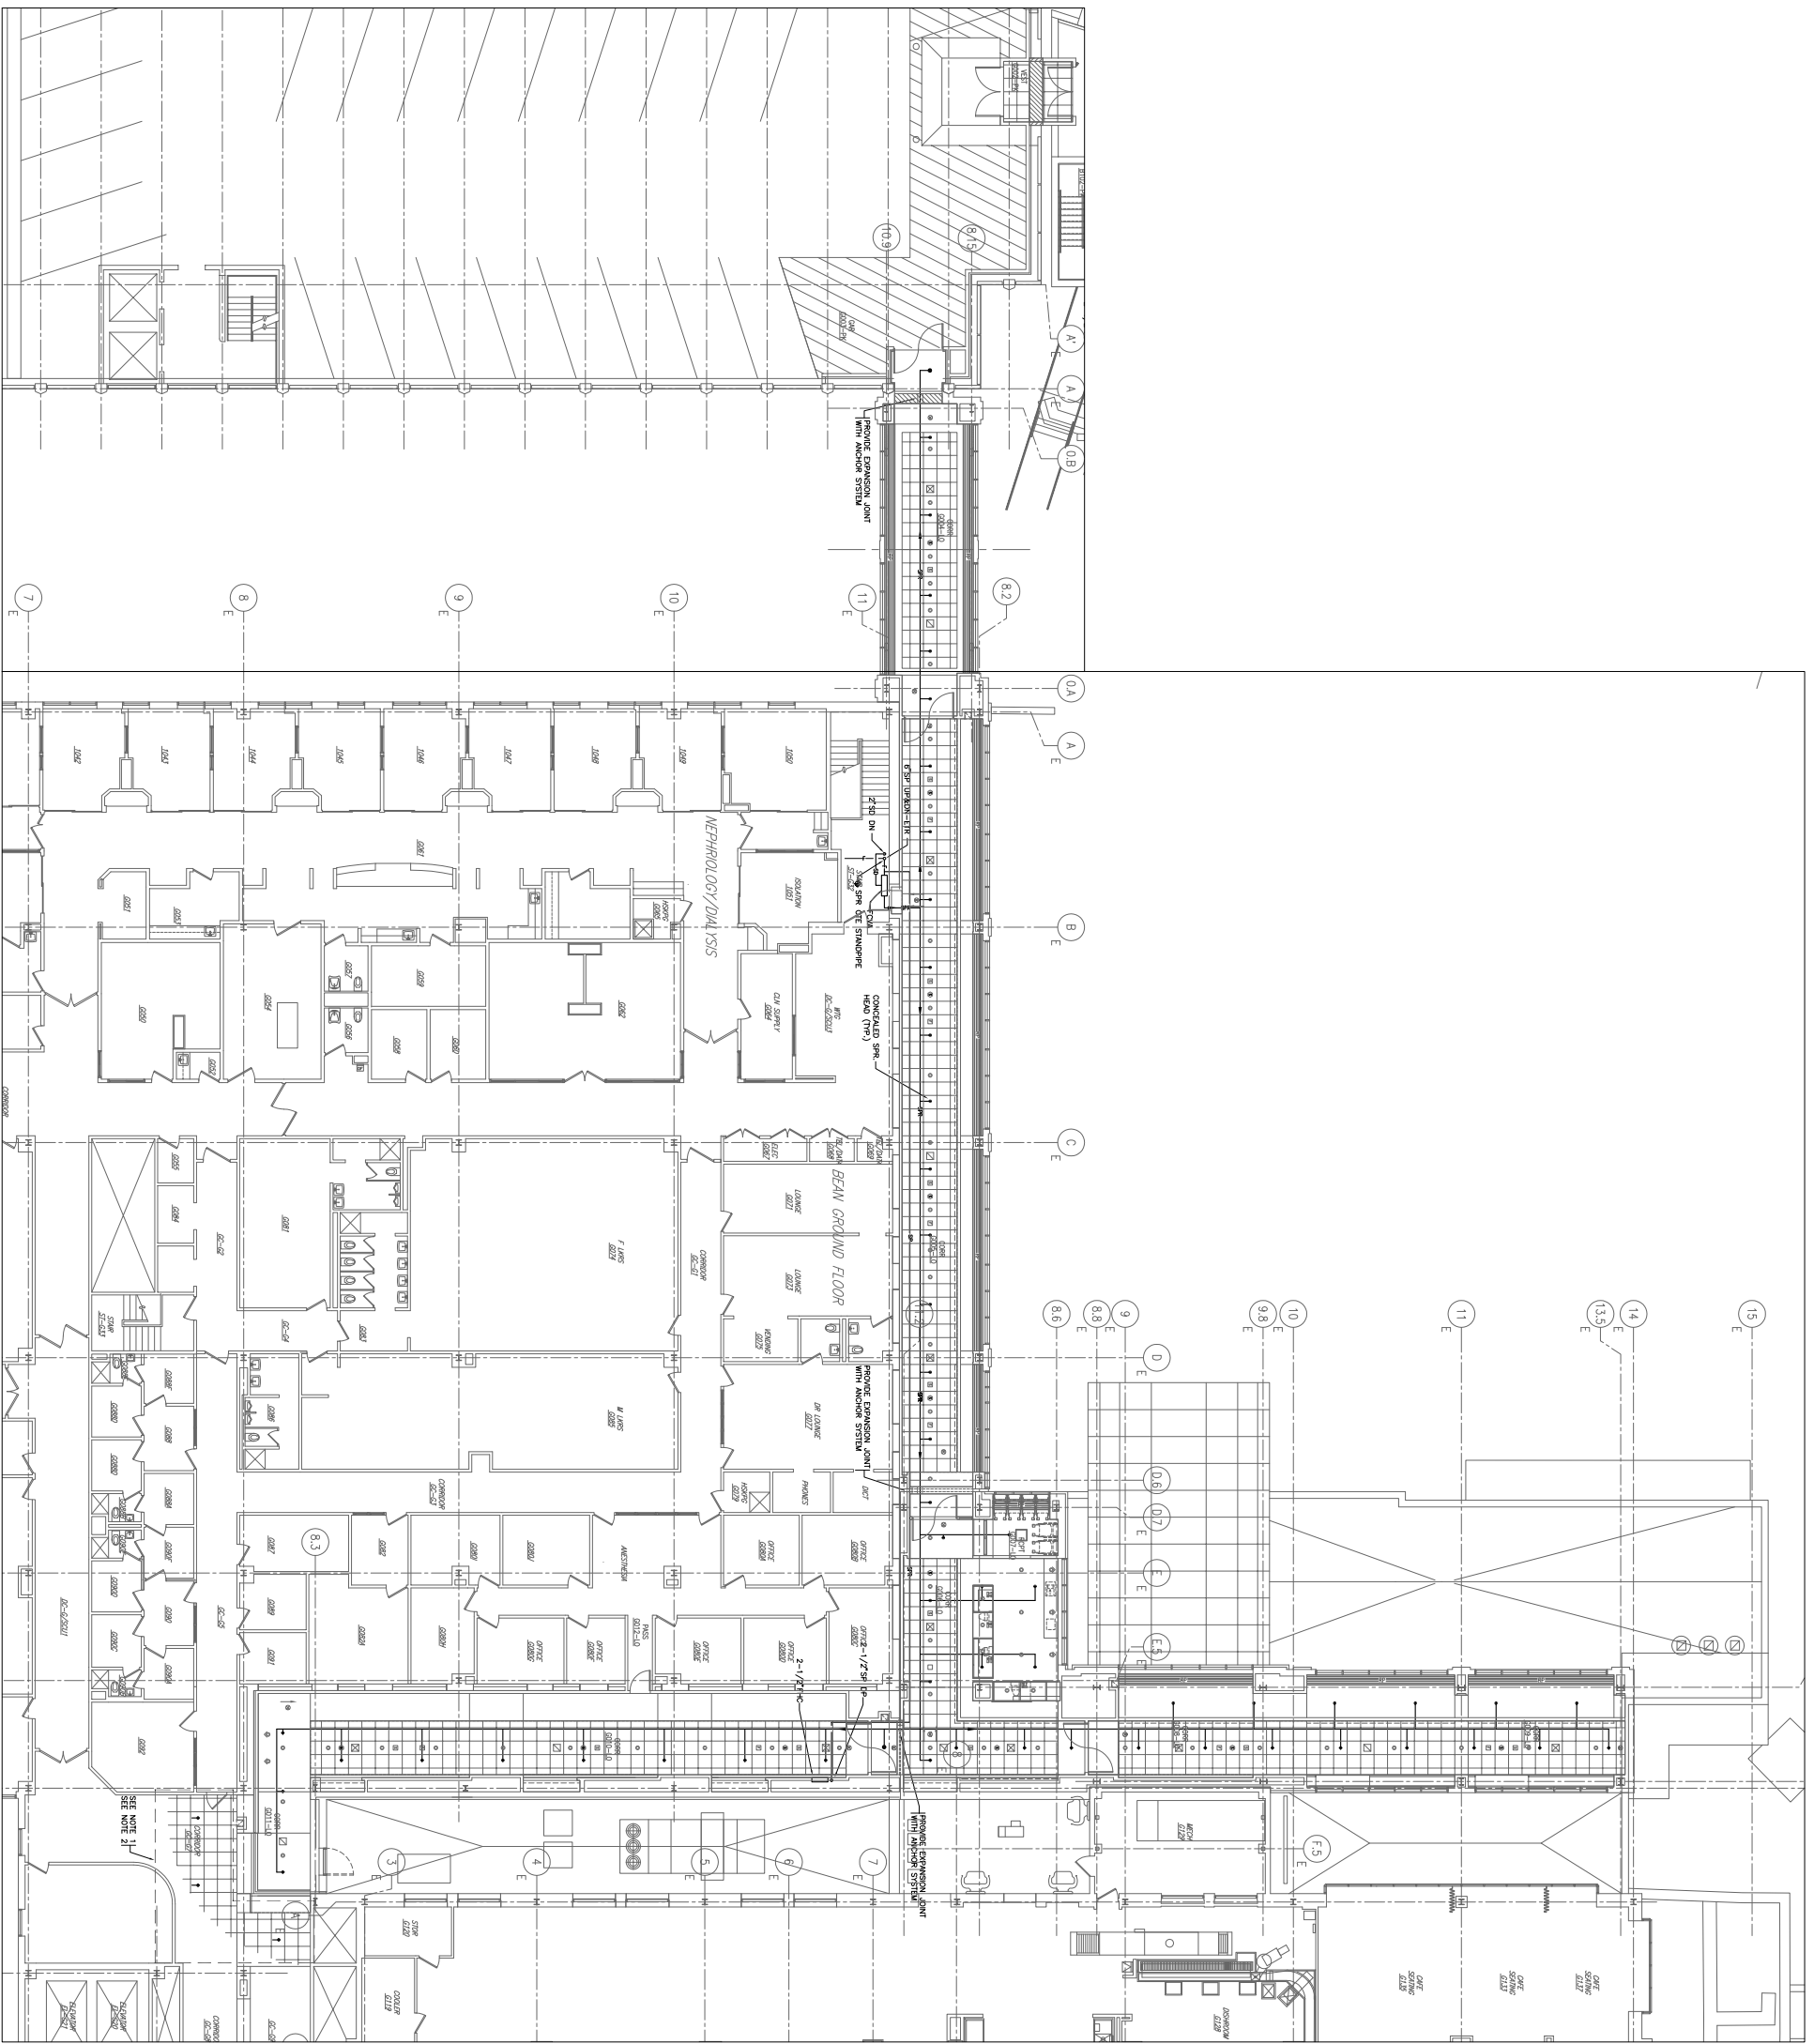

DATE: 08/14/24

DESCRIPTION: FIRE PROTECTION CONNECTOR


ISSUE DATE: 08/14/24

SCALE: AS SHOWN

PROJECT: 24-1179-10

NO: 02

SCALE LOG



Maine Medical Center
 Pkg F - Garage / Vault / Conn / Helipad
 Portland, ME
 MMC Project No. 21845

**FIRE PROTECTION CONNECTOR
 GROUND LEVEL PLAN**

Commission No.	4878	Issue Number	02/14/24
Drawn By	ML	Sheet Number	FP20G.2
Checked By	ML		
Approved By	ML		
Project No.	21845		
Project Name	24-1179-10		
Project Location	30 Main Street		