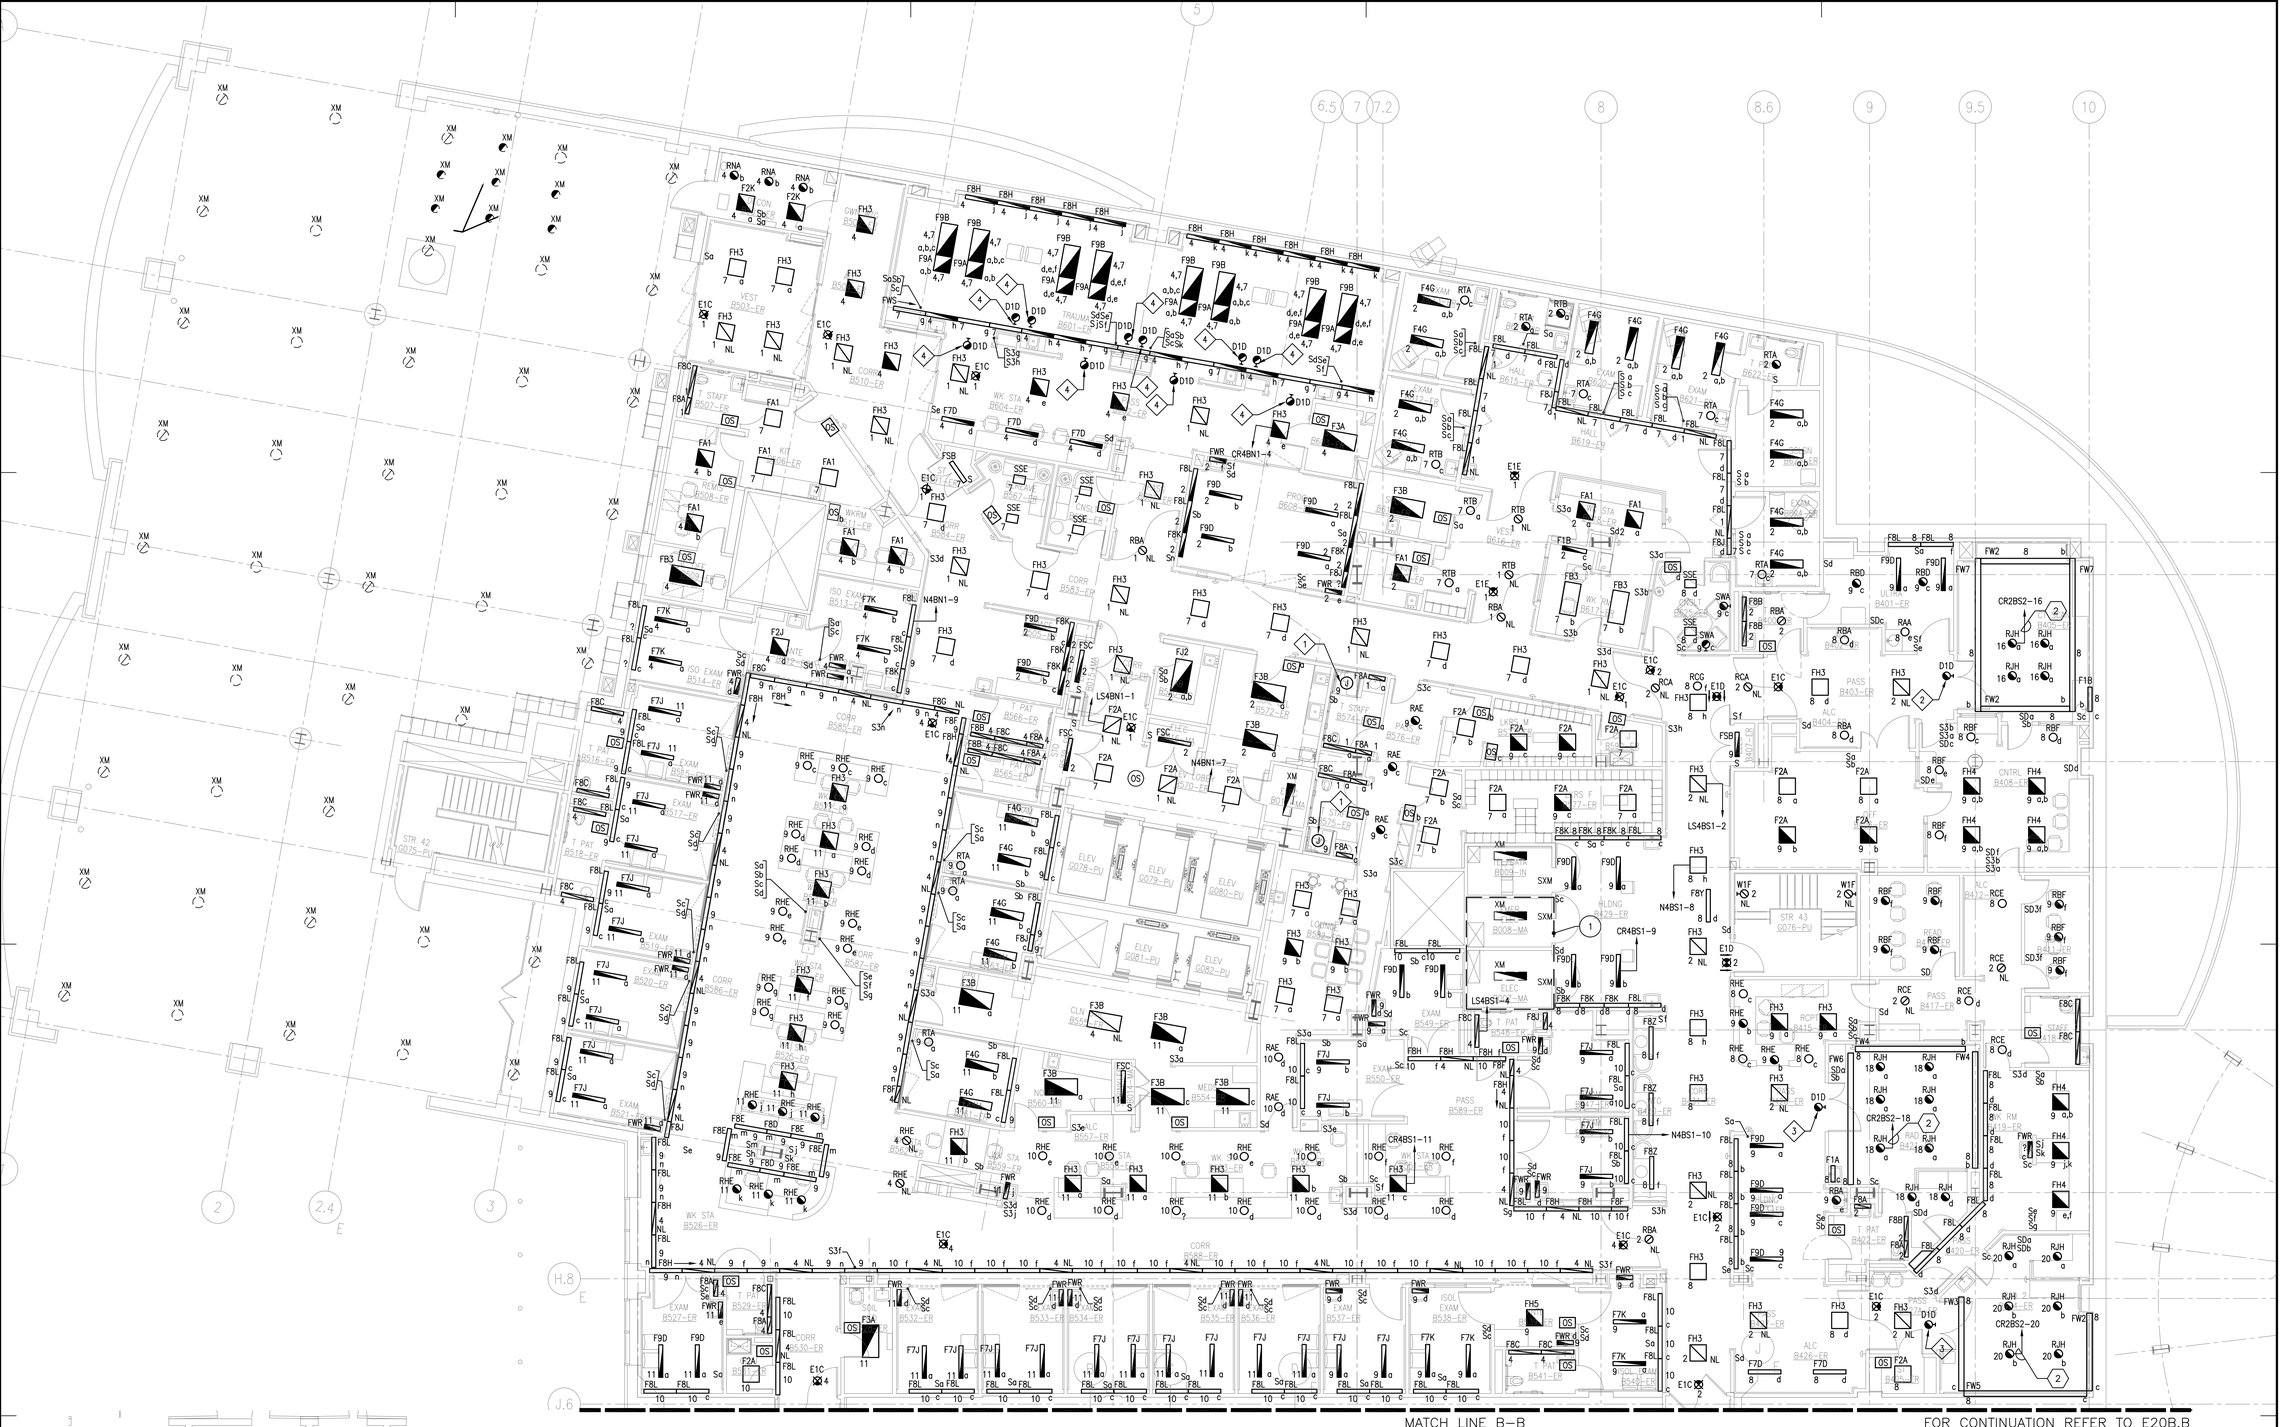

1 BASEMENT FLOOR LIGHTING PLAN
1/8" = 1'-0"

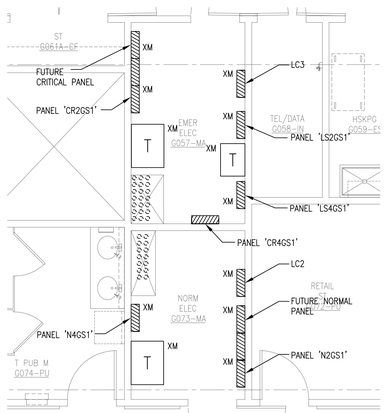

2 EXISTING GROUND FLOOR NORMAL AND EMERGENCY ELECTRICAL CLOSETS (SOUTH)
1/4" = 1'-0"

General Notes:

DRAWING NOTES:

1. EXISTING GROUND FLOOR SOUTH ELECTRICAL CLOSETS ARE LOCATED BELOW. SEE PART PLAN ON THIS DRAWING.

EQUIPMENT NOTES:

1. CRITICAL POWER CONNECTION TO SHOWER LIGHT FURNISHED BY DIVISION 15 AND INSTALLED BY ELECTRICAL CONTRACTOR.
2. REFER TO DRAWING E500 FOR CIRCUIT AND WIRING REQUIREMENTS.
3. REFER TO DRAWING E501 FOR CIRCUIT AND WIRING REQUIREMENTS.
4. REFER TO DRAWING E502 FOR CIRCUIT AND WIRING REQUIREMENTS.

BRANCH CIRCUIT NOTES:

1. UTILIZE SPARE 1P–20A CIRCUIT BREAKERS FOR ALL HOMERUNS INDICATED ON THIS DRAWING UNLESS OTHERWISE NOTED.
2. HOMERUN TO NEW PANELBOARD.

MARK	ISSUE DATE	DESCRIPTION
BID	12/14/07	BID SET

Issue Log



Key Plan

TRO Jung|Brannen
ARCHITECTURE INTERIOR DESIGN ENGINEERING MASTER PLANNING
22 Boston Wharf Road, Boston, Massachusetts 02210
Tel 617.502.9400 Fax 617.502.3402 www.trojungbrannen.com

Maine Medical Center
ED Expansion and Renovation
Portland, Maine MMC Project No. 21843

Drawing Title
ELECTRICAL BASEMENT FLOOR LIGHTING PLAN

Drawn By	AB	Commission No.	4696
Approved By	KG	Date Issued	12/14/07

Phase / Package Number	Sheet Number
	E20B.A

Copyright © 2007 TRO Jung|Brannen

4696EPF–00B–LTG–96